



CERTIFICATE OF AUTHENTICITY

THIS IS TO CERTIFY THAT THE FOLLOWING ELECTRONIC RECORDS ARE TRUE AND ACCURATE REPRODUCTIONS OF THE ORIGINAL RECORDS OF JAMES CITY COUNTY GENERAL SERVICES DEPARTMENT- STORMWATER DIVISION; WERE SCANNED IN THE REGULAR COURSE OF BUSINESS PURSUANT TO GUIDELINES ESTABLISHED BY THE LIBRARY OF VIRGINIA AND ARCHIVES; AND HAVE BEEN VERIFIED IN THE CUSTODY OF THE INDIVIDUAL LISTED BELOW.

BMP NUMBER: CC022

DATE VERIFIED: November 15, 2017

QUALITY ASSURANCE TECHNICIAN: Jonathan Craig

LOCATION: WILLIAMSBURG, VIRGINIA



Stormwater Division

MEMORANDUM

DATE: November 15, 2017
SCANNER: Jonathan Craig, Assistant Environment Coordinator
RE: Files Approved for Scanning

Maintenance Agreements: YES
(in file as of scan date)

General File ID or BMP ID: CC022
PIN: 3911200001B
Owner Name: JAMES CITY COUNTY
Legal Description: COMMON OPEN SPACE P-1 IRONBOUND VILLAGE
Local Address: 5335 PALMER LANE

Easement:

Recorded Plat:

Comments: Scanned and added 1 record drawing. Hard copy destroyed. Added full and unmarked copy of maintenance agreement 040024115 from courthouse records.



Stormwater Division


MEMORANDUM

DATE: July 22, 2014
TO: Michael J. Gillis, Virginia Correctional Enterprises Document Management Services
FROM: Jacob Smith, Stormwater Intern
PO: 110426
RE: Files Approved for Scanning

NAME PDF/SCANNED FILE:		IRONBOUND VILLAGE	
BMP ID OR GEN FILE NUMBER:	99179	OWNER NAME:	CUTTING EDGE DEVELOPMENT HANKINS FAMILY
PIN:	N/A	SITE ADDRESS:	N/A
		LEGAL DESCRIPTION:	N/A

MAINTENANCE AGREEMENT IN FILE:	N/A	BOOK/PAGE OR DOCUMENT NO.:	N/A	OTHER DESCRIPTION:	N/A
---	-----	---------------------------------------	-----	-------------------------------	-----

BOX NO.:	1	COMMENTS:	AMENDMENT
-----------------	---	------------------	-----------



Stormwater Division

MEMORANDUM

DATE: March 11, 2010
TO: Michael J. Gillis, Virginia Correctional Enterprises Document Management Services
FROM: Jo Anna Ripley, Stormwater
PO: 270712
RE: Files Approved for Scanning

General File ID or BMP ID: CC022

PIN: 3911200001B

Subdivision, Tract, Business or Owner

Name (if known):

Ironbound Village

Property Description:

Common Open Space Phase 1

Site Address:

5335 Palmer Lane

(For internal use only)

Box 12

Drawer: 7

Agreements: (in file as of scan date)

N

Book or Doc#:

Page:

Comments

As of 3/11/10, the owner of the parcel is: Cutting Edge Development LLC

1. Maintenance Agreement

Prepared By: Michael Drury
101-C Mounts Bay Road
Williamsburg, VA 23187

PB87/100
We own 20%
040024115 of facility

TAX MAP NO.:3911300001A, 3911300002B, 3911300003, 3911300004, 3911300001B

AMENDMENT OF DECLARATION OF COVENANTS AND RESTRICTIONS

This Amendment, made this 22nd day of September, 2004 by CUTTING EDGE DEVELOPMENT, L.L.C., a Virginia Limited Liability Company, hereinafter "Developer", whose address is 739 Thimble Shoals Boulevard, Newport News, Virginia 23606; GEORGE S. HANKINS, JR. and HOWARD B. HANKINS, hereinafter "Hankins" whose business address is 739 Thimble Shoals Boulevard, Newport News, Virginia 23606; and IRONBOUND VILLAGE ASSOCIATION, a Virginia Corporation, hereinafter "Association", whose address is 739 Thimble Shoals Boulevard, Newport News, Virginia 23606.

WITNESSETH:

WHEREAS, the Developer executed that certain Declaration of Covenants and Restrictions dated February 20, 2002 (the "Declaration") filed and recorded with the Clerk of the Circuit Court for the City of Williamsburg and County of James City on October 23, 2002 as Instrument No. 020024649, and;

WHEREAS, the Developer and Hankins collectively own the parcels of real property located in James City County, Virginia, as more particularly described on "Exhibit A" which is attached hereto and incorporated herein by reference and hereinafter referred to as the "Commercial Properties"; and

WHEREAS, the Commercial Properties are located in the community of Ironbound Village, and will contain office, commercial and related uses; and

WHEREAS, the Developer, Hankins and Association desire to exclude the Commercial Properties from the requirements of the Declaration; and

WHEREAS, the Developer, Hankins and Association desire to amend and supplement the Declaration; and

WHEREAS, the Developer, Hankins and Association have approved certain amendments and supplements to the Declaration in accordance with Article IX, Section 2, of the Declaration;

NOW THEREFORE, the Declaration is hereby amended and supplemented as follows:

1. The Developer, Association and Hankins hereby declare that the Commercial Properties as more particularly described on "Exhibit A" which is attached hereto are hereby excluded from and no longer subject to the rights, privileges, covenants, restrictions, conditions, charges, and liens as set forth in the Declaration. This exclusion shall run with the Commercial Properties and inure to all parties having any right, title, or interest in the Commercial Properties or any portions

10f5

✓ 11997110.27
3632526.89

✓ 11997027.85 / 3632394.6
5335

✓ 5339
11997096.02
362296.12

thereof, and to their successors and assigns.

2. The Developer, Association and Hankins declare that the Commercial Properties as more particularly described on "Exhibit A" which is attached hereto, shall be subject to the covenants, restrictions, conditions, and charges, hereinafter set forth in this Section 2 and shall run with the Commercial Properties and be binding on all parties having any right, title, or interest in the Commercial Properties and be binding on all the properties described in the Declaration, or any portions thereof, and to their successors and assigns.

A. The "Special Parking Area" as designated on that plat entitled "Subdivision Plat, Ironbound Village, Phase II Parcel 2, Being The Property Of Cutting Edge Development, LLC, Berkeley District, James City County, Virginia" dated January 12, 2004, revised June 7, 2004 and June 22, 2004, made by LandMark Design Group, which plat is recorded in the Clerk's Office of the Circuit Court for the City of Williamsburg and County of James City as Instrument No. 040024115, to which reference is hereby made for a more complete description, and such plat hereinafter referred to as the "Subdivision Plat", shall be for the primary use as parking for the owners of Lots 5 - 11 as identified on the Subdivision Plat (the "Lots"). The owners of the Lots and their guests, tenants and invitees shall have a perpetual, non-exclusive easement for vehicular parking over and across the Special Parking Area and a perpetual, non-exclusive easement of ingress and egress for vehicular and pedestrian traffic from the Lots and the Special Parking Area over and across the portion of the Commercial Properties shown and set out on the Subdivision Plat as "24.00' Ingress- Egress Easement to and from Palmer Lane. Furthermore, the Special Parking Area shall be maintained by the owners of the Commercial Properties to commercially reasonable standards at least consistent with the maintenance of the other parking areas on the Commercial Properties and may be utilized by the owners of the Commercial Properties for public overflow parking between the hours of 8:00 a.m. until 5:00 p.m.

B. The owners of the Commercial Properties may voluntarily or shall be obligated upon request of the Association, to participate in capital improvements to the area identified as "Phase I Parcel A, Recreation Open Space, Document No. 020023322" on the Subdivision Plat, and hereinafter referred to as "Recreation Open Space". Such capital improvements shall be agreed upon by the owners of the Commercial Properties and such obligation shall be extinguished upon the total accumulated expenditure of \$5,000.00 by the owners of the Commercial Properties. Any request by the Association shall be binding upon the owners of the Commercial Properties when the request amount is matched by the Association, and such request is subject to any appropriation restrictions legally imposed upon any owner of the Commercial Properties. The owners of the Commercial Properties and their guests have the right of enjoyment of the Recreation Open Space.

C. The owners of the Commercial Properties shall participate in any capital improvement, of the area designated as "Parcel B, Common Open Space to (HOA) 1.85 ± ac., Stormwater Management Facility" on that plat entitled "Subdivision Plat, Ironbound Village, Phase I, James City County, Berkeley District, Commonwealth of Virginia" dated February 28, 2002, Made by LandMark Design Group, which plat is recorded in the Clerk's Office of the Circuit Court for the City of Williamsburg and County of James City in Plat Book 87, at page 100, to which reference

is hereby made for a more complete description, such area shall hereinafter be referred to as "Stormwater Facility". Capital improvement is defined as any reasonable cost of reconstruction, maintenance, repair, or replacement of the Stormwater Facility. The owners of the Commercial Properties, upon agreement on the reasonableness of the cost of the capital improvement shall be obligated to participate by sharing 20% of the capital improvement cost. Such obligation is subject to any appropriation restrictions legally imposed upon any owner of the Commercial Properties.

3. The Developer, Association and Hankins amend and supplement the Declaration by stating that if there are no Class A Members at the time of any action, the rights, duties and obligations of the Class A Members shall reside with the Class B Members, except that Class B Members shall only be entitled to one vote for each Lot owned.

IN WITNESS WHEREOF, the Developer, Hankins, and Association have caused this Amendment to be executed on the day and year first written above.

CUTTING EDGE DEVELOPMENT, L.L.C.


a Virginia Limited Liability Corporation

H. B. Hankins, Inc.

By: 
Managing Member

IRONBOUND VILLAGE ASSOCIATION

a Virginia Corporation

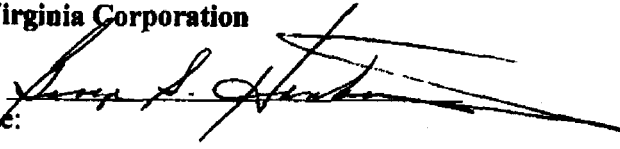By: 
Title:

GEORGE S. HANKINS, JR.

HOWARD B. HANKINS

STATE OF VIRGINIA

CITY/COUNTY OF Williamsburg, to wit:

The foregoing Agreement was acknowledged before me this 22 day of Sept., 2004,

by Howard B. Hankins, Managing Member of Cutting Edge Development
LLC.

Jamie M. Shaper
Notary Public

My commission expires: 2-28-07

STATE OF VIRGINIA

CITY/COUNTY OF Williamsburg, to wit:

The foregoing Agreement was acknowledged before me this 22 day of Sept., 2004,
by George S. Hankins Jr, as _____ of Ironbound Village
Association.

Jamie M. Shaper
Notary Public

My commission expires: 2-28-07

STATE OF VIRGINIA

CITY/COUNTY OF Williamsburg, to wit:

The foregoing Agreement was acknowledged before me this 22 day of Sept., 2004,
by George S. Hankins, Jr.

Jamie M. Shaper
Notary Public

My commission expires: 2-28-07

STATE OF VIRGINIA

CITY/COUNTY OF Williamsburg, to wit:

The foregoing Agreement was acknowledged before me this 22 day of Sept., 2004,
by Howard B. Hankins.

Jamie M. Shaper
Notary Public

My commission expires: 2-28-07

EXHIBIT A

ALL THOSE certain pieces, lots or parcels of land, lying, situate and being in the County of James City, Virginia, shown and set out as : "Phase II, Parcel 1A, 7,116 S.F., 0.1634 acre"; "Phase II, Parcel 1B, 8,867 S.F., 0.2036 acre", "Phase II, Parcel B, 23,664 S.F., 0.5432 acre"; "Phase II, Parcel 3, P.B. 87, Pgs. 40-41"; and "Phase II, Parcel 4, 15,424 S.F., 0.3541 acre" on the plat of subdivision entitled "Ironbound Village Phase II, Being a subdivision of property of Cutting Edge Development, LLC, James City County, Berkeley District, Commonwealth of Virginia" dated 10/15/02, made by LandMark Design Group, which plat is recorded in the Clerk's Office of the Circuit Court for the City of Williamsburg and County of James City in Plat Book 89, at pages 3 - 4, as Instrument No. 020030677, to which reference is hereby made for a more complete description.

The parcels are also known as: 5300 Palmer Lane, JCC Tax Parcel No. 3911300001A; 5304 Palmer Lane, JCC Tax Parcel No. 3911300001B; 5324 Palmer Lane, JCC Tax Parcel No. 3911300002B; 5320 Palmer Lane, JCC Tax Parcel No. 3911300003; and 5340 Palmer Lane, JCC Tax Parcel No. 3911300004.

Prepared by:

Michael Drury
101-C Mounts Bay Road
Williamsburg, VA 23187

2 Large/Small Plot(s) Recorded
herewith as # 04002415

VIRGINIA: CITY OF WILLIAMSBURG & COUNTY OF JAMES CITY
This document was admitted to record on 24 Sept. 04
at 11:50 AM/PM. The taxes imposed by Virginia Code
Section 58.1-801, 58.1-802 & 58.1-814 have been paid.
STATE TAX LOCAL TAX ADDITIONAL TAX
\$ _____ \$ _____ \$ _____
TESTE: BETSY B. WOOLRIDGE, CLERK
BY: Betsy B. Woolridge Clerk

5 of 5

Prepared By: Michael Drury
101-C Mounts Bay Road
Williamsburg, VA 23187

040024115

TAX MAP NO.: 3911300001A, 3911300002B, 3911300003, 3911300004, 3911300001B

AMENDMENT OF DECLARATION OF COVENANTS AND RESTRICTIONS

This Amendment, made this 22nd day of September, 2004 by **CUTTING EDGE DEVELOPMENT, L.L.C.**, a Virginia Limited Liability Company, hereinafter "Developer", whose address is 739 Thimble Shoals Boulevard, Newport News, Virginia 23606 ; **GEORGE S. HANKINS, JR.** and **HOWARD B. HANKINS**, hereinafter "Hankins" whose business address is 739 Thimble Shoals Boulevard, Newport News, Virginia 23606; and **IRONBOUND VILLAGE ASSOCIATION**, a Virginia Corporation, hereinafter "Association", whose address is 739 Thimble Shoals Boulevard, Newport News, Virginia 23606.

WITNESSETH:

WHEREAS, the Developer executed that certain Declaration of Covenants and Restrictions dated February 20, 2002 (the "Declaration") filed and recorded with the Clerk of the Circuit Court for the City of Williamsburg and County of James City on October 23, 2002 as Instrument No. 020024649, and;

WHEREAS, the Developer and Hankins collectively own the parcels of real property located in James City County, Virginia, as more particularly described on "Exhibit A" which is attached hereto and incorporated herein by reference and hereinafter referred to as the "Commercial Properties"; and

WHEREAS, the Commercial Properties are located in the community of Ironbound Village, and will contain office, commercial and related uses; and

WHEREAS, the Developer, Hankins and Association desire to exclude the Commercial Properties from the requirements of the Declaration; and

WHEREAS, the Developer, Hankins and Association desire to amend and supplement the Declaration; and

WHEREAS, the Developer, Hankins and Association have approved certain amendments and supplements to the Declaration in accordance with Article IX, Section 2, of the Declaration;

NOW THEREFORE, the Declaration is hereby amended and supplemented as follows:

1. The Developer, Association and Hankins hereby declare that the Commercial Properties as more particularly described on "Exhibit A" which is attached hereto are hereby excluded from and no longer subject to the rights, privileges, covenants, restrictions, conditions, charges, and liens as set forth in the Declaration. This exclusion shall run with the Commercial Properties and inure to all parties having any right, title, or interest in the Commercial Properties or any portions

thereof, and to their successors and assigns.

2. The Developer, Association and Hankins declare that the Commercial Properties as more particularly described on "Exhibit A" which is attached hereto, shall be subject to the covenants, restrictions, conditions, and charges, hereinafter set forth in this Section 2 and shall run with the Commercial Properties and be binding on all parties having any right, title, or interest in the Commercial Properties and be binding on all the properties described in the Declaration, or any portions thereof, and to their successors and assigns.

A. The "Special Parking Area" as designated on that plat entitled "Subdivision Plat, Ironbound Village, Phase II Parcel 2, Being The Property Of Cutting Edge Development, LLC, Berkeley District, James City County, Virginia" dated January 12, 2004, revised June 7, 2004 and June 22, 2004, made by LandMark Design Group, which plat is recorded in the Clerk's Office of the Circuit Court for the City of Williamsburg and County of James City as Instrument No. 040024115, to which reference is hereby made for a more complete description, and such plat hereinafter referred to as the "Subdivision Plat", shall be for the primary use as parking for the owners of Lots 5 - 11 as identified on the Subdivision Plat (the "Lots"). The owners of the Lots and their guests, tenants and invitees shall have a perpetual, non-exclusive easement for vehicular parking over and across the Special Parking Area and a perpetual, non-exclusive easement of ingress and egress for vehicular and pedestrian traffic from the Lots and the Special Parking Area over and across the portion of the Commercial Properties shown and set out on the Subdivision Plat as "24.00' Ingress- Egress Easement to and from Palmer Lane. Furthermore, the Special Parking Area shall be maintained by the owners of the Commercial Properties to commercially reasonable standards at least consistent with the maintenance of the other parking areas on the Commercial Properties and may be utilized by the owners of the Commercial Properties for public overflow parking between the hours of 8:00 a.m. until 5:00 p.m.

B. The owners of the Commercial Properties may voluntarily or shall be obligated upon request of the Association, to participate in capital improvements to the area identified as "Phase I Parcel A, Recreation Open Space, Document No. 020023322" on the Subdivision Plat, and hereinafter referred to as "Recreation Open Space". Such capital improvements shall be agreed upon by the owners of the Commercial Properties and such obligation shall be extinguished upon the total accumulated expenditure of \$5,000.00 by the owners of the Commercial Properties. Any request by the Association shall be binding upon the owners of the Commercial Properties when the request amount is matched by the Association, and such request is subject to any appropriation restrictions legally imposed upon any owner of the Commercial Properties. The owners of the Commercial Properties and their guests have the right of enjoyment of the Recreation Open Space.

C. The owners of the Commercial Properties shall participate in any capital improvement, of the area designated as "Parcel B, Common Open Space to (HOA) 1.85 ± ac., Stormwater Management Facility" on that plat entitled "Subdivision Plat, Ironbound Village, Phase I, James City County, Berkeley District, Commonwealth of Virginia" dated February 28, 2002, Made by LandMark Design Group, which plat is recorded in the Clerk's Office of the Circuit Court for the City of Williamsburg and County of James City in Plat Book 87, at page 100, to which reference

is hereby made for a more complete description, such area shall hereinafter be referred to as "Stormwater Facility". Capital improvement is defined as any reasonable cost of reconstruction, maintenance, repair, or replacement of the Stormwater Facility. The owners of the Commercial Properties, upon agreement on the reasonableness of the cost of the capital improvement shall be obligated to participate by sharing 20% of the capital improvement cost. Such obligation is subject to any appropriation restrictions legally imposed upon any owner of the Commercial Properties.

3. The Developer, Association and Hankins amend and supplement the Declaration by stating that if there are no Class A Members at the time of any action, the rights, duties and obligations of the Class A Members shall reside with the Class B Members, except that Class B Members shall only be entitled to one vote for each Lot owned.

IN WITNESS WHEREOF, the Developer, Hankins, and Association have caused this Amendment to be executed on the day and year first written above.

CUTTING EDGE DEVELOPMENT, L.L.C.

a Virginia Limited Liability Corporation

H. B. Hankins, Inc.

By: _____

Managing Member

IRONBOUND VILLAGE ASSOCIATION

a Virginia Corporation

By: _____

Title: _____

GEORGE S. HANKINS, JR.

HOWARD B. HANKINS

STATE OF VIRGINIA

CITY/COUNTY OF Williamsburg, to wit:

The foregoing Agreement was acknowledged before me this 22 day of Sept., 2004,

by Howard B. Hankins, Managing Member of Cutting Edge Development
LLC.

Jamie M. Shapiro
Notary Public

My commission expires: 2-28-07
STATE OF VIRGINIA
CITY/COUNTY OF Williamsburg, to wit:

The foregoing Agreement was acknowledged before me this 22 day of Sept., 2004,
by George S. Hankins Jr, as _____ of Ironbound Village
Association.

Jamie M. Shapiro
Notary Public

My commission expires: 2-28-07

STATE OF VIRGINIA
CITY/COUNTY OF Williamsburg, to wit:

The foregoing Agreement was acknowledged before me this 22 day of Sept., 2004,
by George S. Hankins, Jr.

Jamie M. Shapiro
Notary Public

My commission expires: 2-28-07

STATE OF VIRGINIA
CITY/COUNTY OF Williamsburg, to wit:

The foregoing Agreement was acknowledged before me this 22 day of Sept., 2004,
by Howard B. Hankins.

Jamie M. Shapiro
Notary Public

My commission expires: 2-28-07

EXHIBIT A

ALL THOSE certain pieces, lots or parcels of land, lying, situate and being in the County of James City, Virginia, shown and set out as : "Phase II, Parcel 1A, 7,116 S.F., 0.1634 acre"; "Phase II, Parcel 1B, 8,867 S.F., 0.2036 acre", "Phase II, Parcel B, 23,664 S.F., 0.5432 acre"; "Phase II, Parcel 3, P.B. 87, Pgs. 40-41"; and "Phase II, Parcel 4, 15,424 S.F., 0.3541 acre" on the plat of subdivision entitled "Ironbound Village Phase II, Being a subdivision of property of Cutting Edge Development, LLC, James City County, Berkeley District, Commonwealth of Virginia" dated 10/15/02, made by LandMark Design Group, which plat is recorded in the Clerk's Office of the Circuit Court for the City of Williamsburg and County of James City in Plat Book 89, at pages 3 - 4, as Instrument No. 020030677, to which reference is hereby made for a more complete description.

The parcels are also known as: 5300 Palmer Lane, JCC Tax Parcel No. 3911300001A; 5304 Palmer Lane, JCC Tax Parcel No. 3911300001B; 5324 Palmer Lane, JCC Tax Parcel No. 3911300002B; 5320 Palmer Lane, JCC Tax Parcel No. 3911300003; and 5340 Palmer Lane, JCC Tax Parcel No. 3911300004.

Prepared by:

Michael Drury
101-C Mounts Bay Road
Williamsburg, VA 23187

2 Large/Small Plat(s) Recorded
herewith as # 04002415

VIRGINIA: CITY OF WILLIAMSBURG & COUNTY OF JAMES CITY
This document was admitted to record on 24 Sept. 04
at 11:50 AM/PM. The taxes imposed by Virginia Code
Section 58.1-801, 58.1-802 & 58.1-814 have been paid.
STATE TAX LOCAL TAX ADDITIONAL TAX
\$ \$ \$
TESTE: BETSY B. WOOLRIDGE, CLERK
BY: Betsy B. Woolridge Clerk

5 of 5

CERTIFICATE OF SOURCE OF TITLE:

THE PROPERTY SHOWN ON THIS PLAT WAS CONVEYED BY SHADE J. AND CARLETHA R. PALMER TO CUTTING EDGE DEVELOPMENT, LLC., BY DEED DATED 1-18-01 AND RECORDED IN THE OFFICE OF THE CLERK OF DISTRICT COURT OF THE COUNTY OF JAMES CITY, AS INSTRUMENT NO. 020030677.

OWNER'S CERTIFICATE:

THE SUBDIVISION OF LAND SHOWN ON THIS PLAT IS WITH THE FREE CONSENT AND IN ACCORDANCE WITH THE DESIRE OF THE UNDERSIGNED OWNERS, PROPRIETORS, AND/OR TRUSTEES.

OWNER: CUTTING EDGE DEVELOPMENT, LLC.

BY: Howard B. Hawkins 4/2/04
SIGNATURE DATE

Howard B. Hawkins, Pres.
NAME PRINTED TITLE

CERTIFICATE OF NOTARIZATION:

STATE OF Virginia


CITY/COUNTY OF James City
I, Chris S. Cole A NOTARY
PUBLIC IN AND FOR THE CITY/COUNTY AND STATE AFORESAID, DO
HEREBY CERTIFY THAT THE PERSONS WHOSE NAMES ARE SIGNED
TO THE FOREGOING WRITING HAVE ACKNOWLEDGED THE SAME BEFORE ME
IN THE CITY/COUNTY AFORESAID, GIVEN UNDER MY NAME THIS 2nd
DAY OF April, 2004. MY COMMISSION EXPIRES

Chris S. Cole
(SIGNATURE)

SURVEYOR'S CERTIFICATE:

I HEREBY CERTIFY THAT TO THE BEST OF MY KNOWLEDGE OR BELIEF, THIS PLAT COMPLIES WITH ALL OF THE REQUIREMENTS OF THE BOARD OF SUPERVISORS AND ORDINANCES OF THE COUNTY OF JAMES CITY, VIRGINIA, REGARDING THE PLATTING OF SUBDIVISIONS WITHIN THE COUNTY.

3-3-04 Peter Farrell
DATE PETER FARRELL, LS NO. 002036

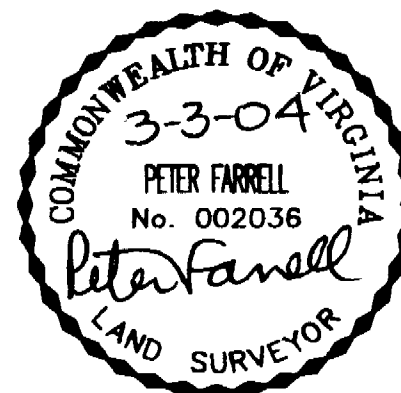

CERTIFICATE OF APPROVAL:

THIS SUBDIVISION IS APPROVED BY THE UNDERSIGNED IN ACCORDANCE WITH EXISTING SUBDIVISION REGULATIONS AND MAY BE ADMITTED TO RECORD.

DATE NOT APPLICABLE
VIRGINIA DEPARTMENT OF TRANSPORTATION

CERTIFICATE OF APPROVAL:

THIS SUBDIVISION IS APPROVED BY THE UNDERSIGNED IN ACCORDANCE WITH EXISTING SUBDIVISION REGULATIONS AND MAY BE ADMITTED TO RECORD.

9/2/04 Chris S. Cole
DATE SUBDIVISION AGENT OF JAMES CITY COUNTY

STATE OF VIRGINIA, COUNTY OF JAMES CITY

IN THE CLERK'S OFFICE OF THE CIRCUIT COURT FOR THE COUNTY OF JAMES CITY
THIS 24th DAY OF September 2004,
2004, THIS PLAT WAS PRESENTED AND ADMITTED TO THE RECORD
AS THE LAW DIRECTS.

BETSY B. WOOLRIDGE, CLERK
TESTEE: Chris S. Cole CLERK

DOCUMENT NO. 040024115

NOTES:


1. THIS PROPERTY IS JAMES CITY COUNTY TAX PARCEL 3911300002 AND ZONED (MU) MIXED USE DISTRICT.
2. THE PROPERTY WAS REZONED BY THE BOARD OF SUPERVISORS CASE NO.(Z-3-00) WITH PROFFERS AND THE SUBDIVISION PLAN IS IN ACCORDANCE WITH THE IRONBOUND VILLAGE MASTER PLAN, DATED 9/13/2000.

3. TOTAL NUMBER OF LOTS = 7

PARCEL 2 AREA TABULATION:

LOT 5	0.0415 AC.
LOT 6	0.0320 AC.
LOT 7	0.0533 AC.
LOT 8	0.0582 AC.
LOT 9	0.0396 AC.
LOT 10	0.0415 AC.
LOT 11	0.0646 AC.
COMMON OPEN SPACE	0.3261 AC.
TOTAL	0.6568 AC.

4. ALL LOTS SERVED BY PUBLIC WATER AND SEWER.
5. ANY OLD WELLS THAT MAY BE ON THE SITE THAT WILL NOT BE USED WILL BE PROPERLY ABANDONED IN ACCORDANCE WITH STATE PRIVATE WELL REGULATIONS.
6. ALL DRAINAGE EASEMENTS DESIGNATED ON THE PLAT ARE HEREBY DEDICATED TO THE IRONBOUND VILLAGE ASSOCIATION.
7. THE PROPERTY LIES WITHIN A RESOURCE MANAGEMENT AREA AND IS SUBJECT TO JAMES CITY COUNTY'S CHESAPEAKE BAY PRESERVATION ORDINANCE.
8. IN ACCORDANCE WITH SECTION 19-33 OF THE JAMES CITY COUNTY SUBDIVISION ORDINANCE, ALL UTILITIES SHALL BE PLACED UNDERGROUND.
9. THE COORDINATES SHOWN ON THIS PLAT ARE BASED ON JAMES CITY COUNTY CONTROL MONUMENTS NO. 325 & 325 AZ. DATUM = NAD 83.
10. THE PROPERTY SHOWN ON THIS PLAT APPEARS TO LIE WITHIN FLOOD ZONE X ACCORDING TO FEDERAL EMERGENCY MANAGEMENT AGENCY-NATIONAL FLOOD INSURANCE PROGRAM COMMUNITY PANEL NO.510 0035B DATED 2-06-91.
11. THIS PLAT WAS PREPARED WITHOUT THE BENEFIT OF A CURRENT TITLE REPORT AND THEREFORE MAY NOT DEPICT ALL TITLE MATTERS AFFECTING THE PROPERTY SHOWN HEREON.
12. PROPERTY CORNER MONUMENTATION WILL BE SET IN ACCORDANCE WITH SECTIONS 19-34 THRU 19-36 OF THE JAMES CITY COUNTY SUBDIVISION ORDINANCE.
13. STREET IDENTIFICATION SIGNS SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 19-55 OF THE JAMES CITY COUNTY SUBDIVISION ORDINANCE.
14. UNLESS OTHERWISE NOTED, ALL DRAINAGE EASEMENTS DESIGNATED ON THIS PLAT SHALL REMAIN PRIVATE.
15. NATURAL OPEN SPACE EASEMENTS SHALL REMAIN IN A NATURAL UNDISTURBED STATE EXCEPT FOR THOSE ACTIVITIES REFERENCED ON THE DEED OF EASEMENT.
16. EASEMENTS DENOTED AS "JCSA UTILITY EASEMENTS ARE FOR THE EXCLUSIVE USE OF THE JAMES CITY SERVICE AUTHORITY AND THE PROPERTY OWNER. OTHER UTILITY SERVICE PROVIDERS DESIRING TO USE THESE EASEMENTS WITH THE EXCEPTION OF PERPENDICULAR UTILITY CROSSINGS MUST OBTAIN AUTHORIZATION FOR ACCESS AND USE FROM JCSA AND THE PROPERTY OWNER. ADDITIONALLY, JCSA SHALL NOT BE HELD RESPONSIBLE FOR ANY DAMAGE TO IMPROVEMENTS WITHIN THIS EASEMENT, FROM ANY CAUSE.
17. REFERENCES USED IN THE PREPARATION OF THIS PLAT:
DOCUMENT NO. 020023322
DOCUMENT NO. 020019528
DOCUMENT NO. 020030677
INSTRUMENT NO. 010000841

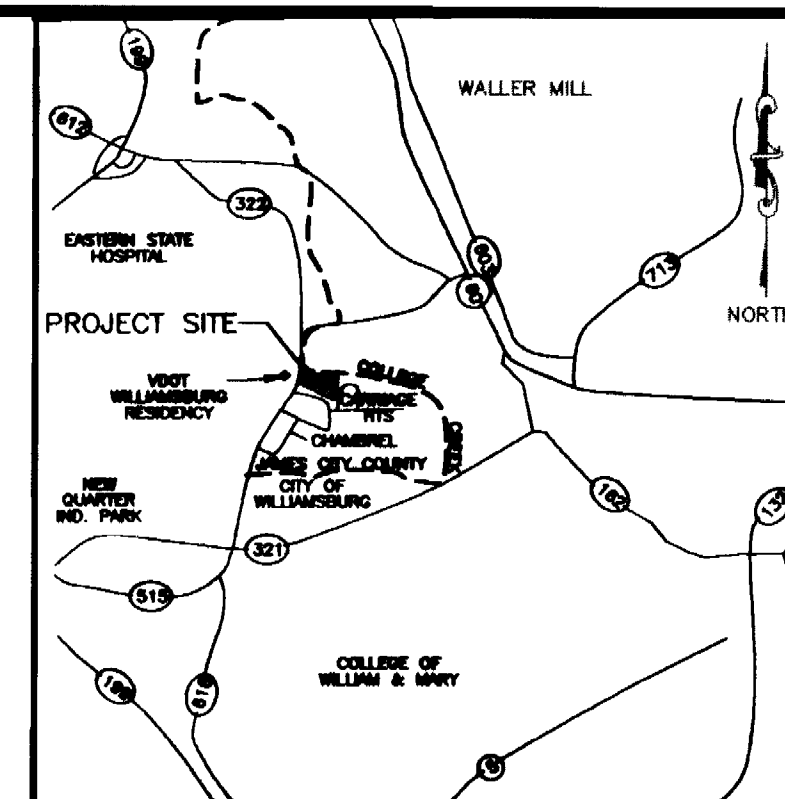

COPYRIGHT ADC THE MAP PEOPLE PERMITTED USE NO. 20201150
VICINITY MAP 1"=2000'

SUBDIVISION PLAT
IRONBOUND VILLAGE
PHASE II PARCEL 2
BEING THE PROPERTY OF
CUTTING EDGE DEVELOPMENT, LLC.

BERKELEY DISTRICT, JAMES CITY COUNTY, VIRGINIA

DATE: JANUARY 12, 2004

REVISED: MARCH 3, 2004

SHEET 1 OF 2

LANDMARK
DESIGN GROUP
Engineers • Planners • Surveyors
Landscape Architects • Environmental Consultants

4029 Ironbound Road
Suite 100
Williamsburg, VA 23188
Tel. (757) 253-2975
Fax (757) 229-0049
Email: lmdg@landmarkdg.com

5544 Greenwich Road
Suite 200
Virginia Beach, VA 23462
Tel. (757) 473-2000
Fax (757) 497-7933
Email: lmdg@landmarkdg.com

CC022 IRONBOUND VILLAGE IRONBOUND ROAD - 17 01 220

3. As-Built Plan

6. Design Calculations

TEMPORARY SEDIMENT BASIN DESIGN DATA SHEET

(with or without an emergency spillway)

Project IRONBOUND VILLAGE

Basin # 1 Location NE Corner

Total area draining to basin: 6.9 acres.

Basin Volume Design

Wet Storage:

1. Minimum required volume = 67 cu. yds. x Total Drainage Area (acres).

$$67 \text{ cu. yds.} \times \underline{6.9} \text{ acres} = \underline{462} \text{ cu. yds.}$$

2. Available basin volume = 636 cu. yds. at elevation 75. (From storage - elevation curve)

3. Excavate 636 cu. yds. to obtain required volume*.

* Elevation corresponding to required volume = invert of the dewatering orifice.

4. Available volume before cleanout required.

$$33 \text{ cu. yds.} \times \underline{6.9} \text{ acres} = \underline{228} \text{ cu. yds.}$$

5. Elevation corresponding to cleanout level = 73.

(From Storage - Elevation Curve)

6. Distance from invert of the dewatering orifice to cleanout level = 2.0 ft. (Min. = 1.0 ft.)

Dry Storage:

7. Minimum required volume = 67 cu. yds. x Total Drainage Area (acres).

$$67 \text{ cu. yds.} \times \underline{6.9} \text{ acres} = \underline{462} \text{ cu. yds.}$$

8. Total available basin volume at crest of riser* = 1,221 cu. yds. at elevation 77.0. (From Storage - Elevation Curve)

* Minimum = 134 cu. yds./acre of total drainage area.

9. Diameter of dewatering orifice = 4 in.

10. Diameter of flexible tubing = 6 in. (diameter of dewatering orifice plus 2 inches).

$$Q = \frac{(1221)(27)}{21600} = 1.53 \text{ c}$$

$$A = \frac{1.53}{2(64.32)(\frac{1}{2})} = 1.1$$

$$d = 0.34' = 4''$$

Preliminary Design Elevations

11. Crest of Riser = 77.7

Top of Dam = 80.0

Design High Water = 77

Upstream Toe of Dam = 70

Basin Shape

12. $\frac{\text{Length of Flow}}{\text{Effective Width}} = \frac{L}{We} = \frac{70}{25} = 2.8$

If > 2 , baffles are not required ✓

If < 2 , baffles are required _____

Runoff

13. $Q_2 = \underline{13.2}$ cfs (From Chapter 5) $(1.0)(6.9)(5.45)(0.35)$

14. $Q_{25} = \underline{22.0}$ cfs (From Chapter 5) $(1.1)(6.9)(8.27)(.35)$

C=0.35
is not
OK.

Principal Spillway Design

15. With emergency spillway, required spillway capacity $Q_p = Q_2 = \underline{13.2}$ cfs. (riser and barrel)

Without emergency spillway, required spillway capacity $Q_p = Q_{25} = \underline{N/A}$ cfs. (riser and barrel)

16. With emergency spillway:

Assumed available head (h) = 1.5 ft. (Using Q_2)

h = Crest of Emergency Spillway Elevation - Crest of Riser Elevation

Without emergency spillway:

Assumed available head (h) = N/A ft. (Using Q_{25})

h = Design High Water Elevation - Crest of Riser Elevation

17. Riser diameter (D_r) = 36 in. Actual head (h) = 1.5 ft.

(From Plate 3.14-8.)

Note: Avoid orifice flow conditions.

18. Barrel length (l) = 100 ft. ✓

Head (H) on barrel through embankment = 9 ft.

(From Plate 3.14-7).

19. Barrel diameter = 18 in. ✓

(From Plate 3.14-B [concrete pipe] or Plate 3.14-A [corrugated pipe]).

20. Trash rack and anti-vortex device

Diameter = 60 inches. ✓

Height = 17 inches.

(From Table 3.14-D).

Emergency Spillway Design

21. Required spillway capacity $Q_e = Q_{25} - Q_p =$ 8.8 cfs.

22. Bottom width (b) = 8.0 ft.; the slope of the exit channel (s) = .08 ft./foot; and the minimum length of the exit channel (x) = 50 ft.

(From Table 3.14-C).


Anti-Seep Collar Design

23. Depth of water at principal spillway crest (Y) = 7 ft.
Slope of upstream face of embankment (Z) = 6 :1.
Slope of principal spillway barrel (S_b) = 1.0 %
Length of barrel in saturated zone (L_s) = 75 ft.
24. Number of collars required = 2 dimensions = 5.25
(from Plate 3.14-12).


Final Design Elevations

25. Top of Dam = 80.0
Design High Water = 77
Emergency Spillway Crest = 78.5
Principal Spillway Crest = 77.0
Dewatering Orifice Invert = 75.0
Cleanout Elevation = 73.0
Elevation of Upstream Toe of Dam
or Excavated Bottom of "Wet Storage
Area" (if excavation was performed) = 70.0

SEDIMENT BASIN SCHEMATIC ELEVATIONS

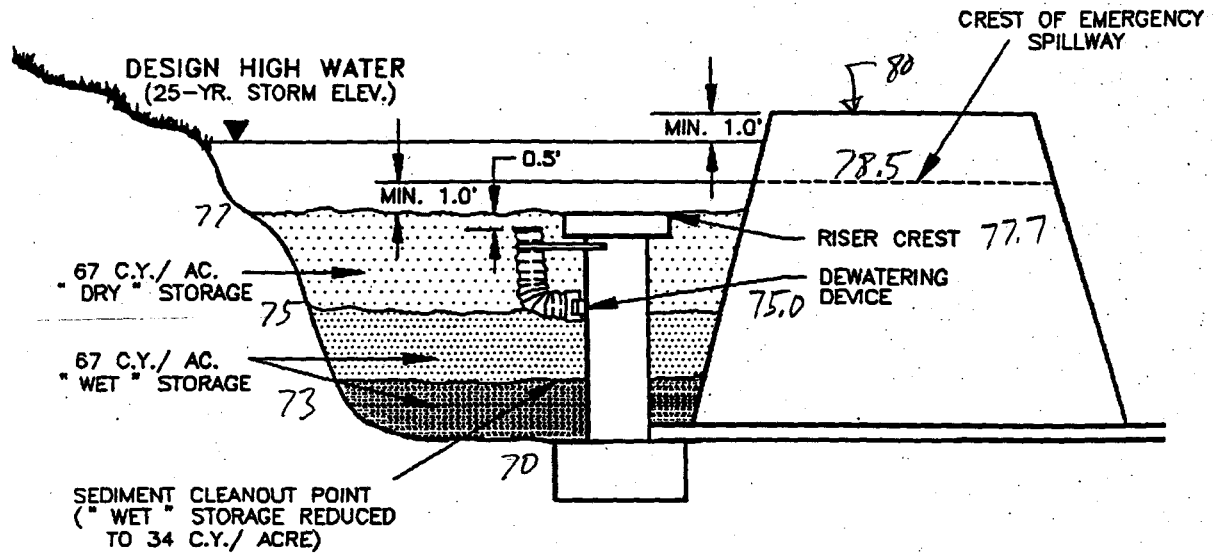


DESIGN ELEVATIONS WITH EMERGENCY SPILLWAY

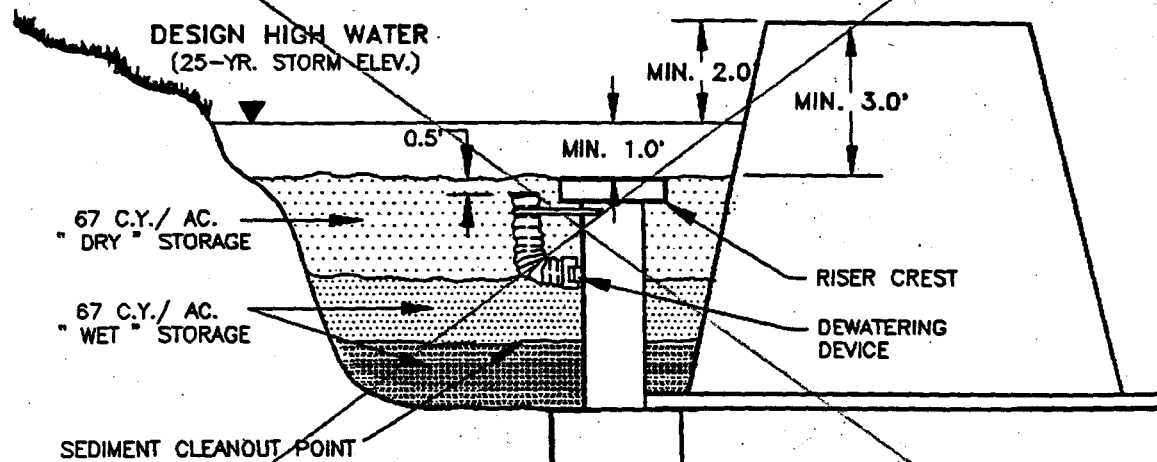

DESIGN ELEVATIONS WITHOUT EMERGENCY SPILLWAY (RISER PASSES 25-YR. EVENT)


Source: Va. DSWC

Plate 3.14-2

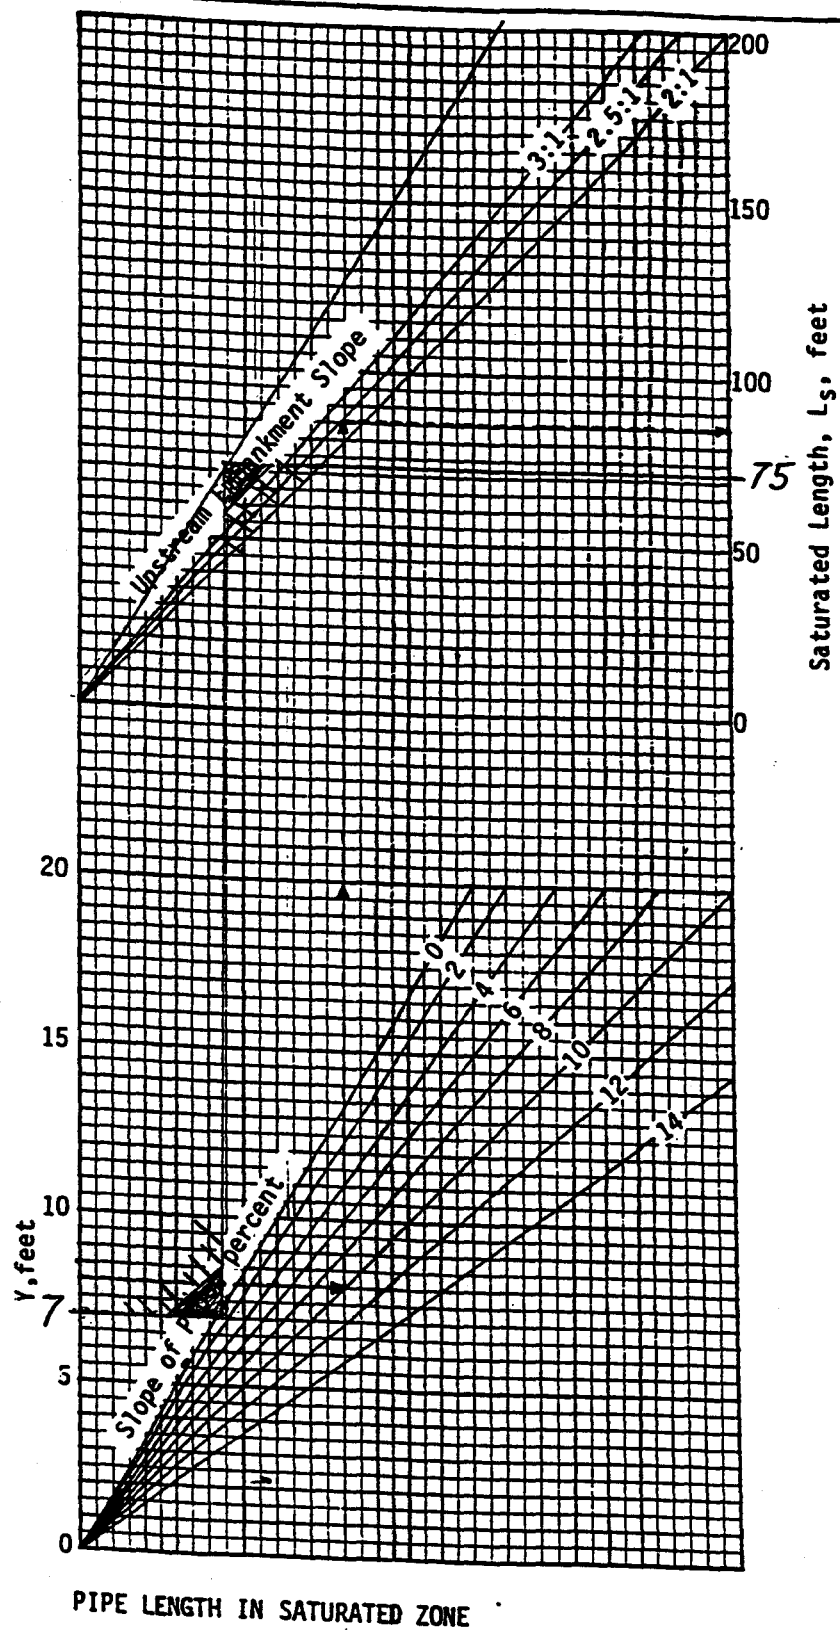

Source: USDA-SCS

Plate 3.14-11

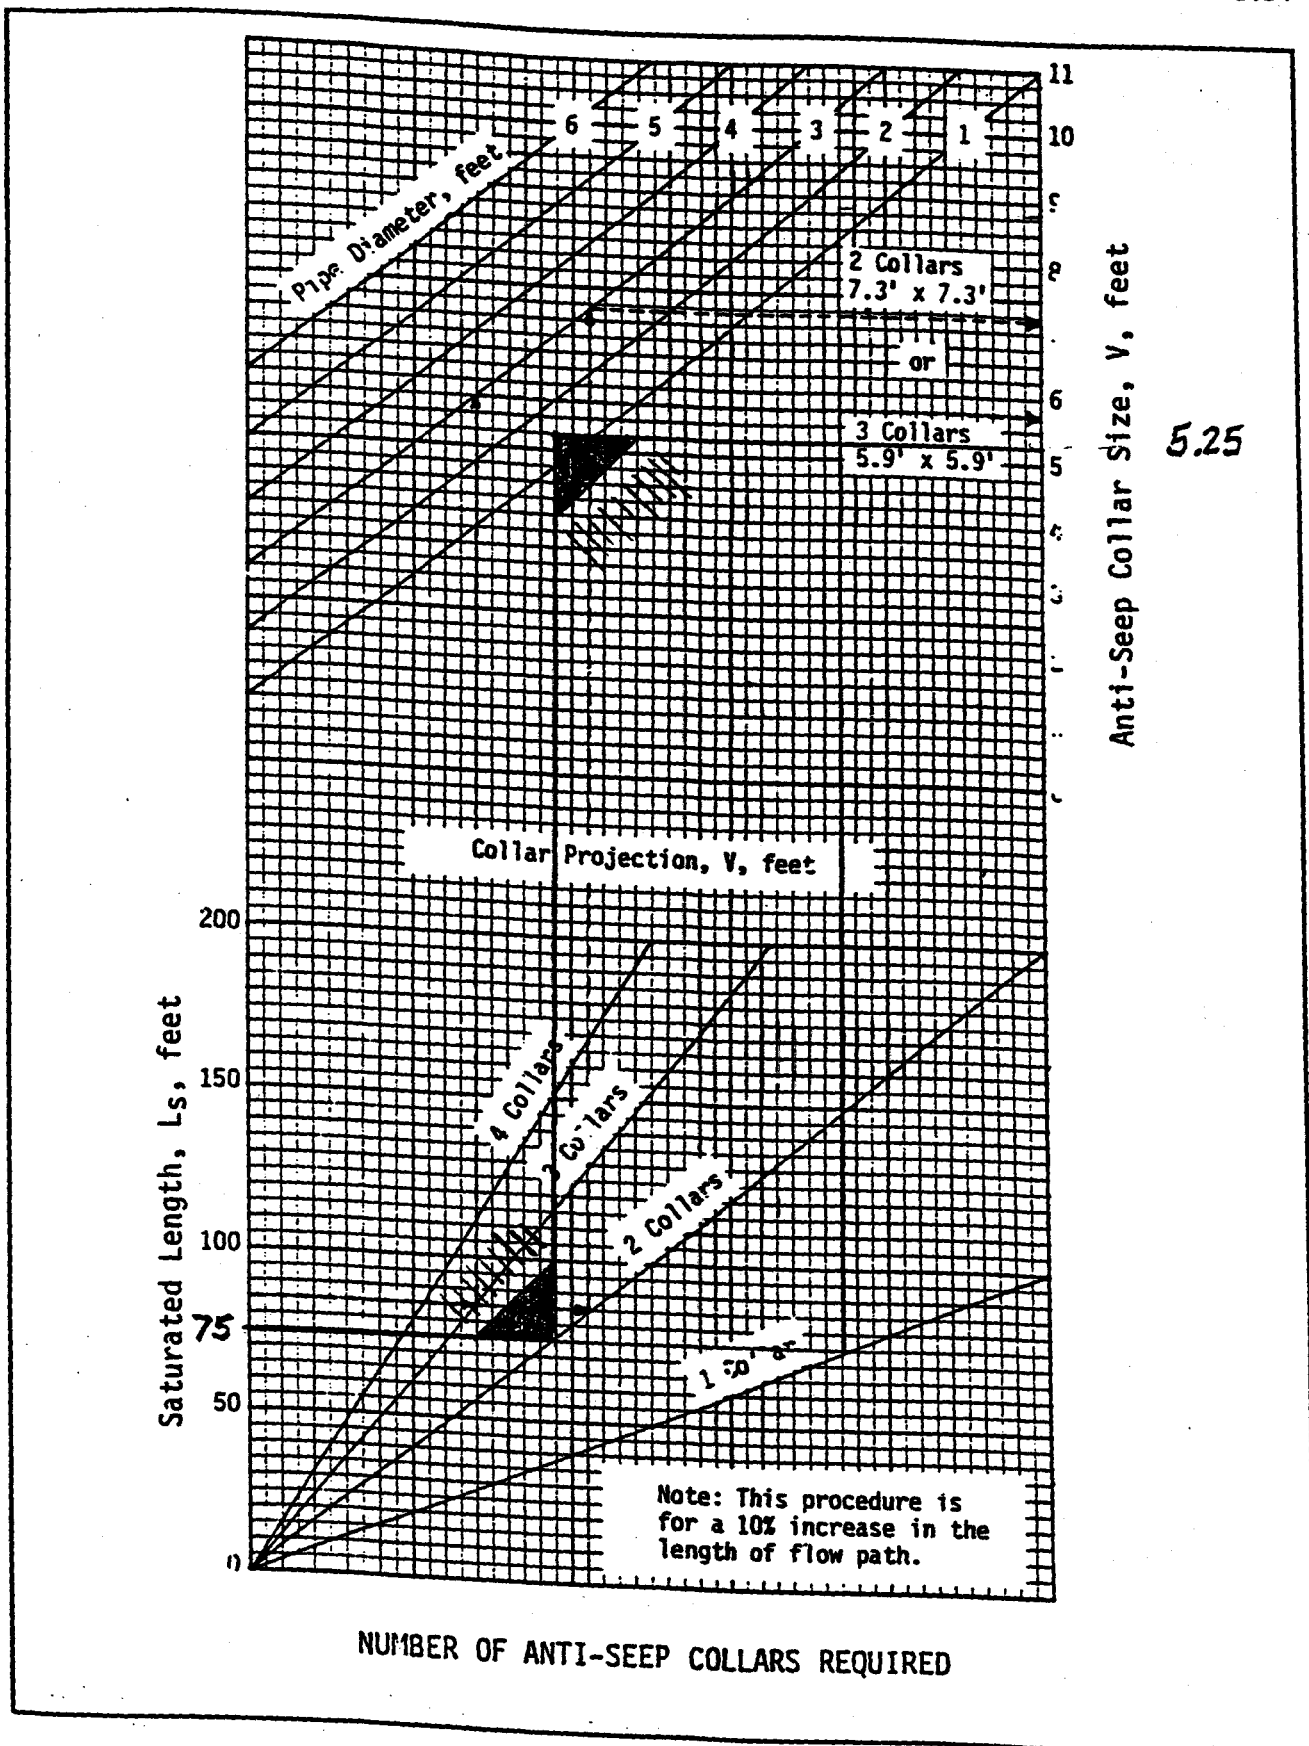

Source: USDA-SCS

Plate 3.14-12

Impervious Area and Required Volume Calculations
for
Ironbound Village
AES# 8914-1

Impervious items	Totals		Acres
Houses	23 Ea	1350 SF	0.71
T.H.	7 Ea	912 SF	0.15
Office	4 Ea	2400 SF	0.22
Driveways	23 Ea	312 SF	0.16
Roads:			
Public	870 LF	31 Width	0.62
Private	530 LF	60 Width	0.73
Pond Access Rd	340 LF	12 Width	0.09
Wet Pond Surface @ N.P.	105 LF	65 Width	0.16
Sidewalks:			
w/in R/W	850 LF	8 Width	0.16
Offsite Road	500 LF	12 Width	0.14
Total Impervious Area (TIA)			3.14

Area to Pond = 6.8 Acres

Percent Impervious = 46%

Pond's Required Wet Volume = $(1'')(ft/12'')(TIA\text{ Ac})(43560\text{ sf/Ac}) = 11,390\text{ c.f.}$

Pond's Required Dry Volume = $(1'')(ft/12'')(TIA\text{ Ac})(43560\text{ sf/Ac}) = 11,390\text{ c.f.}$

Sediment Forebay's Required Volume = $(0.1'')(ft/12'')(TIA\text{ Ac})(43560\text{ sf/Ac}) = 1,139\text{ c.f.}$

CC022

WORKSHEET FOR BMP POINT SYSTEM

TOTAL SITE AREA = 7.75 AC.

A. STRUCTURAL BMP POINT ALLOCATION

<u>BMP</u>	<u>BMP Points</u>	<u>Fraction of Site Served</u>	<u>Weighted BMP Points</u>
Wet Pond (E.D.)	10 ✓	$x (6.30 + 0.59) \div 7.75 =$	<u>8.89</u>

TOTAL WEIGHTED STRUCTURAL BMP POINTS: 8.89

B. NATURAL OPEN SPACE CREDIT

<u>Adjacent To Wetland</u>	<u>Natural Open Space Credit</u>	<u>Fraction of Site</u>	<u>Points for Natural Open Space</u>
No	10	$x 0.94 \div 7.75$	$= 1.21$

C. TOTAL WEIGHTED POINTS

<u>Structural BMP Points</u>		<u>Natural Open Space Points</u>		<u>Total</u>
8.89	+	1.21	=	10.10 ✓

NOTES:

- 1) Natural open space has been placed in a conservation easement.

S:\OBS\8914\01-IBV\Design\Pond\bmp-pnts.doc

8.89
 1.21
 10.10
 7.75 { 500.0
 415.0
 5.0

BMP VOLUME CALCULATIONS
for
STONEHOUSE Ph 1, Bent Tree (Sect. V-B) Ph3
AES Project No.: 8878-00

PROPOSED POND VOLUME

Eleva	Depth	Area (sq. ft.)	Incremental Volume (cu. ft.)	Sum Volume (cu. ft.)	Sum Volume (cu. yd.)	Volume Above NPE
70.0	0.0	1,094	0	0	0	
72.0	2.0	2,396	3,490	3,490	129	
73.7	1.7	4,303	5,694	9,184	340	
74.0	0.3	5,971	1,541	10,725	397	
75.0	1.0	6,918	6,445	17,170	636	0
76.0	1.0	7,865	7,392	24,561	910	7,391
77.0	1.0	8,926	8,396	32,957	1,221	15,787
78.0	1.0	9,986	9,456	42,413	1,571	25,243
78.5	0.5	10,684	5,168	47,580	1,762	30,410
80.0	1.5	12,776	17,595	65,175	2,414	48,005

RELEASE RATE REQUIRED TO DETAINED VOLUME FOR 24 HOURS

Required BMP Volume (based upon Impervious Area) = 11,390 cubic feet

Volume Provided (based upon above table) = 15,787 cubic feet

Elevation of water surface associated with provided volume = 77.0

Elevation of Low Flow Orifice = 75.0

Average Head, in feet = 1.0


Average Release Rate Calculation $\frac{15,787 \text{ cubic feet}}{(24 \text{ hours} \times 60 \text{ minutes/hour} \times 60 \text{ seconds/minute})} = 0.2 \text{ cfs}$

LOW FLOW ORIFICE DIAMETER REQUIRED TO MAINTAIN AVERAGE RELEASE RATE

$$\text{Diameter of Low Flow Orifice} = 2 * (Q / ((64.32 * (h / 2))^{(1/2)} * 0.6 * 3.14)))^{(1/2)}$$

where, Q equals average release rate (cfs), h equals average head (feet)

Diameter of Low Flow Orifice = 0.30 feet, or 4 inches

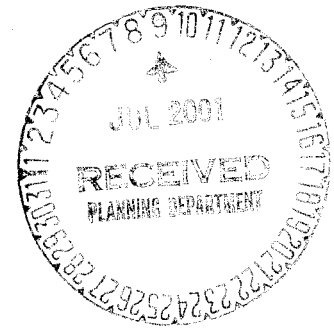

IRONBOUND VILLAGE


FOR
CUTTING EDGE DEVELOPMENT, LLC.

AES PROJECT NUMBER: 8914-01

BMP & SWM POND, E&S CONTROL, AND DRAINAGE CALCULATIONS


*S-36-01 IRONBOUND VILLAGE
PH I SUBDIV PLAN*

*SP-29-01 IRONBOUND VILLAGE
PHASE II SITE PLAN*



AES CONSULTING ENGINEERS
5248 OLDE TOWNE ROAD, SUITE #1
WILLIAMSBURG, VIRGINIA 23188

JULY 3, 2001

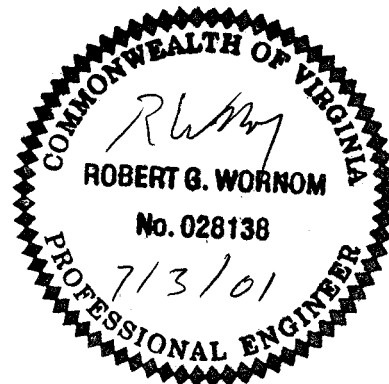

STREAM CHANNEL PROTECTION CALCULATIONS
for
Ironbound Village
AES Project No.: 8914-1

PROPOSED POND VOLUME

Eleva	Depth	Area (sq. ft.)	Incremental Volume (cu. ft.)	Sum Volume (cu. ft.)	Sum Volume (cu. yd.)	Volume Above NPE
70.0	0.0	1,094	0	0	0	
72.0	2.0	2,396	3,490	3,490	129	
73.7	1.7	4,303	5,694	9,184	340	
74.0	0.3	5,971	1,541	10,725	397	
75.0	1.0	6,918	6,445	17,170	636	0
76.0	1.0	7,865	7,392	24,561	910	7,391
77.0	1.0	8,926	8,395	32,957	1,221	15,787
78.0	1.0	9,986	9,456	42,412	1,571	25,242
78.5	0.5	10,684	5,168	47,580	1,762	30,410
80.0	1.5	12,776	17,595	65,175	2,414	48,005

RELEASE RATE REQUIRED TO DETAINED VOLUME FOR 24 HOURS

Required Volume based upon 1-Year, 24-Hour Storm Hydrograph =

14,939 cubic feet

Volume provided based upon above table =

15,787 cubic feet

Elevation of water surface associated with provided volume =

77.0

(75.87 per routing)

Elevation of Low Flow Orifice =

75.0

Average Head, in feet =

1.0

Average Release Rate Calculation

$$\frac{15,787 \text{ cubic feet}}{(24 \text{ hours} \times 60 \text{ minutes/hour} \times 60 \text{ seconds/minute})} =$$

0.2 cfs

LOW FLOW ORIFICE DIAMETER REQUIRED TO MAINTAIN AVERAGE RELEASE RATE

$$\text{Diameter of Low Flow Orifice} = 2 * (Q / ((64.32 * (h / 2))^{(1/2)} * 0.6 * 3.14))^{(1/2)}$$

where, Q equals average release rate (cfs), h equals average head (feet)

Diameter of Low Flow Orifice =

0.30

feet, or

4 inches

$A = 6.8 \text{ ac}$
 $C = 0.55 \approx CN = 79$
 $T_c = 5 \text{ min.} - 0.083 \text{ hr.}$
 $\text{Runoff} = 1.04 \text{ in}$
 $\text{Peak} = 10.8 \text{ cfs}$
 $V_{or} = \frac{A \times \text{Runoff}}{12 \text{ in}} + \frac{4380.9 \text{ ac} \times 6.8 \text{ ac}}{12 \text{ in}} = 25,671 \text{ cf}$

TEMPORARY SEDIMENT BASIN DESIGN DATA SHEET

(with or without an emergency spillway)

Project IRON BOUND VILLAGE

Basin # _____ Location _____

Total area draining to basin: 6.9 acres.

Basin Volume Design

Wet Storage:

1. Minimum required volume = 67 cu. yds. x Total Drainage Area (acres).

$$67 \text{ cu. yds.} \times \underline{6.9} \text{ acres} = \underline{462} \text{ cu. yds.}$$

2. Available basin volume = 636 cu. yds. at elevation 75. (From storage - elevation curve)

3. Excavate 636 cu. yds. to obtain required volume*.

* Elevation corresponding to required volume = invert of the dewatering orifice.

4. Available volume before cleanout required.

$$33 \text{ cu. yds.} \times \underline{6.9} \text{ acres} = \underline{228} \text{ cu. yds.}$$

5. Elevation corresponding to cleanout level = 73.

(From Storage - Elevation Curve)

6. Distance from invert of the dewatering orifice to cleanout level = 2.0 ft. (Min. = 1.0 ft.)

Dry Storage:

7. Minimum required volume = 67 cu. yds. x Total Drainage Area (acres).

$$67 \text{ cu. yds.} \times \underline{6.9} \text{ acres} = \underline{462} \text{ cu. yds.}$$

8. Total available basin volume at crest of riser* = 1,221 cu. yds. at elevation 77.0. (From Storage - Elevation Curve)

* Minimum = 134 cu. yds./acre of total drainage area.

9. Diameter of dewatering orifice = 4 in. $Q = \frac{(1221)(2.7)}{21600} = 1.53 \text{ cfs}$
10. Diameter of flexible tubing = 6 in. (diameter of dewatering orifice plus 2 inches). $A = 1.53 / \sqrt{64.32} (2.7) (1.6) = .09$
 $d = 0.34' = 4''$

Preliminary Design Elevations

11. Crest of Riser = 77.0
- Top of Dam = 80.0
- Design High Water = 77.5
- Upstream Toe of Dam = 70

Basin Shape

12. $\frac{\text{Length of Flow}}{\text{Effective Width}} = \frac{L}{We} = \frac{70}{25} = 2.8$
- If > 2, baffles are not required ✓
- If < 2, baffles are required _____

Runoff

13. $Q_2 = \underline{12.6}$ cfs (From Chapter 5) $Q = C_f \times A \times I \times C$
 $(1.0)(6.9)(4.56)(0.40)$
14. $Q_{25} = \underline{20.3}$ cfs (From Chapter 5) $(1.1)(6.9)(6.67)(.40)$

Principal Spillway Design

15. With emergency spillway, required spillway capacity $Q_p = Q_2 = \underline{12.6}$ cfs. (riser and barrel)
- Without emergency spillway, required spillway capacity $Q_p = Q_{25} = \underline{N/A}$ cfs. (riser and barrel)

16. With emergency spillway:

$$\text{Assumed available head (h)} = \underline{1.5} \text{ ft. (Using } Q_2\text{)}$$

$$h = \text{Crest of Emergency Spillway Elevation} - \text{Crest of Riser Elevation}$$

Without emergency spillway:

$$\text{Assumed available head (h)} = \underline{N/A} \text{ ft. (Using } Q_{25}\text{)}$$

$$h = \text{Design High Water Elevation} - \text{Crest of Riser Elevation}$$

17. Riser diameter (D_r) = 36" in. Actual head (h) = 0.5 ft.

(From Plate 3.14-8.)

Note: Avoid orifice flow conditions.

18. Barrel length (l) = 100 ft.

$$\text{Head (H) on barrel through embankment} = \underline{9.9} \text{ ft.}$$

(From Plate 3.14-7).

19. Barrel diameter = 15 in.

(From Plate 3.14-B [concrete pipe] or Plate 3.14-A [corrugated pipe]).

20. Trash rack and anti-vortex device

(inside) Diameter = 60 inches. 54 RQD

Height = 24 inches. 17 RQD

(From Table 3.14-D).

Emergency Spillway Design

21. Required spillway capacity $Q_e = Q_{25} - Q_p = \underline{7.7}$ cfs.

22. Bottom width (b) = 8.0 ft.; the slope of the exit channel (s) = .08 ft./foot; and the minimum length of the exit channel (x) = 36 ft.

(From Table 3.14-C).


Anti-Seep Collar Design

23. Depth of water at principal spillway crest (Y) = 7 ft.
Slope of upstream face of embankment (Z) = 6 :1.
Slope of principal spillway barrel (S_b) = 1.0 %
Length of barrel in saturated zone (L_s) = 75 ft.
24. Number of collars required = 2 dimensions = 5.25
(from Plate 3.14-12).

Final Design Elevations

25. Top of Dam = 80.0
Design High Water = 77.5
Emergency Spillway Crest = 78.5
Principal Spillway Crest = 77.0
Dewatering Orifice Invert = 75.0
Cleanout Elevation = 73.0
Elevation of Upstream Toe of Dam
or Excavated Bottom of "Wet Storage
Area" (if excavation was performed) = 70.0

SEDIMENT BASIN SCHEMATIC ELEVATIONS

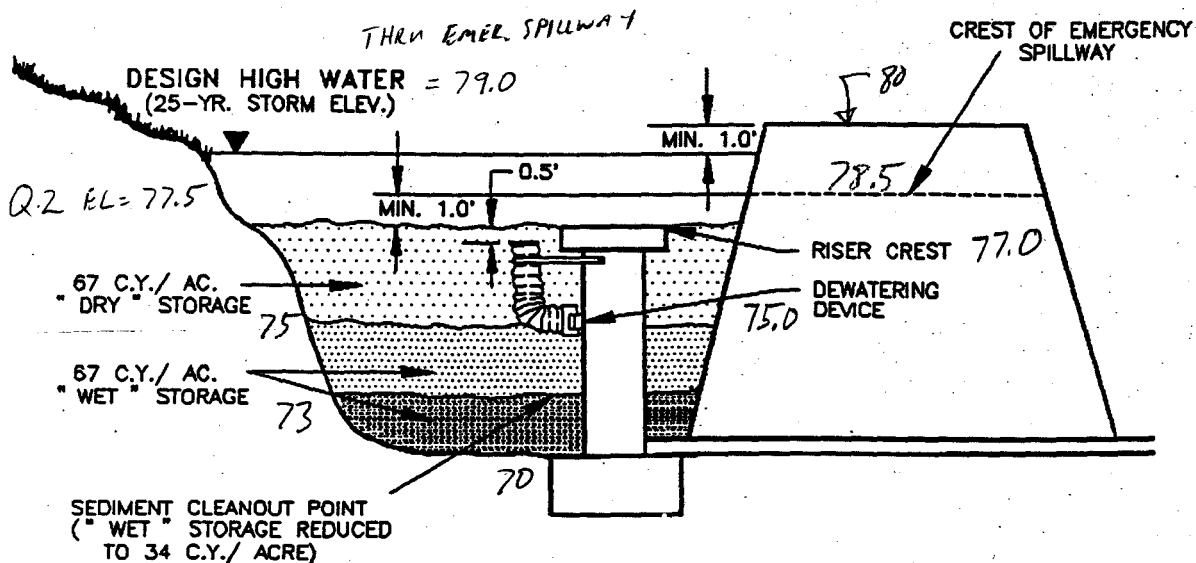


DESIGN ELEVATIONS WITH EMERGENCY SPILLWAY


POND ROUTING:

2-YR WSE = 77.1

25-YR WSE = 77.6

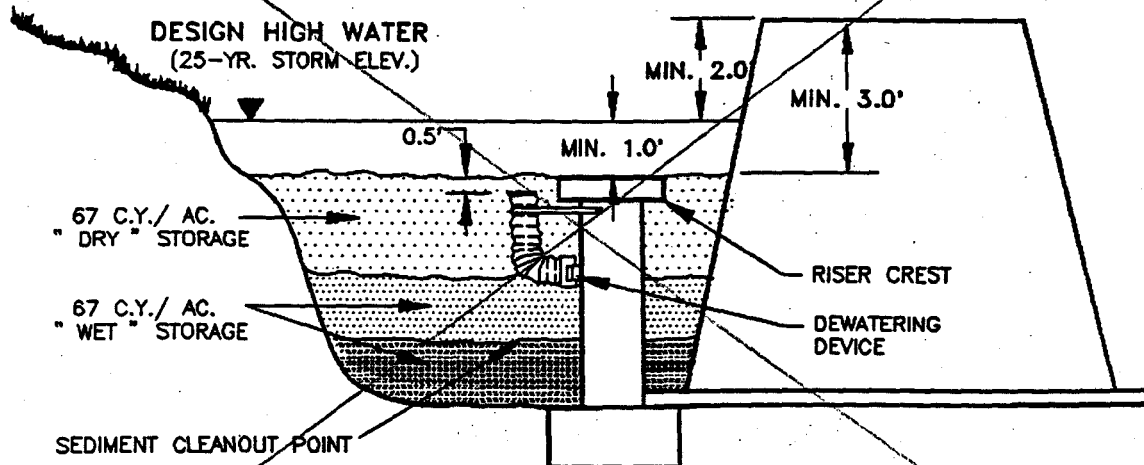

DESIGN ELEVATIONS WITHOUT EMERGENCY SPILLWAY (RISER PASSES 25-YR. EVENT)

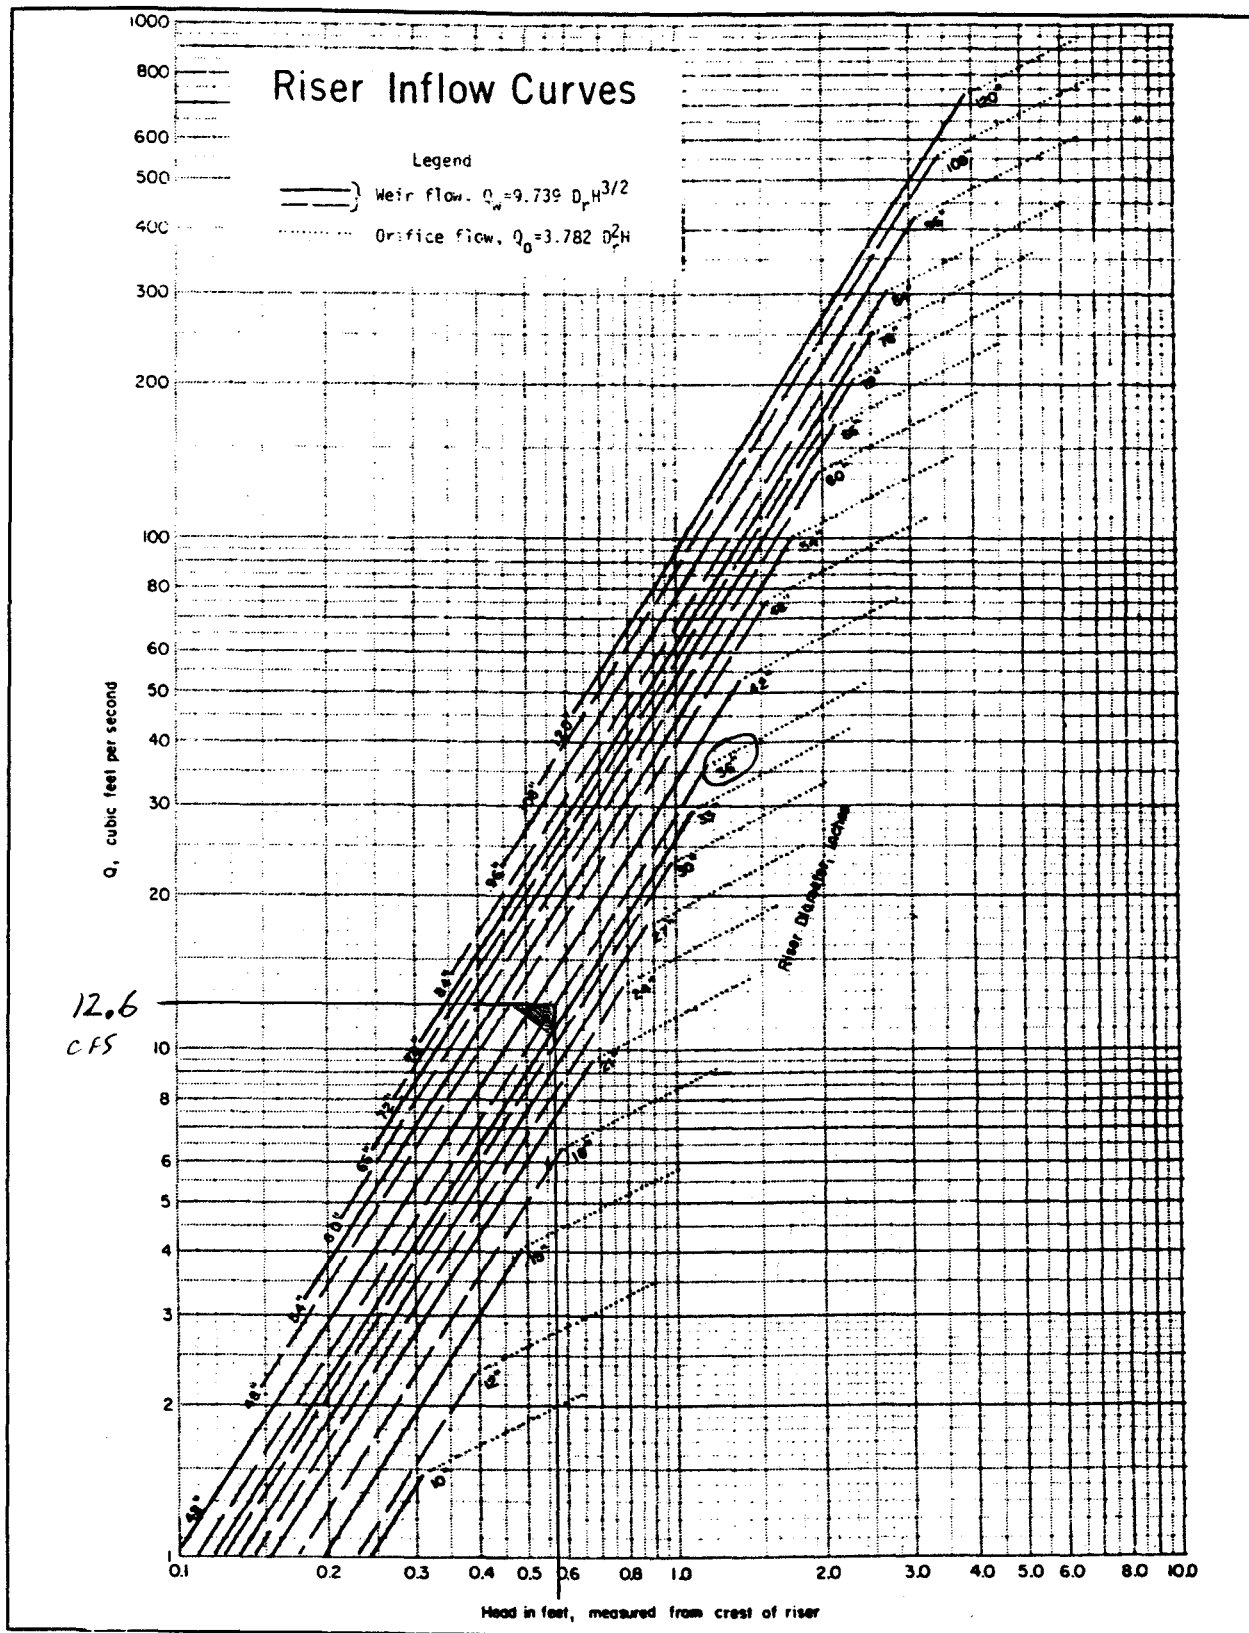

Source: USDA-SCS

Plate 3.14-8

TABLE 3.14-B
PIPE FLOW CHART, $n = 0.013$

FOR REINFORCED CONCRETE PIPE INLET $K_m = K_e + K_b = 0.65$ AND 70 FEET OF REINFORCED CONCRETE PIPE CONDUIT (full flow assumed)

Note correction factors for pipe lengths other than 70 feet
diameter of pipe in inches

H, in feet	12"	15"	18"	21"	24"	30"	36"	42"	48"	54"	60"	66"	72"	78"	84"	90"	96"	102"
1	3.22	5.44	8.29	11.8	15.9	26.0	38.6	53.8	71.4	91.5	114	139	167	197	229	264	302	342
2	4.55	7.69	11.7	16.7	22.5	36.8	54.6	76.0	101	129	161	197	236	278	324	374	427	483
3	5.57	9.42	14.4	20.4	27.5	45.0	66.9	93.1	124	159	198	241	289	341	397	458	523	592
4	6.43	10.9	16.6	23.5	31.8	52.0	77.3	108	143	183	228	278	334	394	459	529	604	683
5	7.19	12.2	18.5	26.3	35.5	58.1	86.4	120	160	205	255	311	373	440	513	591	675	764
6	7.88	13.3	20.3	28.8	38.9	63.7	94.6	132	175	224	280	341	409	482	562	647	739	837
7	8.51	14.4	21.9	31.1	42.0	68.8	102	142	189	242	302	368	441	521	607	699	798	904
8	9.10	15.4	23.5	33.3	44.9	73.5	109	152	202	259	323	394	472	557	645	748	854	966
9	9.65	16.3	24.9	35.3	47.7	78.0	116	161	214	275	342	418	500	590	688	793	905	1025
10	10.2	17.2	26.2	37.2	50.2	82.2	122	170	226	289	361	440	527	622	725	836	954	1080
11	10.7	18.0	27.5	39.0	52.7	86.2	128	178	237	304	379	462	553	653	761	877	1001	1133
12	11.1	18.9	28.7	40.8	55.0	90.1	134	186	247	317	395	482	578	682	794	916	1045	1184
13	11.6	19.6	29.9	42.4	57.3	93.7	139	194	257	330	411	502	601	710	827	953	1088	1232
14	12.0	20.4	31.0	44.1	59.4	97.3	145	201	267	342	427	521	624	736	858	989	1129	1278
15	12.5	21.1	32.1	45.6	61.5	101	150	208	277	354	442	539	646	762	888	1024	1169	1323
16	12.9	21.8	33.2	47.1	63.5	104	155	215	286	366	457	557	667	787	917	1057	1207	1367
17	13.3	22.4	34.2	48.5	65.5	107	159	222	294	377	471	574	688	812	946	1090	1244	1409
18	13.7	23.1	35.2	49.9	67.4	110	164	228	303	388	484	591	708	835	973	1121	1280	1450
19	14.0	23.7	36.1	51.3	69.2	113	168	234	311	399	497	607	727	858	1000	1152	1315	1489
20	14.4	24.3	37.1	52.6	71.0	116	173	240	319	409	510	623	746	880	1026	1182	1350	1528
21	14.7	24.9	38.0	53.9	72.8	119	177	246	327	419	523	638	764	902	1051	1211	1383	1566
22	15.1	25.5	38.9	55.2	74.5	122	181	252	335	429	535	653	782	923	1076	1240	1415	1603
23	15.4	26.1	39.8	56.5	76.2	125	186	258	342	439	547	668	800	944	1100	1268	1447	1639
24	15.8	26.7	40.6	57.7	77.8	127	189	263	350	448	559	682	817	964	1123	1295	1478	1674
25	16.1	27.2	41.5	58.9	79.4	130	193	269	357	458	571	696	834	984	1147	1322	1509	1708
26	16.4	27.7	42.3	60.0	81.0	133	197	274	364	467	582	710	850	1004	1169	1348	1539	1742
27	16.7	28.3	43.1	61.2	82.5	135	201	279	371	476	593	723	867	1023	1192	1373	1568	1775
28	17.0	28.8	43.9	62.3	84.1	138	204	285	378	484	604	737	883	1041	1214	1399	1597	1808
29	17.3	29.3	44.7	63.4	85.5	140	208	290	384	493	615	750	898	1060	1235	1423	1625	1840
30	17.6	29.8	45.4	64.5	87.0	142	212	294	391	501	625	763	913	1078	1256	1448	1653	1871
L, in feet	Correction Factors For Other Pipe Lengths																	
20	1.30	1.24	1.21	1.18	1.15	1.12	1.10	1.08	1.07	1.06	1.05	1.05	1.04	1.04	1.03	1.03	1.03	1.03
30	1.22	1.18	1.15	1.13	1.12	1.09	1.08	1.06	1.05	1.05	1.04	1.04	1.03	1.03	1.03	1.02	1.02	1.02
40	1.15	1.13	1.11	1.10	1.08	1.07	1.05	1.05	1.04	1.03	1.03	1.03	1.02	1.02	1.02	1.02	1.02	1.02
50	1.09	1.08	1.07	1.06	1.05	1.04	1.04	1.03	1.03	1.02	1.02	1.01	1.01	1.01	1.01	1.01	1.01	1.01
60	1.04	1.04	1.03	1.03	1.03	1.02	1.02	1.02	1.01	1.01	1.01	1.01	1.01	1.01	1.01	1.01	1.01	1.01
70	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
80	.96	.97	.97	.97	.98	.98	.98	.99	.99	.99	.99	.99	.99	.99	.99	.99	.99	.99
90	.93	.94	.94	.95	.95	.96	.97	.97	.98	.98	.98	.98	.98	.99	.99	.99	.99	.99
100	.90	.91	.92	.93	.93	.95	.95	.96	.97	.97	.98	.98	.98	.98	.98	.98	.98	.98
120	.84	.86	.87	.89	.90	.91	.93	.94	.94	.95	.96	.96	.96	.97	.97	.97	.97	.98
140	.80	.82	.83	.85	.86	.88	.90	.91	.92	.93	.94	.94	.95	.95	.96	.96	.96	.97
160	.76	.78	.80	.82	.83	.86	.88	.89	.90	.91	.92	.93	.94	.94	.95	.95	.95	.96


Source: USDA-SCS

TABLE 3.14-C

DESIGN DATA FOR EARTH SPILLWAYS


STAGE (H _P) IN FEET	SPILLWAY VARIABLES	BOTTOM WIDTH (b) IN FEET																	
		8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40	
C 5	Q	6	7	8	10	11	13	14	15	17	18	20	21	22	24	25	27	28	
	V	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	
	S	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	3.9	
	X	32	33	33	33	33	33	33	33	33	33	33	33	33	33	33	33	33	
O 6	Q	8	10	12	14	16	18	20	22	24	26	28	30	32	34	35	37	39	
	V	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	
	S	3.7	3.7	3.7	3.7	3.7	3.7	3.7	3.7	3.7	3.7	3.7	3.7	3.7	3.7	3.7	3.7	3.7	
	X	36	36	36	36	36	36	37	37	37	37	37	37	37	37	37	37	37	
O 7	Q	11	13	16	18	20	23	25	28	30	33	35	38	41	43	44	46	48	
	V	3.2	3.2	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	
	S	3.5	3.5	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	
	X	39	40	40	40	41	41	41	41	41	41	41	41	41	41	41	41	41	
O 8	Q	13	16	19	22	26	29	32	35	38	42	45	46	48	51	54	57	60	
	V	3.5	3.5	3.5	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	
	S	3.3	3.3	3.3	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	
	X	44	44	44	44	45	45	45	45	45	45	45	45	45	45	45	45	45	
O 9	Q	17	20	24	28	32	35	39	43	47	51	53	57	60	64	68	71	75	
	V	3.7	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	
	S	3.2	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	
	X	47	47	48	48	48	48	48	48	48	48	49	49	49	49	49	49	49	
I 0	Q	20	24	29	33	38	42	47	51	56	61	63	68	72	77	81	86	90	
	V	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	
	S	3.1	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	
	X	51	51	51	51	52	52	52	52	52	52	52	52	52	52	52	52	52	
I 1	Q	23	28	34	39	44	49	54	60	65	70	74	79	84	89	95	100	105	
	V	4.2	4.2	4.2	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	
	S	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	
	X	55	55	55	55	55	55	55	56	56	56	56	56	56	56	56	56	56	
I 2	Q	28	33	40	45	51	58	64	69	76	80	86	92	98	104	110	116	122	
	V	4.4	4.4	4.4	4.4	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	
	S	2.9	2.9	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	
	X	58	58	59	59	59	59	59	59	60	60	60	60	60	60	60	60	60	
I 3	Q	32	38	46	53	58	65	73	80	86	91	99	106	112	119	125	133	140	
	V	4.5	4.6	4.6	4.6	4.6	4.6	4.7	4.7	4.7	4.7	4.7	4.7	4.7	4.7	4.7	4.7	4.7	
	S	2.8	2.8	2.8	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	
	X	62	62	62	63	63	63	63	63	63	63	63	64	64	64	64	64	64	
I 4	Q	37	44	51	59	66	74	82	90	96	103	111	119	127	134	142	150	158	
	V	4.7	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.9	4.9	4.9	4.9	4.9	4.9	4.9	4.9	
	S	2.8	2.7	2.7	2.7	2.7	2.7	2.7	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	
	X	65	66	66	66	66	67	67	67	67	67	67	68	68	68	68	68	69	
I 5	Q	41	50	58	66	75	85	92	101	108	116	125	133	142	150	160	169	178	
	V	4.8	4.9	4.9	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.1	5.1	5.1	
	S	2.7	2.7	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.5	2.5	2.5	
	X	69	69	70	70	71	71	71	71	71	71	71	72	72	72	72	72	72	
I 6	Q	46	56	65	75	84	94	104	112	122	132	142	149	158	168	178	187	197	
	V	5.0	5.1	5.1	5.1	5.1	5.2	5.2	5.2	5.2	5.2	5.2	5.2	5.2	5.2	5.2	5.2	5.2	
	S	2.6	2.6	2.6	2.6	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	
	X	72	74	74	75	75	76	76	76	76	76	76	76	76	76	76	76	76	
I 7	Q	52	62	72	83	94	105	115	126	135	145	156	167	175	187	196	206	217	
	V	5.2	5.2	5.2	5.3	5.3	5.3	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	
	S	2.6	2.6	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	
	X	76	78	79	80	80	80	80	80	80	80	80	80	80	80	80	80	80	
I 8	Q	58	69	81	93	104	116	127	138	150	160	171	182	194	204	214	226	233	
	V	5.3	5.4	5.4	5.5	5.5	5.5	5.5	5.5	5.5	5.5	5.5	5.6	5.6	5.6	5.6	5.6	5.6	
	S	2.5	2.5	2.5	2.5	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	
	X	80	82	83	84	84	84	84	84	84	84	84	84	84	84	84	84	84	
I 9	Q	64	76	88	102	114	127	140	152	164	175	188	201	213	225	235	248	260	
	V	5.5	5.5	5.5	5.6	5.6	5.6	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	
	S	2.5	2.5	2.5	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	
	X	84	85	86	87	88	88	88	88	88	88	88	88	88	88	88	88	88	
2.0	Q	71	83	97	111	125	138	153	164	178	193	204	218	232	245	256	269	283	
	V	5.6	5.7	5.7	5.7	5.8	5.8	5.8	5.8	5.8	5.8	5.8	5.9	5.9	5.9	5.9	5.9	5.9	
	S	2.5	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	
	X	88	90	91	91	91	91	92	92	92	92	92	92	92	92	92	92	92	
2.1	Q	77	91	107	122	135	149	162	177	192	207	220	234	250	267	276	291	305	
	V	5.7	5.8	5.9	5.9	5.9	5.9	5.9	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	
	S	2.4	2.4	2.4	2.4	2.4	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	
	X	92	93	95	95	95	95	95	95	95	96	96	96	96	96	96	96	96	
2.2	Q	84	100	116	131	146	163	177	194	210	224	238	253	269	288	301	314	330	
	V	5.9	5.9	6.0	6.0	6.0	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.2	6.2	6.2	6.2	
	S	2.4	2.4	2.4	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	
	X	96	98	99	99	99	99	99	100	100	100	100	100	100	100	100	100	100	
2.3	Q	90	108	124	140	158	175	193	208	226	243	258	275	292	306	323	341	354	
	V	6.0	6.1	6.1	6.1	6.2	6.2	6.2	6.2	6.3	6.3	6.3	6.3	6.3	6.3	6.3	6.3	6.3	
	S	2.4	2.4	2.3	2.3	2.3	2.3	2.3	2.3	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	
	X	100	102	102	103	103	103	104	104	104	105	105	105	105	105	105	105	105	
2.4	Q	99	116	136	152	170	189	206	224	241	260	275	294	312	327	346	364	378	
	V	6.1	6.2	6.2	6.3	6.3	6.3	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	
	S	2.3	2.3	2.3	2.3	2.3	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	
	X	105	105	106	107	107	108	108	108	108	109	109	109	109	109	109	109	109	

Source: USDA-SCS

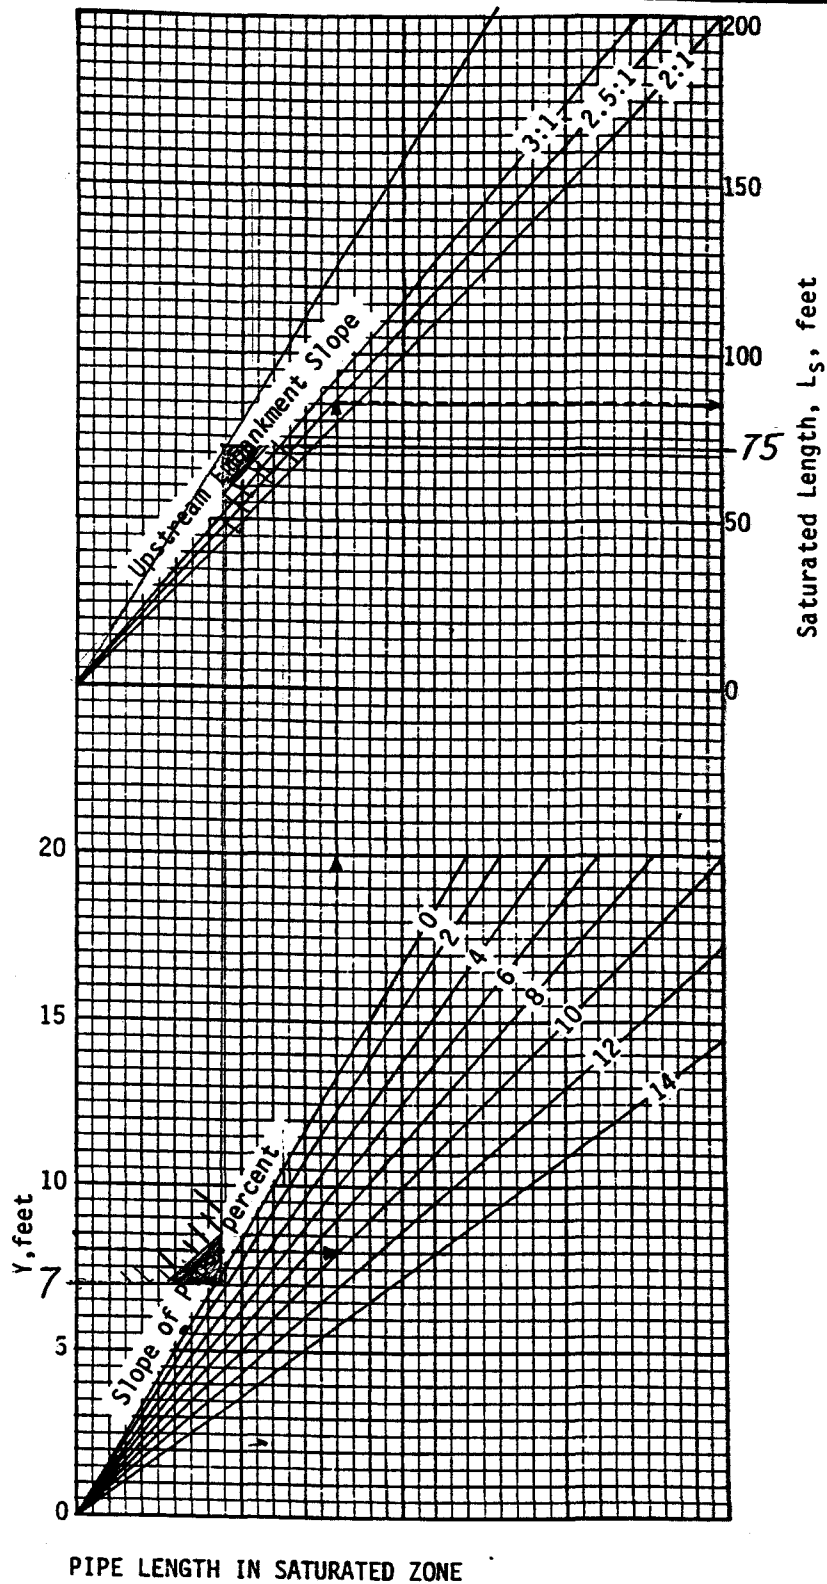

Source: USDA-SCS

Plate 3.14-11

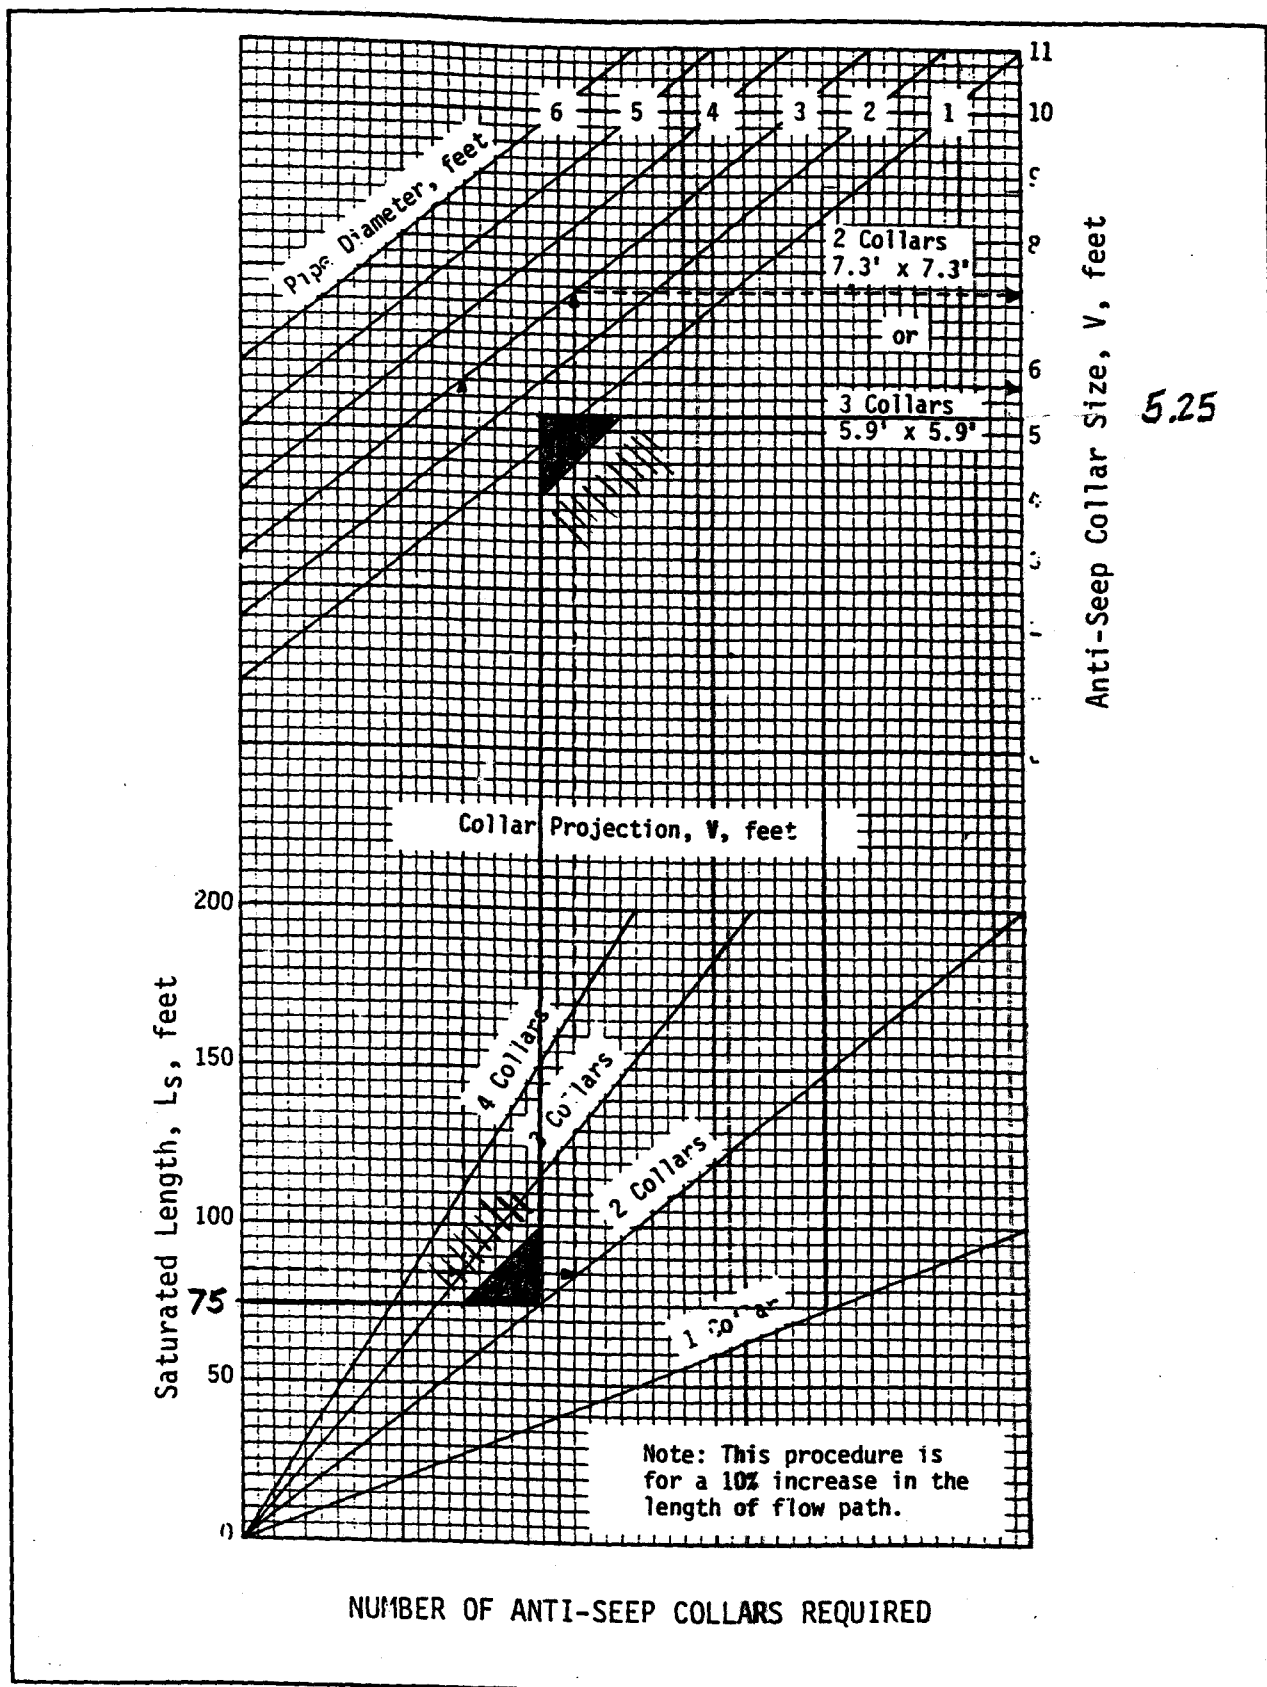

Source: USDA-SCS

Plate 3.14-12

Hydrograph Summary Report

Page 1

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to peak (min)	Volume (cuft)	Return period (yrs)	Inflow hyd(s)	Maximum elevation (ft)	Maximum storage (cuft)	Hydrograph description
1	Rational	7.8 ✓	1	5	2,922	2	—	—	—	2yr Pre
2	Rational	10.0 ✓	1	5	3,768	10	—	—	—	10yr Pre
3	Rational	13.0 ✓	1	5	4,858	100	—	—	—	100yr Pre
5	Rational	18.2 ✓	1	5	6,830	1	—	—	—	1yr Post
6	Rational	21.0 ✓	1	5	7,864	2	—	—	—	2yr Post
7	Rational	27.0 ✓	1	5	10,141	10	—	—	—	10yr Post
8	Rational	34.9 ✓	1	5	13,074	100	—	—	—	100yr Post
10	Reservoir	0.4	1	12	6,406	1	5	75.87	23,584	1yr routing
11	Reservoir	0.4	1	12	7,385	2	6	76.00	24,561	2yr routing
12	Reservoir	0.4	1	12	9,538	10	7	76.26	26,718	10yr routing
13	Reservoir	0.5	1	12	12,312	100	8	76.59 <i>DHW</i>	29,503	100yr routing
Proj. file: Pond.gpw				IDF file: JCChydrographs.IDF				Run date: 06-21-2001		

Hydrograph Plot

English

Hyd. No. 10


1yr routing

Hydrograph type = Reservoir
Storm frequency = 1 yrs
Inflow hyd. No. = 5
Max. Elevation = 75.87 ft

Peak discharge = 0.35 cfs
Time interval = 1 min
Reservoir name = pond1
Max. Storage = 23,584 cuft

Storage Indication method used.

Total Volume = 6,406 cuft

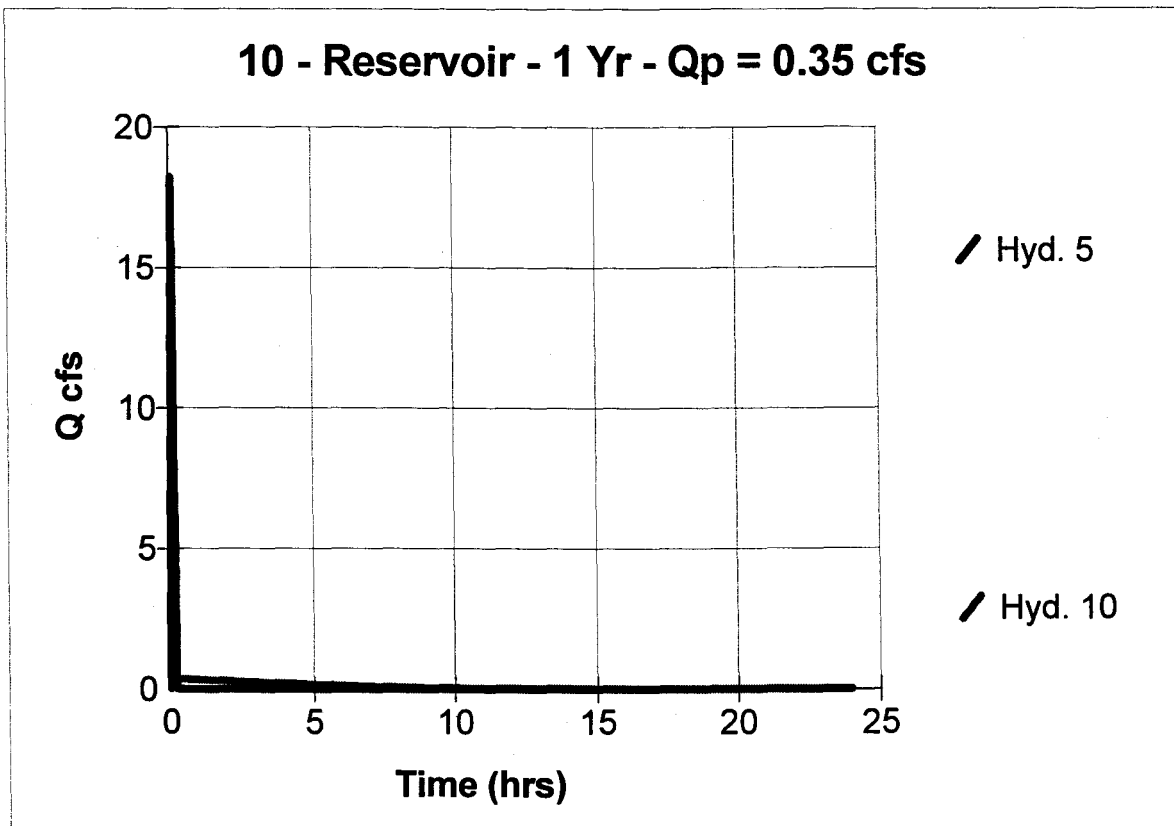

*Routed
1-yr*

Hydrograph Plot

English

Hyd. No. 11


2yr routing

Hydrograph type = Reservoir
Storm frequency = 2 yrs
Inflow hyd. No. = 6
Max. Elevation = 76.00 ft

Peak discharge = 0.38 cfs
Time interval = 1 min
Reservoir name = pond1
Max. Storage = 24,561 cuft

Storage Indication method used.

Total Volume = 7,385 cuft

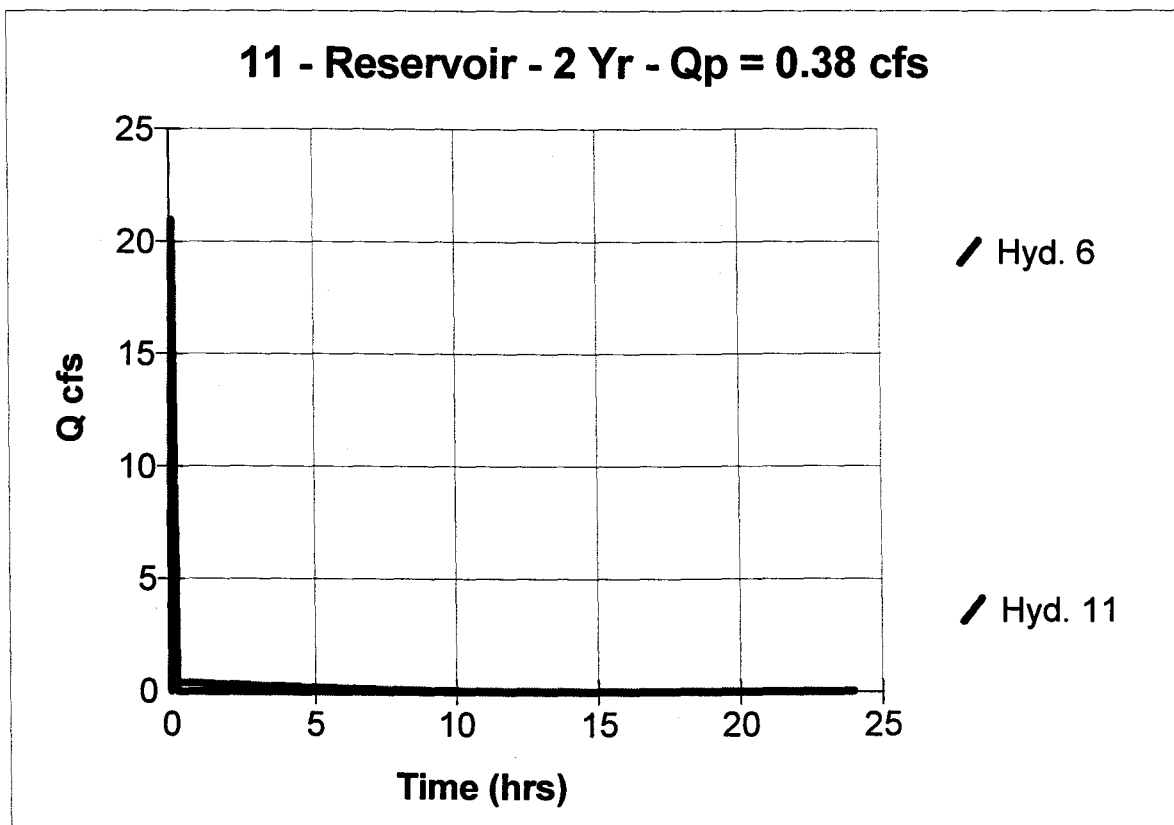

*Routed
2-Year*

Hydrograph Plot

English

Hyd. No. 12


10yr routing

Hydrograph type = Reservoir
Storm frequency = 10 yrs
Inflow hyd. No. = 7
Max. Elevation = 76.26 ft

Peak discharge = 0.44 cfs
Time interval = 1 min
Reservoir name = pond1
Max. Storage = 26,718 cuft

Storage Indication method used.

Total Volume = 9,538 cuft

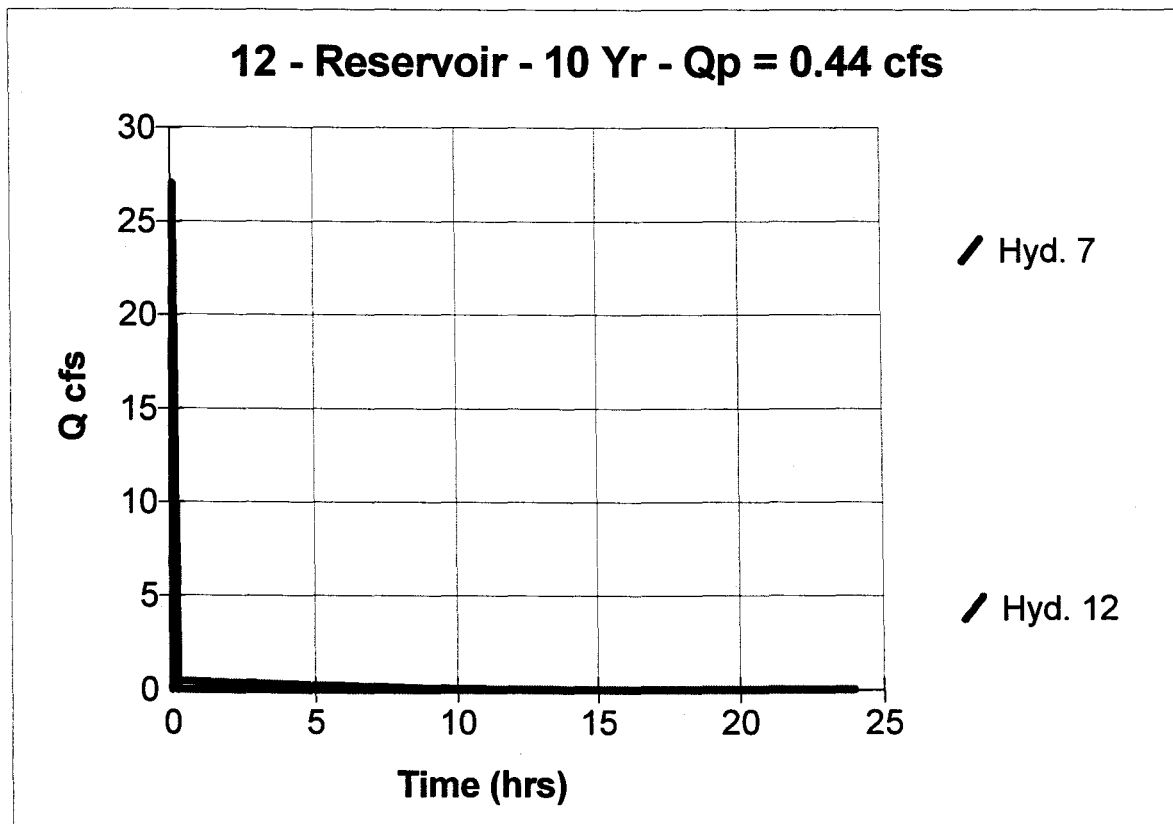

*Routed
10-YR.*

Hydrograph Plot

English

Hyd. No. 13

100yr routing


Hydrograph type = Reservoir
Storm frequency = 100 yrs
Inflow hyd. No. = 8
Max. Elevation = 76.59 ft

*Never reaches
riser crest @
EL 77.0*

Peak discharge = 0.50 cfs
Time interval = 1 min
Reservoir name = pond1
Max. Storage = 29,503 cuft


Storage Indication method used.

Total Volume = 12,312 cuft

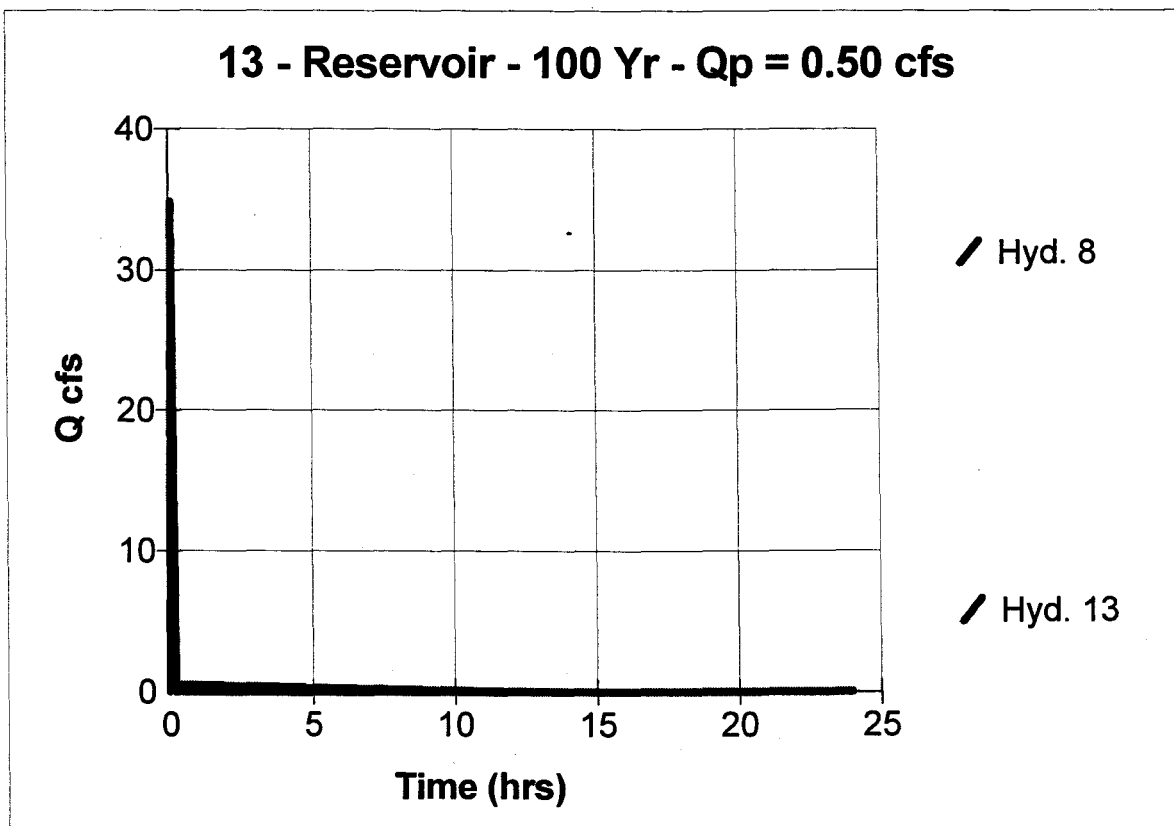

*Routed
100-yr.*

pond1

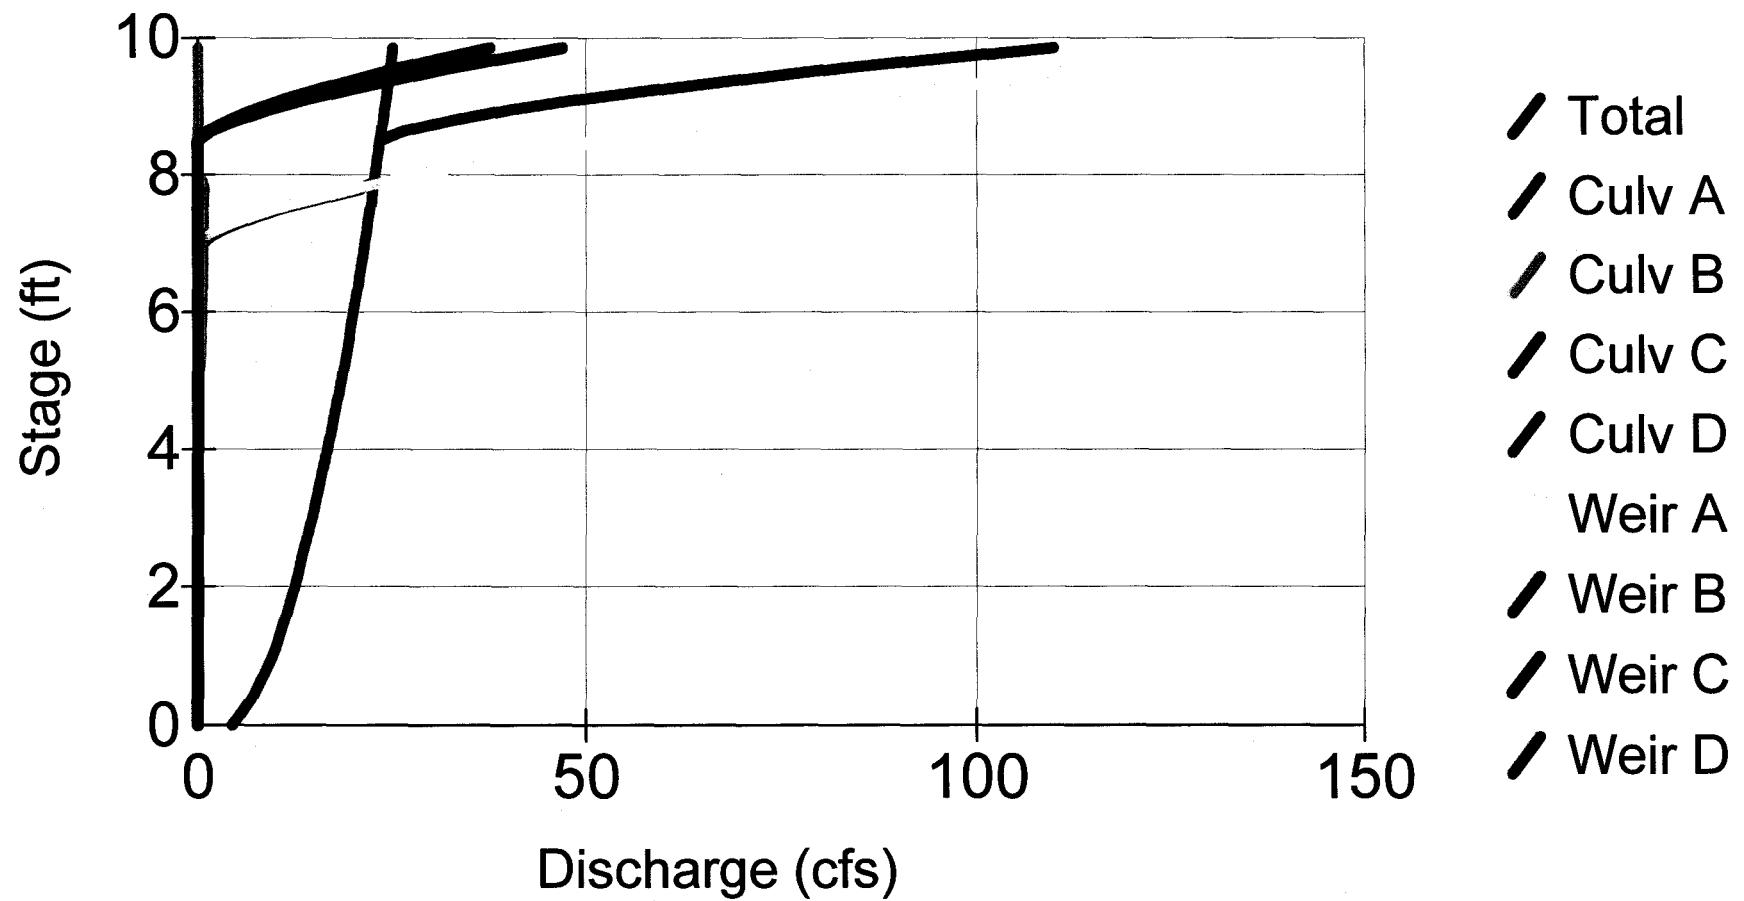

Reservoir Report

Page 1

English

Reservoir No. 1 - pond1

Pond Data

Pond storage is based on known contour areas

Stage / Storage Table

Stage ft	Elevation ft	Contour area sqft	Incr. Storage cuft	Total storage cuft
0.00	70.00 ✓	1,094	0	0
2.00	72.00	2,396	3,490	3,490
3.70	73.70	4,303	5,694	9,184
4.00	74.00	5,971	1,541	10,725
5.00	75.00	6,918	6,445	17,170
6.00	76.00	7,865	7,392	24,562
7.00	77.00	8,926	8,396	32,958
8.00	78.00	9,986	9,456	42,414
8.50	78.50 ✓	10,684	5,168	47,582
10.00	80.00 ✓	12,776	17,595	65,177

Culvert / Orifice Structures

	[A] <i>BARREL</i>	[B]	[C]	[D]
Rise in	= 18.0 ✓	4.0 ✓	0.0	0.0
Span in	= 18.0 ✓	4.0 ✓	0.0	0.0
No. Barrels	= 1	1 ✓	0	0
Invert El. ft	= 69.00 ✓	75.00	0.00	0.00
Length ft	= 100.0 ✓	0.0	0.0	0.0
Slope %	= 1.00 ✓	0.00	0.00	0.00
N-Value	= .013	.013 ✓	.000	.000
Orif. Coeff.	= 0.60 ✓	0.60 ✓	0.00	0.00
Multi-Stage	= ----	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len ft	= 9.4 ✓	8.0 ✓	10.0	0.0
Crest El. ft	= 77.00 ✓	78.50	78.50	0.00
Weir Coeff.	= 3.00 ✓	3.00 ✓	3.00	0.00
Eqn. Exp.	= 1.50	1.50	1.50	0.00
Multi-Stage	= Yes	No	No	No

Tailwater Elevation = 69.20 ft

Note: All outflows have been analyzed under inlet and outlet control.

Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Discharge cfs
0.00	0	70.00	4.31	0.00	---	---	0.00	0.00	0.00	---	0.00
2.00	3,490	72.00	12.33	0.00	---	---	0.00	0.00	0.00	---	0.00
3.70	9,184	73.70	15.98	0.00	---	---	0.00	0.00	0.00	---	0.00
4.00	10,725	74.00	16.54	0.00	---	---	0.00	0.00	0.00	---	0.00
5.00	17,170	75.00	18.29	0.00	---	---	0.00	0.00	0.00	---	0.00
6.00	24,562	76.00	19.88	0.38	---	---	0.00	0.00	0.00	---	0.38
7.00	32,958	77.00	21.36	0.57	---	---	0.00	0.00	0.00	---	0.57
8.00	42,414	78.00	22.74	0.00	---	---	28.20	0.00	0.00	---	22.74
8.50	47,582	78.50	23.40	0.00	---	---	51.81	0.00	0.00	---	23.40
10.00	65,177	80.00	25.27	0.00	---	---	146.53	44.09	55.11	---	124.48

pond1


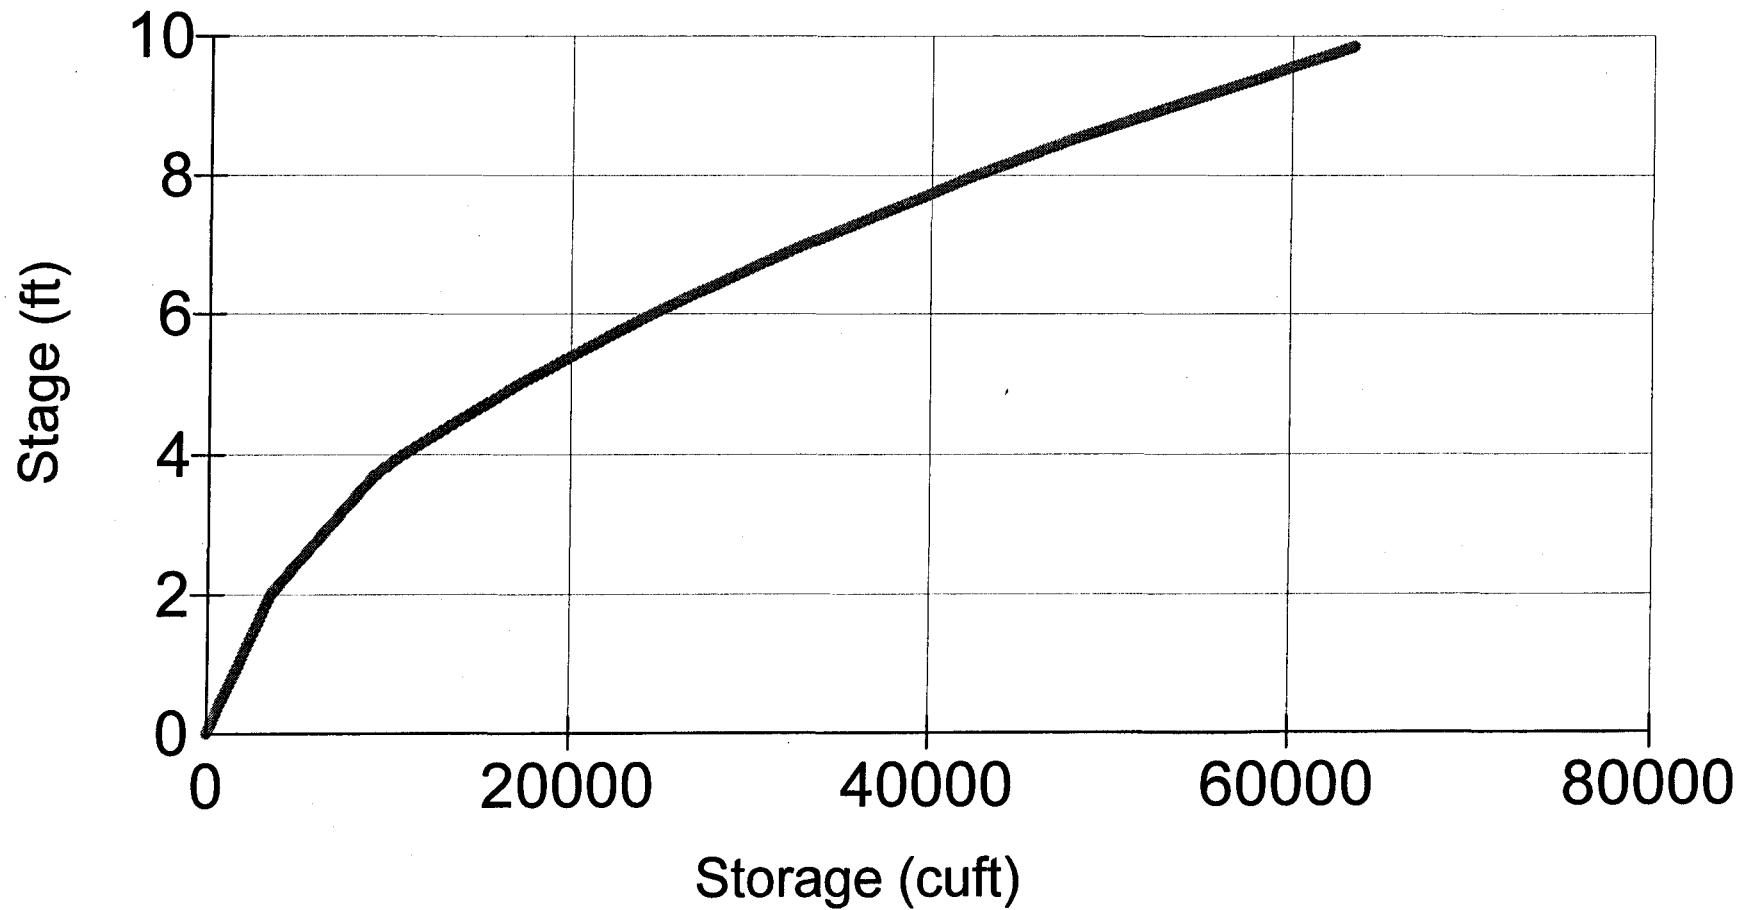


Fig. 1.5.1.2

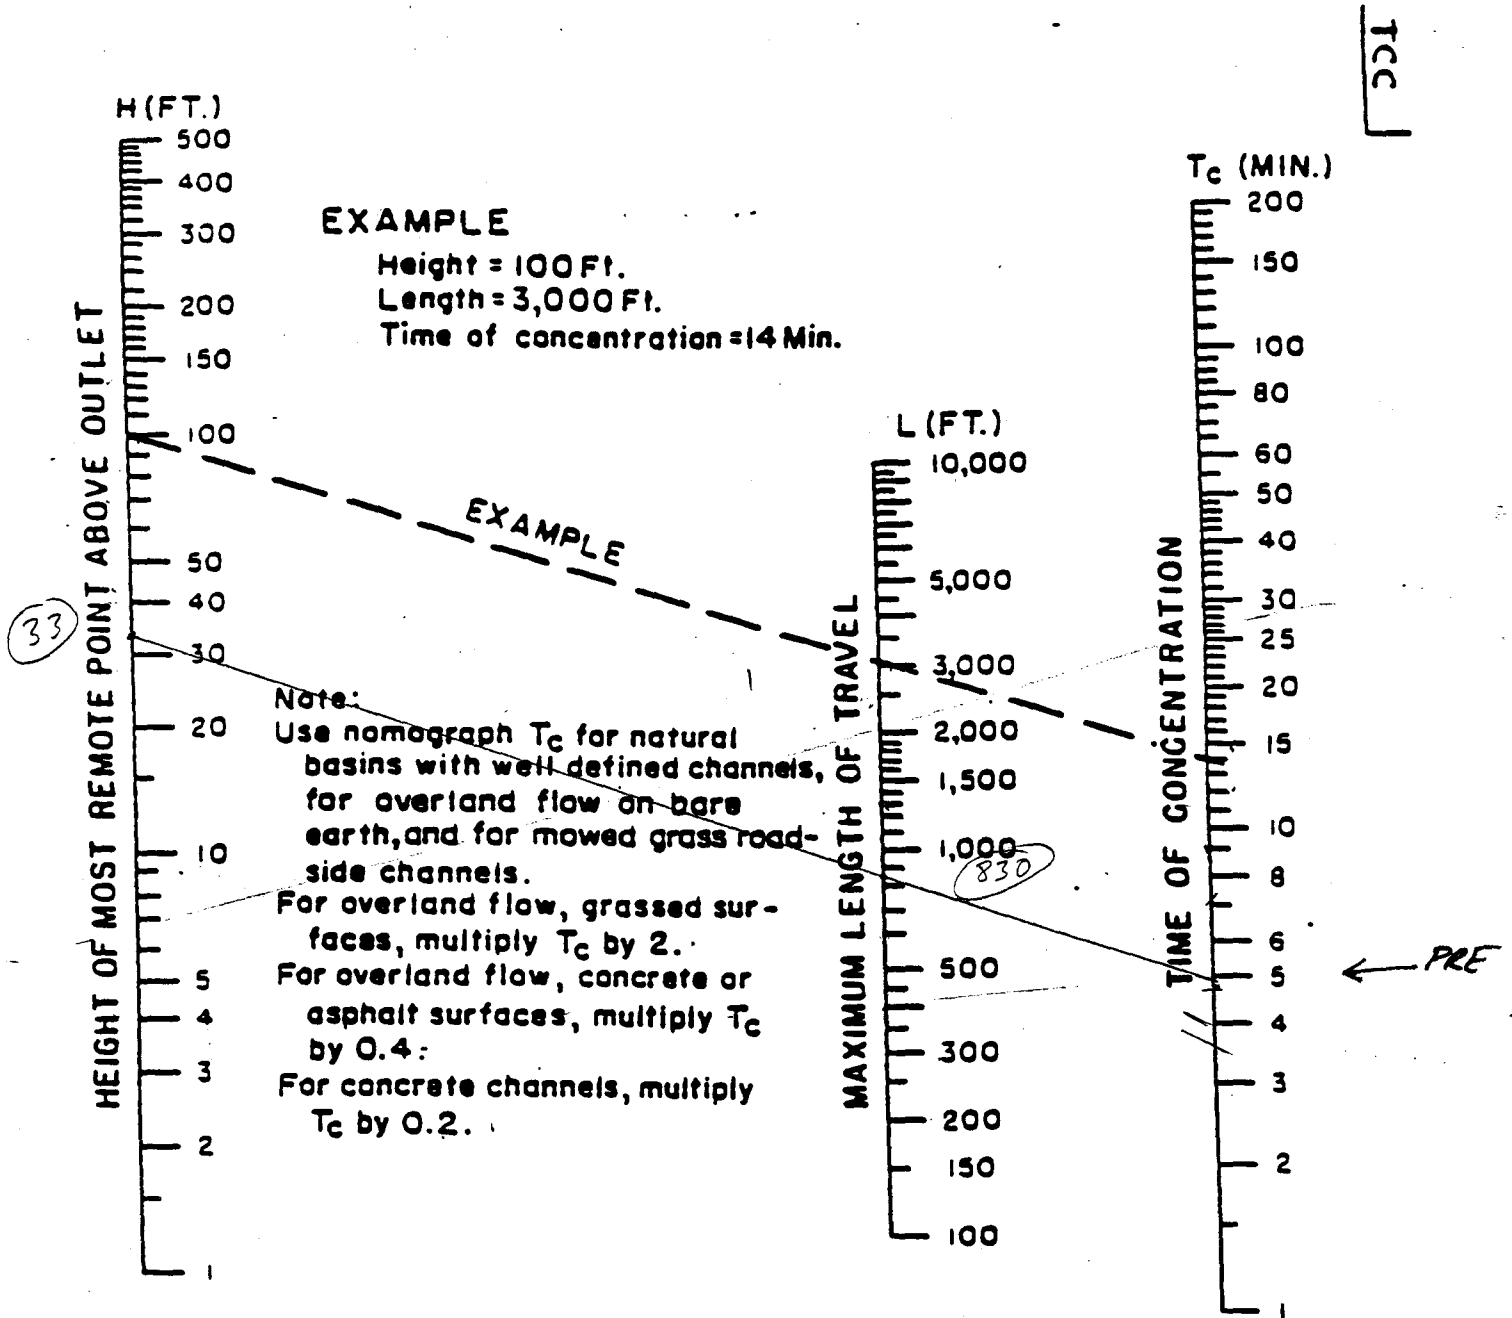

Based on study by P. Z. Kirpich,
 Civil Engineering, Vol. 10, No. 6, June 1940, p. 362

TIME OF CONCENTRATION OF SMALL DRAINAGE BASINS

Hydrograph Plot

English


Hyd. No. 1

2yr Pre

Hydrograph type = Rational
Storm frequency = 2 yrs
Drainage area = 4.7 ac
Intensity = 5.53 in
I-D-F Curve = JCChydrographs.IDF

Peak discharge = 7.79 cfs
Time interval = 1 min
Runoff coeff. = 0.3
Time of conc. (Tc) = 5 min ? OK
Reced. limb factor = 1.5

Total Volume = 2,922 cuft

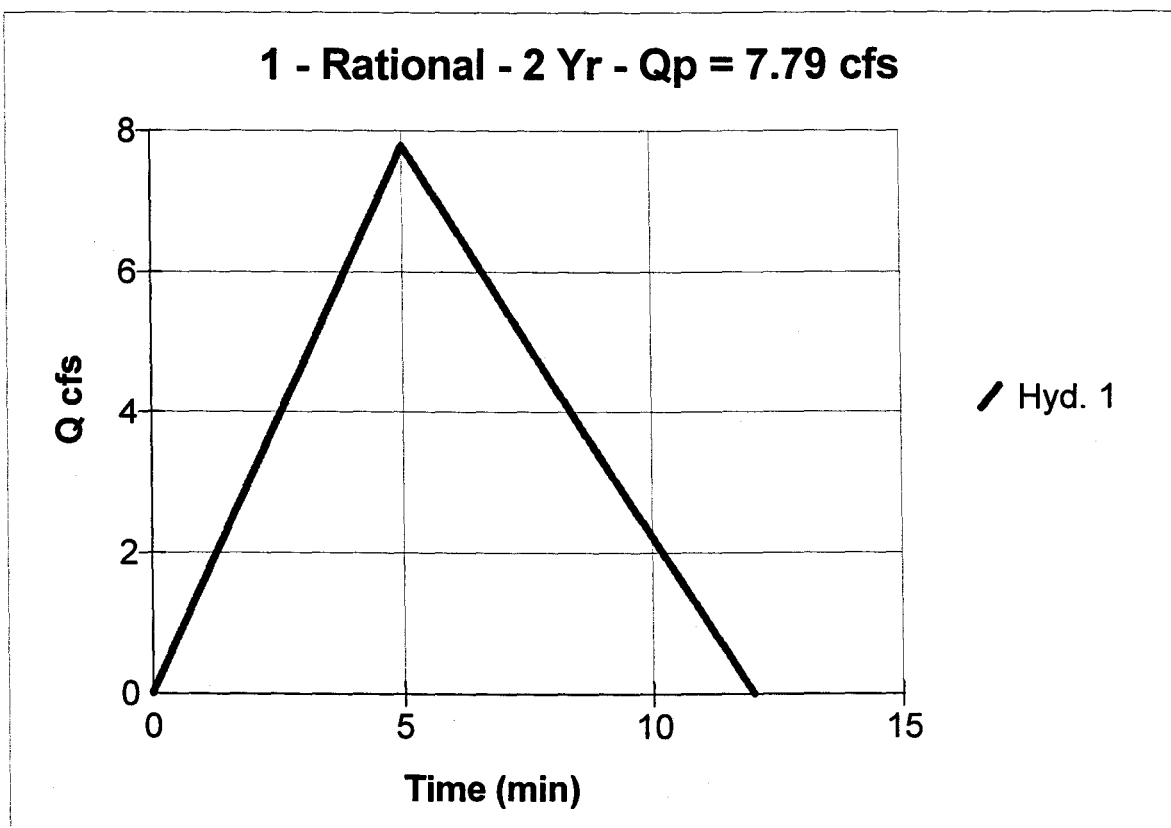

Hydrograph Plot

English


Hyd. No. 2

10yr Pre

Hydrograph type = Rational
Storm frequency = 10 yrs
Drainage area = 4.7 ac
Intensity = 7.13 in
I-D-F Curve = JCChydrographs.IDF

Peak discharge = 10.05 cfs
Time interval = 1 min
Runoff coeff. = 0.3
Time of conc. (Tc) = 5 min
Reced. limb factor = 1.5

Total Volume = 3,768 cuft

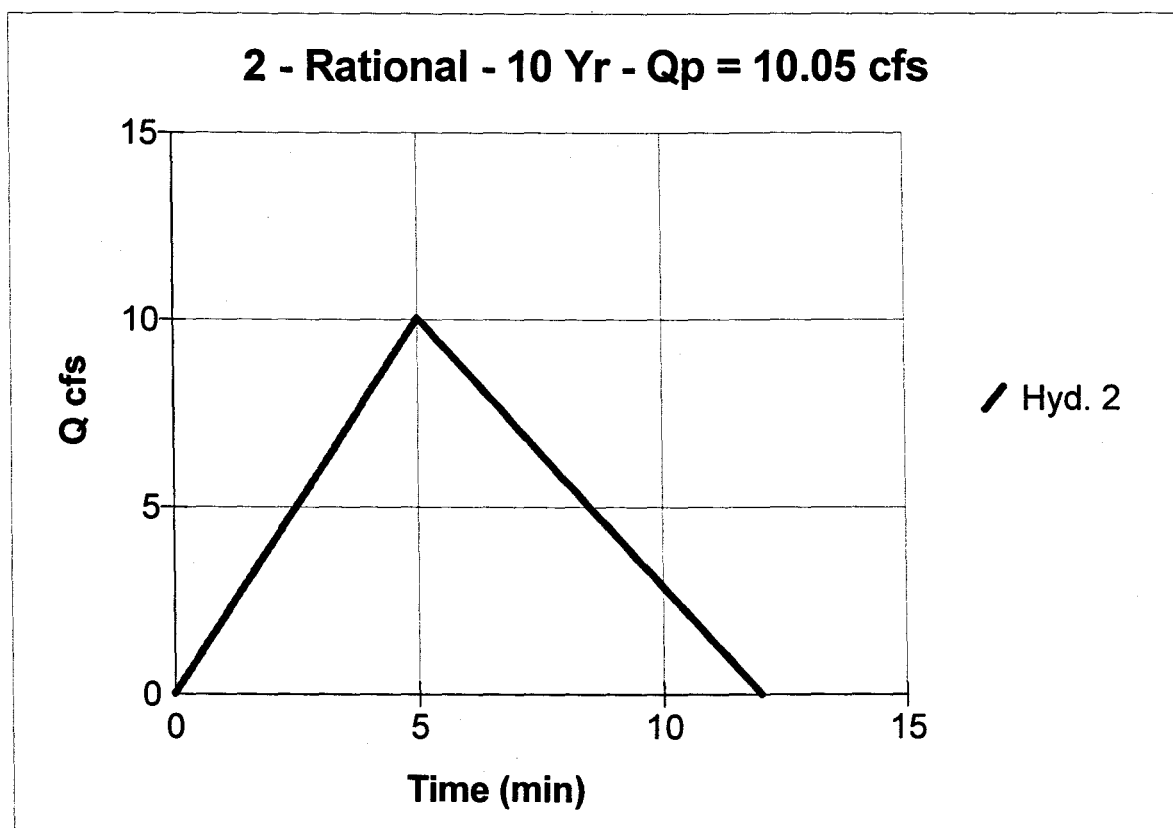

Hydrograph Plot

English


Hyd. No. 3

100yr Pre

Hydrograph type = Rational
Storm frequency = 100 yrs
Drainage area = 4.7 ac
Intensity = 9.19 in
I-D-F Curve = JCChydrographs.IDF

Peak discharge = 12.95 cfs
Time interval = 1 min
Runoff coeff. = 0.3
Time of conc. (Tc) = 5 min
Reced. limb factor = 1.5

Total Volume = 4,858 cuft

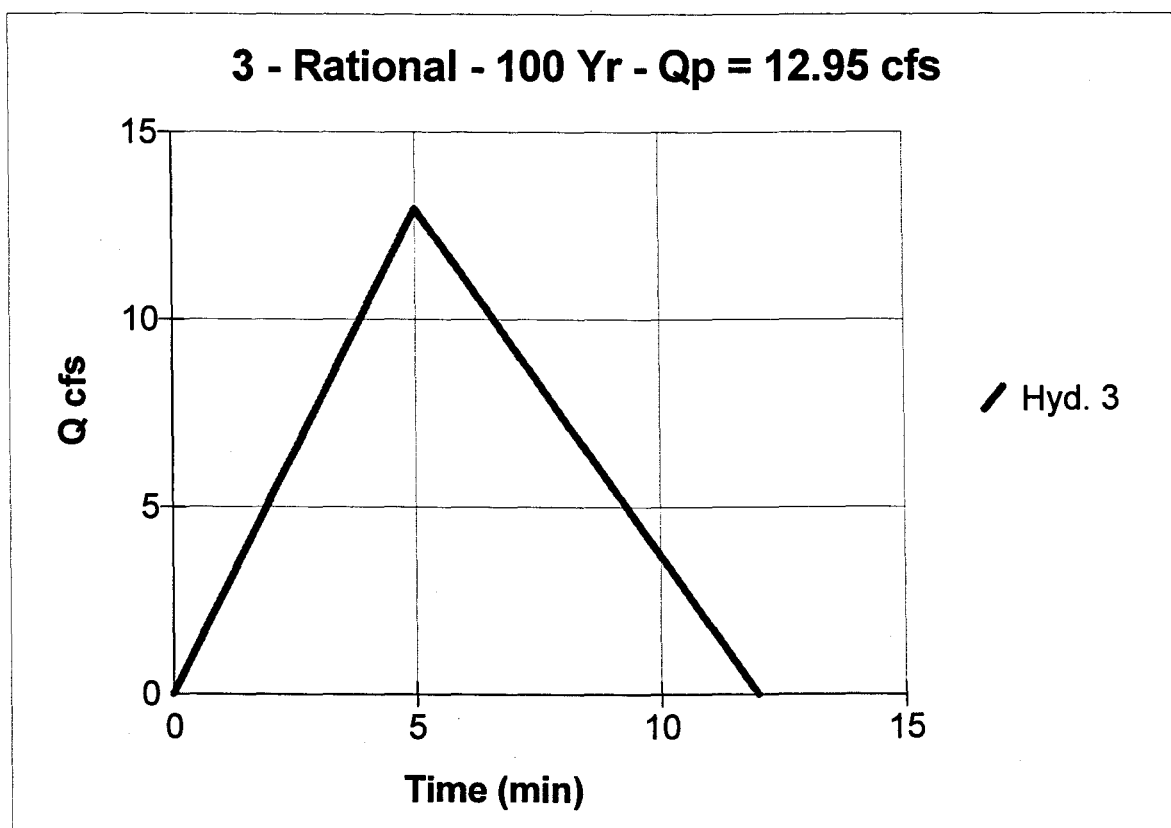

WORKSHEET FOR BMP POINT SYSTEM

TOTAL SITE AREA = 7.75 AC.

A. STRUCTURAL BMP POINT ALLOCATION

<u>BMP</u>	<u>BMP Points</u>	<u>Fraction of Site Served</u>	<u>Weighted BMP Points</u>
Wet Pond (E.D.)	10 ✓	x $(\overset{\checkmark}{6.30} + \overset{\checkmark}{0.59}) \div 7.75 =$ ✓	<u>8.89</u>

TOTAL WEIGHTED STRUCTURAL BMP POINTS:

8.89

B. NATURAL OPEN SPACE CREDIT

<u>Adjacent To Wetland</u>	<u>Natural Open Space Credit</u>	<u>Fraction of Site</u>	<u>Points for Natural Open Space</u>
No	10	x $0.94 \div 7.75$	= 1.21 ✓

C. TOTAL WEIGHTED POINTS

<u>Structural BMP Points</u> ✓	+	<u>Natural Open Space Points</u> ✓	=	<u>Total</u> ✓
8.89		1.21		10.10

NOTES:

- 1) Natural open space has been placed in a conservation easement.

Impervious Area and Required Volume Calculations
for
Ironbound Village
AES# 8914-1

Impervious items	Totals		Acres
Houses	23 Ea	1350 SF	0.71
T.H.	7 Ea	912 SF	0.15
Office	4 Ea	2400 SF	0.22
Driveways	23 Ea	312 SF	0.16
Roads:			
Public	870 LF	31 Width	0.62
Private	530 LF	60 Width	0.73
Pond Access Rd	340 LF	12 Width	0.09
Wet Pond Surface @ N.P.	105 LF	65 Width	0.16
Sidewalks:			
w/in R/W	850 LF	8 Width	0.16
Offsite Road	500 LF	12 Width	0.14
Total Impervious Area (TIA)			3.14

Area to Pond = 6.8 Acres

Percent Impervious = 46% ✓

Pond's Required Wet Volume = $(1'')(\text{ft}/12'')(\text{TIA Ac})(43560 \text{ sf}/\text{Ac}) = 11,390 \text{ c.f.}$

Pond's Required Dry Volume = $(1'')(\text{ft}/12'')(\text{TIA Ac})(43560 \text{ sf}/\text{Ac}) = 11,390 \text{ c.f.}$

Sediment Forebay's Required Volume = $(0.1'')(\text{ft}/12'')(\text{TIA Ac})(43560 \text{ sf}/\text{Ac}) = 1,139 \text{ c.f.}$

$$\frac{\text{IMPERV } 3.14(0.95) + \text{OTHER } 3.66(0.5)}{6.8}$$

$$C = 0.70; C = 0.60 \text{ w/OTHER}$$

$$C = 0.55 \text{ USED AT } C = 0.3$$

BMP VOLUME CALCULATIONS
for
STONEHOUSE PH 1, Bent Tree (Sect. V-B) Ph3
AES Project No.: 8878-00

OK
W/Q ✓

PROPOSED POND VOLUME

Eleva	Depth	Area (sq. ft.)	Incremental Volume (cu. ft.)	Sum Volume (cu. ft.)	Sum Volume (cu. yd.)	Volume Above NPE
70.0	0.0	1,094	0	0	0	
72.0	2.0	2,396	3,490	3,490	129	
73.7	1.7	4,303	5,694	9,184	340	
74.0	0.3	5,971	1,541	10,725	397	
75.0	1.0	6,918	6,445	17,170	636	0
76.0	1.0	7,886	7,392	24,561	910	7,391
77.0	1.0	8,926	8,396	32,957	1,221	15,787
78.0	1.0	9,986	9,456	42,413	1,571	25,243
78.5	0.5	10,684	5,168	47,580	1,762	30,410
80.0	1.5	12,776	17,595	65,175	2,414	48,005

RELEASE RATE REQUIRED TO DETAINED VOLUME FOR 24 HOURS

Required BMP Volume (based upon Impervious Area) = 11,390 cubic feet

Volume Provided (based upon above table) = 15,787 cubic feet

Elevation of water surface associated with provided volume = 77.0

Elevation of Low Flow Orifice = 75.0

Average Head, in feet = 1.0

Average Release Rate Calculation $\frac{15,787 \text{ cubic feet}}{(24 \text{ hours} \times 60 \text{ minutes/hour} \times 60 \text{ seconds/minute})} = 0.2 \text{ cfs}$

SEE
FIRST
PAGE

LOW FLOW ORIFICE DIAMETER REQUIRED TO MAINTAIN AVERAGE RELEASE RATE

$$\text{Diameter of Low Flow Orifice} = 2 * (Q / ((64.32 * (h / 2)) ^ (1/2) * 0.6 * 3.14))) ^ (1/2)$$

where, Q equals average release rate (cfs), h equals average head (feet)

Diameter of Low Flow Orifice = 0.30 feet, or 4 inches

SEDIMENT FOREBAY
for
Ironbound Village
AES Project No.: 8914-1

DRAINAGE AREA TO POINT OF CONCERN 6.8 Acres

IMPERVIOUS AREA TO POINT OF CONCERN 3.14 Acres

STORAGE REQUIRED

A. Volume = 1" per Impervious Area = 1139 cf

STORAGE PROVIDED

Eleva	Depth	Area (sq. ft.)	Incremental Volume (cu. ft.)	Wet Volume (cu. ft.)	Wet Volume (cu. yd.)		
70.0	0.0	422	0	0	0		
72.0	2.0	994	1,416	1,416	52		
73.0	1.0	1,365	1,180	2,596	96		

1180 > 1139 OK.

C. Anti-Flotation Calculations

Down Force = Wt of riser + Wt. of Soil + Wt. of Anti-Vortex Cap

Wt. of Riser = Wt. Walls + Wt. Slab + Wt. Grout - Openings - Weir

Wt. Walls =	$((O.D./2)^2 - (I.D./2)^2) \times 3.14 \times (\text{Height}) \times 150 \text{ LB/CF}$
Wt. of walls	7418 LB
Wt. Slab	Area Base Slab x Thickness x 150LB/CF
Wt. of slab	2944 LB
Wt. Grout	4239 LB
Wt. outlet opening	132 LB
Wt. of weir	0 LB
Wt. of Riser =	<u>14469</u> LB

Wt. of Soil = Wt. Soil at the Angle of Repose - Wt. Water
 = (Vol. Above Base Slab - Vol. Riser) x (110LB - 64.4 LB)

Slab Area =	19.63 SF	
		Avg. Area =
Surface Area =	39.75 SF	29.69
Vol. above Base =	178 CF	
Vol. Riser =	103 CF	
Wt. Soil =	<u>4686</u> LB	


Wt. Anti-Vortex Cap **2220 LB**

Total Down Force =	<u>21375</u> LB	↓ ✓	(14469 + 4686 + 2220)
Total Uplift =	<u>12815</u> LB	↑ ✓	
Resultant Force =	<u>8559</u> LB	↓	OK

FS = 1.668 > 1.5 OK

Buoyancy / Anti-Flotation Calculations

A. Sketch:

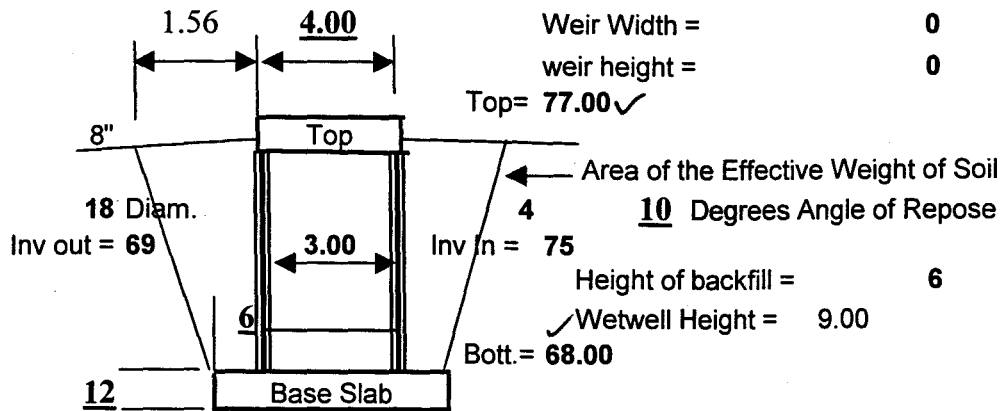

B. Buoyancy Calculations (Uplift)

Uplift = Wt. Water Displaced by the Wetwell

$$\text{Vol. of the riser} = \left(\frac{\text{O.D.}}{2} \right)^2 \times 3.14 \times \text{Height}$$

113 CF

$$\text{Vol. of slab} = \left(\frac{\text{Dia. Slab}}{2} \right)^2 \times 3.14 \times \text{Slab Thickness}$$

20 CF

$$\text{Total Vol. of Displacement} = 133 \text{ CF}$$

$$\text{Total Uplift} = 8544 \text{ LB} \uparrow \text{Up}$$

Safety factor against uplift =

1.3

for any pond

Safety factor against uplift =

1.5

at normal pool elevation of wet ponds



$$\text{Total Uplift with safety factor} = 12815 \text{ LB} \uparrow \text{Up}$$

Source: USDA-SCS

III - 164


Plate 3.18-3

DESIGN OF OUTLET PROTECTION FROM A ROUND PIPE FLOWING FULL
MINIMUM TAILWATER CONDITION ($T_w < 0.5$ DIAMETER)

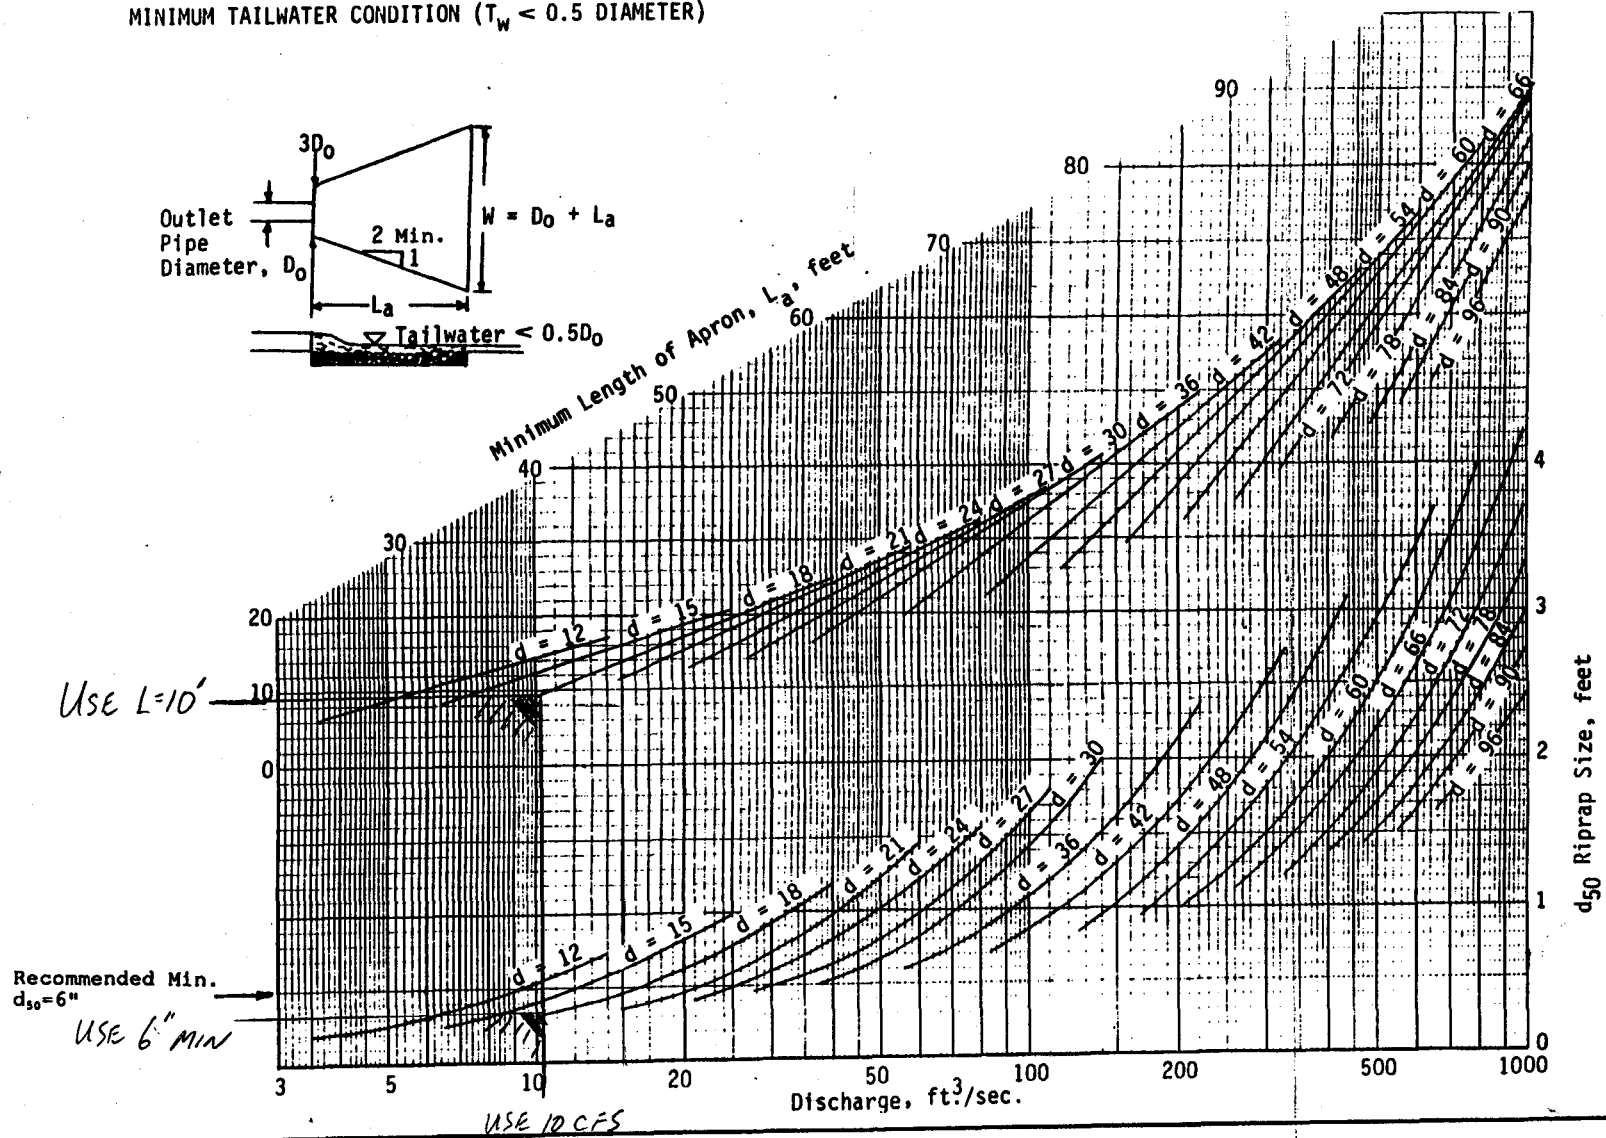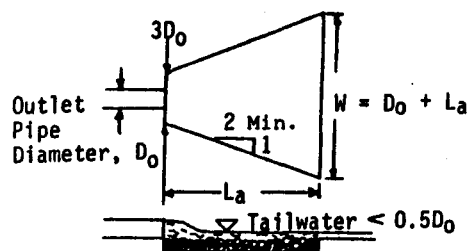

Adequate Channel Analysis
Ironbound Village
July 5, 2001
Project No. 8914-01

CHANNEL GEOMETRY (SS #8)

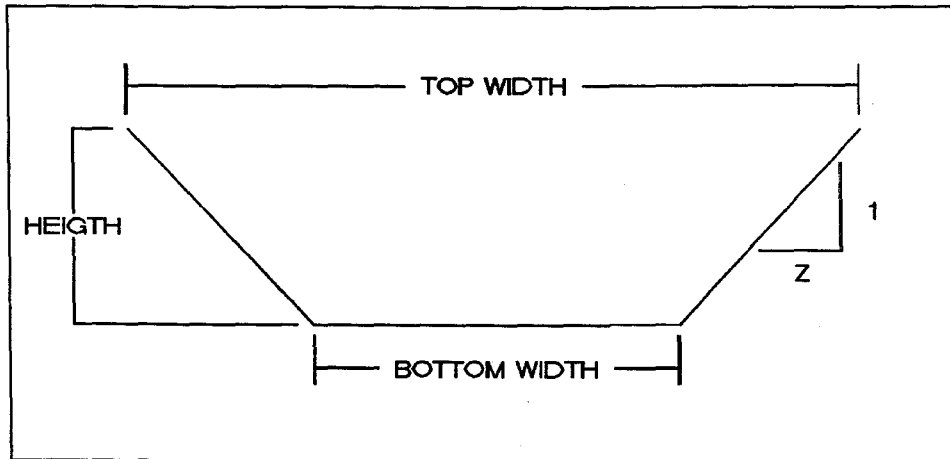

BOTTOM WIDTH =	1 FT
HEIGHT =	1.5 FT
Z =	3.0 FT
SLOPE (S)	0.03 FT/FT
MANNING'S N	0.03 Per VDOT Drainage Main

SOIL TYPE

SANDY LOAM

MAX. PERMISSIBLE VELOCITY = 2.5 FT /SEC

2-YEAR STORM EVENT

TIME OF CONCENTRATION 5 MIN.
RAINFALL INTENSITY = 5.5
RUNOFF COEF. = 0.8
DRAINAGE AREA = 0.45 AC.

PEAK FLOW RATE = 1.98 CFS (Q = CIA)
PEAK VELOCITY = 2.50 CFS (SEE FOLLOWING TABLE) *OK*

* VELOCITY FOR POST DEVELOPMENT 2-YEAR STORM IS
LESS THAN OR EQUAL TO MAXIMUM PERMISSIBLE VELOCITY OF 2.50 CFS,
THEREFORE, CHANNEL IS ADEQUATE.

<u>Incremental</u> <u>Depth</u> (FT)	<u>Area</u> (SQ FT)	<u>WP</u> (FT)	<u>Hydraulic</u> <u>Radius</u> (FT)	<u>Velocity</u> (FT/SEC)	<u>Flow</u> (CFS)
0.00	0.00	1.00	0.00	0.00	0.00
0.10	0.00	1.63	0.00	0.13	0.00
0.20	0.02	2.26	0.01	0.42	0.01
0.30	0.08	2.90	0.03	0.79	0.06
0.40	0.19	3.53	0.05	1.23	0.24
0.50	0.38	4.16	0.09	1.73	0.65
0.60	0.65	4.79	0.14	2.27	1.47
0.63	0.73	4.95	0.15	2.41	1.76
0.64	0.79	5.06	0.16	2.50	1.98
0.65	0.82	5.11	0.16	2.55	2.10
0.70	1.03	5.43	0.19	2.84	2.92
0.80	1.54	6.06	0.25	3.45	5.29
0.90	2.19	6.69	0.33	4.08	8.93
1.00	3.00	7.32	0.41	4.74	14.23

10-YEAR STORM EVENT

TIME OF CONCENTRATION 5 MIN.
RAINFALL INTENSITY = 7.0
RUNOFF COEF. = 0.8
DRAINAGE AREA = 0.45 AC.

PEAK FLOW RATE = 2.52 CFS (Q = CIA)
DEPTH = 0.68 FT (SEE FOLLOWING TABLE) *< 1' OK*

* INCREMENTAL DEPTH FOR POST DEVELOPMENT 10-YEAR
STORM IS LESS THAN THE HEIGHT OF THE CHANNEL,
THEREFORE, CHANNEL IS ADEQUATE.

<u>Incremental</u> <u>Depth</u>	<u>Area</u>	<u>WP</u>	<u>Hydraulic</u> <u>Radius</u>	<u>Velocity</u>	<u>Flow</u>
(FT)	(SQ FT)	(FT)	(FT)	(FT/SEC)	(CFS)
0.00	0.00	1.00	0.00	0.00	0.00
0.10	0.00	1.63	0.00	0.13	0.00
0.20	0.02	2.26	0.01	0.42	0.01
0.30	0.08	2.90	0.03	0.79	0.06
0.40	0.19	3.53	0.05	1.23	0.24
0.50	0.38	4.16	0.09	1.73	0.65
0.60	0.65	4.79	0.14	2.27	1.47
0.65	0.82	5.11	0.16	2.55	2.10
0.67	0.90	5.24	0.17	2.66	2.40
0.68	0.93	5.28	0.18	2.70	2.52
0.70	1.03	5.43	0.19	2.84	2.92
0.80	1.54	6.06	0.25	3.45	5.29
0.90	2.19	6.69	0.33	4.08	8.93
1.00	3.00	7.32	0.41	4.74	14.23


Adequate Channel Analysis

Ironbound Village

July 5, 2001

Project No. 8914-01

CHANNEL GEOMETRY (SS #6A)

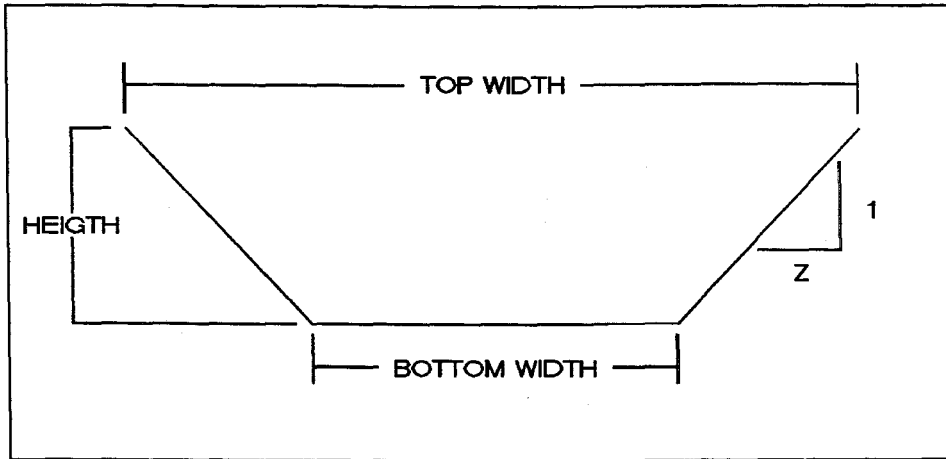

BOTTOM WIDTH =	1 FT
HEIGHT =	1.5 FT
Z =	3.0 FT
SLOPE (S)	0.01 FT/FT
MANNING'S N	0.03 Per VDOT Drainage Main

SOIL TYPE

SANDY LOAM

MAX. PERMISSIBLE VELOCITY = 2.5 FT /SEC

2-YEAR STORM EVENT

TIME OF CONCENTRATION 5 MIN.
RAINFALL INTENSITY = 5.5
RUNOFF COEF. = 0.5
DRAINAGE AREA = 0.63 AC.

PEAK FLOW RATE = 1.73 CFS (Q = CIA)
PEAK VELOCITY = 1.65 CFS (SEE FOLLOWING TABLE) *OK*

* VELOCITY FOR POST DEVELOPMENT 2-YEAR STORM IS
LESS THAN OR EQUAL TO MAXIMUM PERMISSIBLE VELOCITY OF 2.50 CFS,
THEREFORE, CHANNEL IS ADEQUATE.

<u>Incremental</u> <u>Depth</u> (FT)	<u>Area</u> (SQ FT)	<u>WP</u> (FT)	<u>Hydraulic</u> <u>Radius</u> (FT)	<u>Velocity</u> (FT/SEC)	<u>Flow</u> (CFS)
0.00	0.00	1.00	0.00	0.00	0.00
0.10	0.00	1.63	0.00	0.07	0.00
0.20	0.02	2.26	0.01	0.24	0.01
0.30	0.08	2.90	0.03	0.46	0.04
0.40	0.19	3.53	0.05	0.71	0.14
0.50	0.38	4.16	0.09	1.00	0.37
0.60	0.65	4.79	0.14	1.31	0.85
0.70	1.03	5.43	0.19	1.64	1.69
0.70	1.05	5.45	0.19	1.65	1.73
0.71	1.07	5.49	0.20	1.67	1.80
0.75	1.27	5.74	0.22	1.81	2.29
0.80	1.54	6.06	0.25	1.99	3.06
0.90	2.19	6.69	0.33	2.36	5.15
1.00	3.00	7.32	0.41	2.74	8.22

10-YEAR STORM EVENT

TIME OF CONCENTRATION 5 MIN.
RAINFALL INTENSITY = 7.0
RUNOFF COEF. = 0.5
DRAINAGE AREA = 0.63 AC.


PEAK FLOW RATE = 2.21 CFS (Q = CIA)
DEPTH = 0.74 FT (SEE FOLLOWING TABLE) 2' 0"

* INCREMENTAL DEPTH FOR POST DEVELOPMENT 10-YEAR
STORM IS LESS THAN THE HEIGHT OF THE CHANNEL,
THEREFORE, CHANNEL IS ADEQUATE.

<u>Incremental</u> <u>Depth</u>	<u>Area</u>	<u>WP</u>	<u>Hydraulic</u> <u>Radius</u>	<u>Velocity</u>	<u>Flow</u>
(FT)	(SQ FT)	(FT)	(FT)	(FT/SEC)	(CFS)
0.00	0.00	1.00	0.00	0.00	0.00
0.10	0.00	1.63	0.00	0.07	0.00
0.20	0.02	2.26	0.01	0.24	0.01
0.30	0.08	2.90	0.03	0.46	0.04
0.40	0.19	3.53	0.05	0.71	0.14
0.50	0.38	4.16	0.09	1.00	0.37
0.60	0.65	4.79	0.14	1.31	0.85
0.70	1.03	5.43	0.19	1.64	1.69
0.74	1.22	5.68	0.21	1.78	2.16
0.74	1.24	5.71	0.22	1.79	2.21
0.75	1.27	5.74	0.22	1.81	2.29
0.80	1.54	6.06	0.25	1.99	3.06
0.90	2.19	6.69	0.33	2.36	5.15
1.00	3.00	7.32	0.41	2.74	8.22

Adequate Channel Analysis
Ironbound Village
July 5, 2001
Project No. 8914-01

CHANNEL GEOMETRY (SS #12)

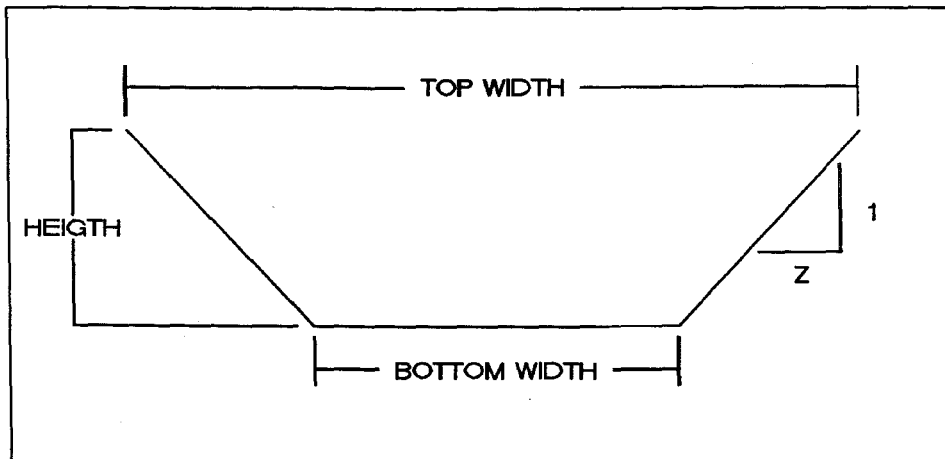

BOTTOM WIDTH =	1 FT
HEIGHT =	1.5 FT
Z =	3.0 FT
SLOPE (S)	0.015 FT/FT
MANNING'S N	0.03 Per VDOT Drainage Main

SOIL TYPE

SANDY LOAM

MAX. PERMISSIBLE VELOCITY = 2.5 FT /SEC

2-YEAR STORM EVENT

TIME OF CONCENTRATION 5 MIN.
RAINFALL INTENSITY = 5.5
RUNOFF COEF. = 0.5
DRAINAGE AREA = 0.45 AC.

PEAK FLOW RATE = 1.24 CFS (Q = CIA)
PEAK VELOCITY = 1.70 CFS (SEE FOLLOWING TABLE) *< 2 OK*

* VELOCITY FOR POST DEVELOPMENT 2-YEAR STORM IS
LESS THAN OR EQUAL TO MAXIMUM PERMISSIBLE VELOCITY OF 2.50 CFS,
THEREFORE, CHANNEL IS ADEQUATE.

<u>Incremental</u> <u>Depth</u> (FT)	<u>Area</u> (SQ FT)	<u>WP</u> (FT)	<u>Hydraulic</u> <u>Radius</u> (FT)	<u>Velocity</u> (FT/SEC)	<u>Flow</u> (CFS)
0.00	0.00	1.00	0.00	0.00	0.00
0.10	0.00	1.63	0.00	0.09	0.00
0.20	0.02	2.26	0.01	0.29	0.01
0.30	0.08	2.90	0.03	0.56	0.05
0.40	0.19	3.53	0.05	0.87	0.17
0.50	0.38	4.16	0.09	1.22	0.46
0.60	0.65	4.79	0.14	1.60	1.04
0.62	0.73	4.95	0.15	1.70	1.24
0.63	0.75	4.98	0.15	1.72	1.29
0.65	0.82	5.11	0.16	1.80	1.48
0.70	1.03	5.43	0.19	2.01	2.07
0.80	1.54	6.06	0.25	2.44	3.74
0.90	2.19	6.69	0.33	2.89	6.31
1.00	3.00	7.32	0.41	3.35	10.06

10-YEAR STORM EVENT

TIME OF CONCENTRATION 5 MIN.
RAINFALL INTENSITY = 7.0
RUNOFF COEF. = 0.5
DRAINAGE AREA = 0.45 AC.

PEAK FLOW RATE = 1.58 CFS (Q = CIA)
DEPTH = 0.66 FT (SEE FOLLOWING TABLE) *< 1' OK*

* INCREMENTAL DEPTH FOR POST DEVELOPMENT 10-YEAR
STORM IS LESS THAN THE HEIGHT OF THE CHANNEL,
THEREFORE, CHANNEL IS ADEQUATE.

<u>Incremental Depth</u> (FT)	<u>Area</u> (SQ FT)	<u>WP</u> (FT)	<u>Hydraulic Radius</u> (FT)	<u>Velocity</u> (FT/SEC)	<u>Flow</u> (CFS)
0.00	0.00	1.00	0.00	0.00	0.00
0.10	0.00	1.63	0.00	0.09	0.00
0.20	0.02	2.26	0.01	0.29	0.01
0.30	0.08	2.90	0.03	0.56	0.05
0.40	0.19	3.53	0.05	0.87	0.17
0.50	0.38	4.16	0.09	1.22	0.46
0.60	0.65	4.79	0.14	1.60	1.04
0.65	0.82	5.11	0.16	1.80	1.48
0.66	0.86	5.17	0.17	1.84	1.58
0.67	0.90	5.24	0.17	1.88	1.70
0.70	1.03	5.43	0.19	2.01	2.07
0.80	1.54	6.06	0.25	2.44	3.74
0.90	2.19	6.69	0.33	2.89	6.31
1.00	3.00	7.32	0.41	3.35	10.06

Hydraflow Storm Sewer Tabulation

Page 1

Station		Len (ft)	Drng Area		Rnoff coeff (C)	Area x C		Tc		Rain (I) (in/hr)	Total flow (cfs)	Cap full (cfs)	Vel (ft/s)	Pipe		Invert Elev		HGL Elev		Grnd / Rim Elev		Line ID
Line	To Line		Incr (ac)	Total (ac)		Incr	Total	Inlet (min)	Syst (min)					Size (in)	Slope (%)	Up (ft)	Dn (ft)	Up (ft)	Dn (ft)	Up (ft)	Dn (ft)	
22	21	43' 50.8'	0.40	0.40	0.40	0.16	0.16	5.0	5.0	7.1	1.14	15.63	2.25	15	6.81 5.88	95.18	92.25	95.61	93.03	98.68	95.00	13 TO 12
21	20	22.0	0.45	0.85	0.50	0.22	0.38	5.0	5.9	6.9	2.65	4.57	3.91	15	0.50	92.00	91.89	92.70	92.55	95.00	98.13	12 TO 11
20	18	138.0	0.00	0.85	0.00	0.00	0.38	5.0	6.1	6.8	2.63	8.04	3.50	15	1.55	91.64	89.50	92.29	90.36	98.13	93.71	11 TO 10
19	18	23.0	0.16	0.16	0.85	0.14	0.14	5.0	5.0	7.1	0.97	13.80	2.00	15	4.57	90.55	89.50	90.94	90.36	94.55	93.71	10A TO 10
18	16	60.0	0.00	1.01	0.00	0.00	0.52	5.0	7.1	6.6	3.43	6.29	3.18	15	0.95	89.25	88.68	90.16	90.05	93.71	92.69	10 TO 9A
17	16	34.0	0.31	0.31	0.50	0.16	0.16	5.0	5.0	7.1	1.10	4.57	0.90	15	0.50	88.85	88.68	90.06	90.05	92.85	92.69	9B TO 9A
16	15	65.0	0.31	1.63	0.75	0.23	0.91	5.0	7.5	6.5	5.91	8.21	5.29	15	1.62	88.43	87.38	89.40	88.67	92.69	92.40	9A TO 9
15	7	102.0	0.33	1.96	0.75	0.25	1.16	5.0	7.7	6.5	7.46	11.48	4.39	18	1.20	87.13	85.91	88.44	87.99	92.40	90.16	9 TO 3
14	13	25.0	0.73	0.73	0.50	0.37	0.37	5.0	5.0	7.1	2.60	20.05	4.07	15	9.64	93.50	91.09	94.15	91.74	95.00	94.84	8 TO 7
13	11	84.0	0.00	0.73	0.00	0.00	0.37	5.0	5.2	7.1	2.58	10.52	3.37	15	2.65	90.84	88.61	91.48	89.53	94.84	92.62	7 TO 6
12	11	110.0	0.63	0.63	0.50	0.31	0.31	5.0	5.0	7.1	2.24	11.34	3.09	15	3.08	92.00	88.61	92.60	89.53	95.00	92.62	6A TO 6
11	9	84.0	0.00	1.36	0.00	0.00	0.68	5.0	6.0	6.9	4.66	12.29	3.77	18	1.37	88.36	87.21	89.18	88.52	92.62	91.76	6 TO 5
10	9	34.0	0.32	0.32	0.50	0.16	0.16	5.0	5.0	7.1	1.14	4.57	0.95	15	0.50	87.38	87.21	88.53	88.52	91.92	91.76	5A TO 5
9	8	71.0	0.68	2.36	0.50	0.34	1.18	5.0	6.5	6.7	7.94	16.11	3.29	24	0.51	86.96	86.60	88.26	88.22	91.76	91.53	5 TO 4
8	7	80.0	0.45	2.81	0.80	0.36	1.54	5.0	7.0	6.6	10.18	21.01	3.35	24	0.86	86.35	85.66	88.13	87.99	91.53	90.16	4 TO 3
7	1	34.0	0.54	5.31	0.55	0.30	2.99	5.0	8.1	6.4	19.05	31.99	7.31	24	2.00	85.41	84.73	86.96	86.28	90.16	90.32	3 TO 2
6	5	355.0	0.19	0.19	0.85	0.16	0.16	5.0	5.0	7.1	1.15	1.92	4.02	8	2.54 4.5%	92.00	83.00	92.51	83.51	95.70 85.00	81.00	1G TO 1F
5	End	90.0	0.00	0.19	0.00	0.00	0.16	5.0	6.8	6.7	1.08	13.53	3.23	12	14.44	83.00	70.00	83.44	70.44	91.00	73.00	1F TO 1E
4	3	160.0	0.19	0.19	0.85	0.16	0.16	5.0	5.0	7.1	1.15	2.42	3.94	8	4.00	94.00	87.60	94.51	88.13	97.00	94.00	1D TO 1C
3	2	190.0	0.00	0.19	0.00	0.00	0.16	5.0	5.8	6.9	1.12	2.42	3.93	8	4.00	87.60	80.00	88.10	80.51	94.00	84.00	1C TO 1B
2	End	95.0	0.00	0.19	0.00	0.00	0.16	5.0	6.8	6.7	1.08	11.55	3.23	12	10.53	80.00	70.00	80.44	70.44	84.00	73.00	1B TO 1A

Less
than
2 FPS

Project File: SSDC.stm

IDF File: JCCstormsewer.IDF

Total number of lines: 22

Run Date: 07-05-2001


NOTES: Intensity = 143.72 / (Inlet time + 19.20) ^ 0.94; Return period = 10 Yrs.; Initial tailwater elevation = 77.00 (ft)

Hydraflow Storm Sewer Tabulation

Page :

Station		Len (ft)	Drng Area		Rnoff coeff (C)	Area x C		Tc		Rain (I) (in/hr)	Total flow (cfs)	Cap full (cfs)	Vel (ft/s)	Pipe		Invert Elev		HGL Elev		Grnd / Rim Elev		Line ID
Line	To Line		Incr (ac)	Total (ac)		Incr	Total	Inlet (min)	Syst (min)					Size (in)	Slope (%)	Up (ft)	Dn (ft)	Up (ft)	Dn (ft)	Up (ft)	Dn (ft)	
1	End	94.0 ✓	0.44	5.75	0.55	0.24	3.24	5.0	8.2	6.3	20.53	31.99	6.53 ✓	24 ✓	2.00 ✓	71.88 ✓	70.00 ✓	77.77 ✓	77.00	90.16 90.32	73.00 ✓	2 TO 1
Project File: SSDC.stm									IDF File: JCCstormsewer.IDF						Total number of lines: 22				Run Date: 07-05-2001			
NOTES: Intensity = 143.72 / (Inlet time + 19.20) ^ 0.94; Return period = 10 Yrs. ; Initial tailwater elevation = 77.00 (ft) ✓																						

Hydraflow Plan View

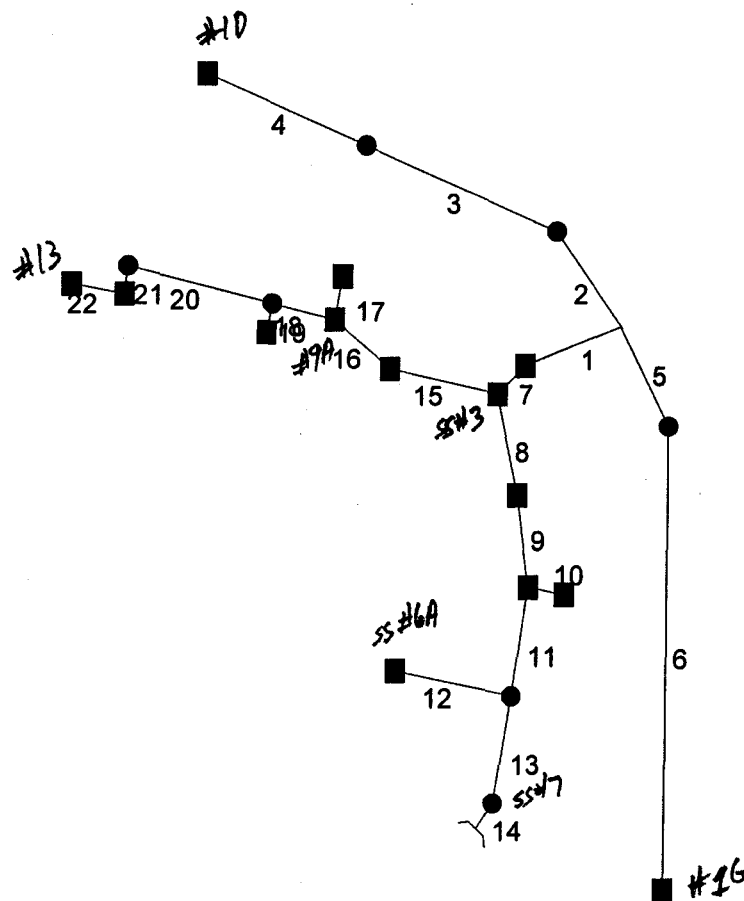

Project file: SSDC.stm

IDF file: JCCstormsewer.IDF

No. Lines: 22

07-03-2001

Hydraflow Inlet Report

Line No	Inlet ID	Q = CIA (cfs)	Q carry (cfs)	Q capt (cfs)	Q byp (cfs)	Junc type	Curb Inlet		Grate Inlet			Gutter							Inlet			Byp line No
							Ht (in)	L (ft)	area (sqft)	L (ft)	W (ft)	So (ft/ft)	W (ft)	Sw (ft/ft)	Sx (ft/ft)	n	depth (ft)	spread (ft)	depth (ft)	spread (ft)	Dep (in)	
22	#13 DI-7	0.64	0.00	0.64	0.00	DrGrt	0.0	0.00	2.12	3.40	3.00	Sag	2.00	0.330	0.330	0.000	0.08	3.48	0.08	3.48	0.0	Off
21	#12 DI-7	0.90	0.00	0.90	0.00	DrGrt	0.0	0.00	2.12	3.40	3.00	Sag	2.00	0.330	0.330	0.000	0.10	3.61	0.10	3.61	0.0	Off
20	#11 MH	0.00	0.00	0.00	0.00	MH	0.0	0.00	0.00	0.00	0.00	0.000	0.00	0.000	0.000	0.013	0.00	0.00	0.00	0.00	0.0	18
19	#10A DI-3A	0.54	0.00	0.29	0.25	Curb	6.0	3.00	0.00	0.00	0.00	0.040	2.00	0.083	0.020	0.013	0.14	1.69	0.16	1.55	2.00	Off
18	#10 MH	0.00	0.00	0.00	0.00	MH	0.0	0.00	0.00	0.00	0.00	0.000	0.00	0.000	0.000	0.013	0.00	0.00	0.00	0.00	0.0	16
17	#9B DI-3B	0.62	0.00	0.46	0.16	Curb	6.0	4.00	0.00	0.00	0.00	0.017	2.00	0.083	0.020	0.013	0.18	2.70	0.19	1.84	2.00	4
16	#9A DI-3B	0.93	0.00	0.61	0.32	Curb	6.0	4.00	0.00	0.00	0.00	0.017	2.00	0.083	0.020	0.013	0.20	3.70	0.22	2.67	2.00	7
15	#9 DI-3B	0.99	0.00	0.62	0.37	Curb	6.0	4.00	0.00	0.00	0.00	0.020	2.00	0.083	0.020	0.013	0.20	3.70	0.22	2.67	2.00	Off
14	#8 ES-1	1.45	0.00	1.45	0.00	Hdwl	0.0	0.00	0.00	0.00	0.00	Sag	0.00	0.000	0.000	0.000	0.00	0.00	0.00	0.00	0.0	13
13	#7 MH	0.00	0.00	0.00	0.00	MH	0.0	0.00	0.00	0.00	0.00	0.000	0.00	0.000	0.000	0.013	0.00	0.00	0.00	0.00	0.0	11
12	#6A DI-7	1.26	0.00	1.26	0.00	DrGrt	0.0	0.00	2.12	3.40	3.00	Sag	2.00	0.330	0.330	0.000	0.13	3.76	0.13	3.76	0.0	Off
11	#6 MH	0.00	0.00	0.00	0.00	MH	0.0	0.00	0.00	0.00	0.00	0.000	0.00	0.000	0.000	0.013	0.00	0.00	0.00	0.00	0.0	9
10	#5A DI-3B	0.64	0.00	0.52	0.12	Curb	6.0	4.00	0.00	0.00	0.00	0.010	2.00	0.083	0.020	0.013	0.20	3.70	0.21	2.17	2.00	1
9	#5 DI-3B	1.35	0.00	1.13	0.22	Curb	6.0	6.00	0.00	0.00	0.00	0.010	2.00	0.083	0.020	0.013	0.25	6.20	0.27	5.17	2.00	7
8	#4 DI-3B	1.43	0.00	1.06	0.38	Curb	6.0	6.00	0.00	0.00	0.00	0.022	2.00	0.083	0.020	0.013	0.22	4.70	0.25	4.17	2.00	Off
7	#3 DI-3C	1.18	0.54	1.72	0.00	Curb	6.0	8.00	0.00	0.00	0.00	Sag	2.00	0.083	0.020	0.000	0.29	7.97	0.33	7.97	2.00	Off
6	#1G DI-7	0.64	0.00	0.64	0.00	DrGrt	0.0	0.00	2.12	3.40	3.00	Sag	2.00	0.050	0.050	0.000	0.08	6.21	0.08	6.21	0.0	5
5	#1F MH	0.00	0.00	0.00	0.00	MH	0.0	0.00	0.00	0.00	0.00	0.000	0.00	0.000	0.000	0.013	0.00	0.00	0.00	0.00	0.0	Off
4	#1D DI-7	0.64	0.16	0.80	0.00	DrGrt	0.0	0.00	2.12	3.40	3.00	Sag	2.00	0.050	0.050	0.000	0.09	6.71	0.09	6.71	0.0	3
3	#1C MH	0.00	0.00	0.00	0.00	MH	0.0	0.00	0.00	0.00	0.00	0.000	0.00	0.000	0.000	0.013	0.00	0.00	0.00	0.00	0.0	2
2	#1B MH	0.00	0.00	0.00	0.00	MH	0.0	0.00	0.00	0.00	0.00	0.000	0.00	0.000	0.000	0.013	0.00	0.00	0.00	0.00	0.0	Off
1	#2 DI-3CC	0.96	0.12	1.08	0.00	Curb	6.0	8.00	0.00	0.00	0.00	Sag	2.00	0.083	0.020	0.000	0.24	5.84	0.28	5.84	2.00	Off

Project File: SSDC.stm

I-D-F File: VDOT_4IN-HR_STM.IDF

Total number of lines: 22

Run Date: 07-05-2001

NOTES: Inlet N-Values = 0.013 ; Intensity = 3.96 / (Inlet time + 0.10) ^ 0.00; Return period = 1 Yrs. ; * Indicates Known Q added

IRONBOUND VILLAGE

IRONBOUND ROAD

PHASES 1 AND 2

DECEMBER 2001

LMDG FILE NO. 2001112-000.07

SUPPORTING ENGINEERING DOCUMENTS

- DRAINAGE CALCULATIONS
 - SUMMARY OF DATA
 - LMDG ROUTING CALCULATIONS
 - AES CALCULATIONS

**FINAL COMPS
BMP DESIGN**

(Return to Scott)

**LANDMARK
DESIGN GROUP**

Engineers ♦ Planners ♦ Surveyors ♦ Landscape Architects ♦ Environmental Consultants
4029 Ironbound Road, Suite 100, Williamsburg, VA 23188 (757) 253-2975 FAX: (757) 229-0049 lmdg@landmarkdgwb.com

SUMMARY OF DATA

<u>Storm Event</u>	<u>AES Results</u>	<u>LMDG Results</u>
2-year pre-developed	6.31	6.31
2-year post-developed	8.96	16.82
2-year routed outflow	3.14	7.28
2-year rise elevation	77.13	77.31
10-year pre-developed	8.43	8.43
10-year post-developed	11.72	22.46
10-year routed outflow	9.60	11.71
10-year rise elevation	77.45	77.44
25-year pre-developed	9.52	9.52
25-year post-developed	13.06	25.37
25-year routed outflow	11.23	13.99
25-year rise elevation	77.57	77.69
100-year pre-developed	11.22	11.22
100-year post-developed	15.19	29.91
100-year routed outflow	13.21	14.30
100-year rise elevation	77.80	78.06

LMDG ROUTING CALCULATIONS

File: Universal Pre.xls
PROJECT: IRONBOUND VILLAGE
 Description: Pre-development to BMP
 Date: 19-Dec-01
 Revised

LandMark Deisgn Group
 4029 Ironbound Road, Suite 100
 Williamsburg, VA 23188

UNIVERSAL RATIONAL METHOD FOR HYDROGRAPH GENERATION

Drainage Area = 4.74 Acres
 Runoff Coefficient = 0.30
 Time of Concentration = 10.20 Min

2 Yr computed peak discharge = 6.31 cfs
 10 Yr computed peak discharge = 8.43 cfs
 25 Yr computed peak discharge = 9.52 cfs
 100 Yr computed peak discharge = 11.22 cfs

COMPUTED HYDROGRAPH VERTEX POINTS

2 Yr Frequency		10 Yr Frequency		25 Yr Frequency		100 Yr Frequency	
Time (min)	Q (cfs)	Time (min)	Q (cfs)	Time (min)	Q (cfs)	Time (min)	Q (cfs)
0.0	0.00	0.0	0.00	0.0	0.00	0.0	0.00
10.2	1.33	10.2	1.77	10.2	2.00	10.2	2.36
20.4	1.89	20.4	2.53	20.4	2.86	20.4	3.37
30.6	6.31	30.6	8.43	30.6	9.52	30.6	11.22
40.8	3.41	40.8	4.55	40.8	5.14	40.8	6.06
51.0	2.46	51.0	3.29	51.0	3.71	51.0	4.38
61.2	1.58	61.2	2.11	61.2	2.38	61.2	2.81
71.4	1.14	71.4	1.52	71.4	1.71	71.4	2.02
81.6	0.95	81.6	1.26	81.6	1.43	81.6	1.68
91.8	0.88	91.8	1.18	91.8	1.33	91.8	1.57
102.0	0.82	102.0	1.10	102.0	1.24	102.0	1.46
112.2	0.00	112.2	0.00	112.2	0.00	112.2	0.00

EQUATIONS

$$I=B/(tc+D)^E$$

$$tp=3*tc$$

$$tb=11*tc$$

$$Qp=C*I^A$$

B,D,E constants based on NWS Hydro 35

File: Universal Post.xls
PROJECT: IRONBOUND VILLAGE
Description: **Postdevelopment to BMP**

LandMark Design Group
4029 Ironbound Road, Suite 100
Williamsburg, VA 23188

Date: 19-Dec-01
Revised:

UNIVERSAL RATIONAL METHOD FOR HYDROGRAPH GENERATION

Drainage Area = 6.89 Acres
Runoff Coefficient = 0.55
Time of Concentration = 10.20 Min

2 Yr computed peak discharge = 16.82 cfs
10 Yr computed peak discharge = 22.46 cfs
25 Yr computed peak discharge = 25.37 cfs
100 Yr computed peak discharge = 29.91 cfs

COMPUTED HYDROGRAPH VERTEX POINTS

2 Yr Frequency		10 Yr Frequency		25 Yr Frequency		100 Yr Frequency	
Time (min)	Q (cfs)	Time (min)	Q (cfs)	Time (min)	Q (cfs)	Time (min)	Q (cfs)
0.0	0.00	0.0	0.00	0.0	0.00	0.0	0.00
10.2	3.53	10.2	4.72	10.2	5.33	10.2	6.28
20.4	5.05	20.4	6.74	20.4	7.61	20.4	8.97
30.6	16.82	30.6	22.46	30.6	25.37	30.6	29.91
40.8	9.08	40.8	12.13	40.8	13.70	40.8	16.15
51.0	6.56	51.0	8.76	51.0	9.89	51.0	11.67
61.2	4.20	61.2	5.62	61.2	6.34	61.2	7.48
71.4	3.03	71.4	4.04	71.4	4.57	71.4	5.38
81.6	2.52	81.6	3.37	81.6	3.81	81.6	4.49
91.8	2.35	91.8	3.14	91.8	3.55	91.8	4.19
102.0	2.19	102.0	2.92	102.0	3.30	102.0	3.89
112.2	0.00	112.2	0.00	112.2	0.00	112.2	0.00

EQUATIONS

$$I=B/(tc+D)^E$$

$$tp=3*tc$$

$$tb=11*tc$$

$$Qp=C*I*A$$

B,D,E constants based on NWS Hydro 35

Hydrograph Summary Report

Page 1

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to peak (min)	Volume (cuft)	Return period (yrs)	Inflow hyd(s)	Maximum elevation (ft)	Maximum storage (cuft)	Hydrograph description
1	Manual	16.82	10	30	33,198	2	---	---	---	2-Year Post-Develo
2	Manual	22.46	10	30	44,340	10	---	---	---	10-Year Post-Devel
3	Manual	25.37	10	30	50,142	25	---	---	---	25-Year Post-Devel
4	Manual	29.91	10	30	59,046	100	---	---	---	100-Year Post-Deve
5	Manual	6.31	10	30	12,462	2	---	---	---	2-Year Pre-Develop
6	Manual	8.43	10	30	16,644	10	---	---	---	10-Year Pre-Develo
7	Manual	9.52	10	30	18,792	25	---	---	---	25-Year Pre-Develo
8	Manual	11.22	10	30	22,158	100	---	---	---	100-Year Pre-Devel
10	Reservoir	7.28	10	50	33,198	2	1	77.31	18,759	Pond 1 - 2-Year St
11	Reservoir	11.71	10	40	44,340	10	2	77.44	19,971	Pond 1 - 10-year s
12	Reservoir	13.99	10	40	50,142	25	3	77.69	22,356	Pond 1 - 25-Year S
13	Reservoir	14.30	10	40	59,046	100	4	78.06	25,840	Pond 1- 100-Year S
Proj. file: ironboundpond.GPW			IDF file: Norfolk.IDF					Run date: 12-19-2001		

Hydrograph Report

Page 1

English

Hyd. No. 1

2-Year Post-Developed

Hydrograph type = Manual

Storm frequency = 2 yrs

Peak discharge = 16.82 cfs

Time interval = 10 min

Total Volume = 33,198 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	3.53
0.33	5.05
0.50	16.82 <<
0.67	9.08
0.83	6.56
1.00	4.20
1.17	3.03
1.33	2.52
1.50	2.35
1.67	2.19

...End

Hydrograph Report

Page 1

English

Hyd. No. 2

10-Year Post-Developed

Hydrograph type = Manual

Storm frequency = 10 yrs

Peak discharge = 22.46 cfs

Time interval = 10 min

Total Volume = 44,340 cuft

Hydrograph Discharge Table

Time -- Outflow

(hrs	cfs)
0.17	4.72
0.33	6.74
0.50	22.46 <<
0.67	12.13
0.83	8.76
1.00	5.62
1.17	4.04
1.33	3.37
1.50	3.14
1.67	2.92

...End

Hydrograph Report

Page 1

English

Hyd. No. 3

25-Year Post-Developed

Hydrograph type = Manual

Storm frequency = 25 yrs

Peak discharge = 25.37 cfs

Time interval = 10 min

Total Volume = 50,142 cuft

Hydrograph Discharge Table

Time -- Outflow

(hrs cfs)

0.17	5.33
0.33	7.61
0.50	25.37 <<
0.67	13.70
0.83	9.89
1.00	6.34
1.17	4.57
1.33	3.91
1.50	3.55
1.67	3.30

...End

Hydrograph Report

Page 1

English

Hyd. No. 4

100-Year Post-Developed

Hydrograph type = Manual

Storm frequency = 100 yrs

Peak discharge = 29.91 cfs

Time interval = 10 min

Total Volume = 59,046 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	6.28
0.33	8.97
0.50	29.91 <<
0.67	16.15
0.83	11.67
1.00	7.48
1.17	5.38
1.33	4.49
1.50	4.19
1.67	3.89

...End

Hydrograph Report

Page 1

English

Hyd. No. 5

2-Year Pre-Developed

Hydrograph type = Manual
Storm frequency = 2 yrs

Peak discharge = 6.31 cfs
Time interval = 10 min

Total Volume = 12,462 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	1.33
0.33	1.89
0.50	6.31 <<
0.67	3.41
0.83	2.46
1.00	1.58
1.17	1.14
1.33	0.95
1.50	0.88
1.67	0.82

...End

Hydrograph Report

Page 1

English

Hyd. No. 6

10-Year Pre-Developed

Hydrograph type = Manual
Storm frequency = 10 yrs

Peak discharge = 8.43 cfs
Time interval = 10 min

Total Volume = 16,644 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	1.77
0.33	2.53
0.50	8.43 <<
0.67	4.55
0.83	3.29
1.00	2.11
1.17	1.52
1.33	1.26
1.50	1.18
1.67	1.10

...End

Hydrograph Report

Page 1

English

Hyd. No. 7

25-Year Pre-Developed

Hydrograph type = Manual
Storm frequency = 25 yrs

Peak discharge = 9.52 cfs
Time interval = 10 min

Total Volume = 18,792 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	2.00
0.33	2.86
0.50	9.52 <<
0.67	5.14
0.83	3.71
1.00	2.38
1.17	1.71
1.33	1.43
1.50	1.33
1.67	1.24

...End

Hydrograph Report

Page 1

English

Hyd. No. 8

100-Year Pre-Developed

Hydrograph type = Manual

Storm frequency = 100 yrs

Peak discharge = 11.22 cfs

Time interval = 10 min

Total Volume = 22,158 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	2.36
0.33	3.37
0.50	11.22 <<
0.67	6.06
0.83	4.38
1.00	2.81
1.17	2.02
1.33	1.68
1.50	1.57
1.67	1.46

...End

Hydrograph Report

Page 1

English

Hyd. No. 10

Pond 1 - 2-Year Storm

Hydrograph type = Reservoir
Storm frequency = 2 yrs
Inflow hyd. No. = 1
Max. Elevation = 77.31 ft

Peak discharge = 7.28 cfs
Time interval = 10 min
Reservoir name = BMP
Max. Storage = 18,759 cuft

Storage Indication method used.

Total Volume = 33,198 cuft

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
0.33	5.05	75.48	11.91	0.22	----	----	----	----	----	----	0.22
0.50	16.82 <<	76.30	12.72	0.45	----	----	----	----	----	----	0.45
0.67	9.08	77.12	13.48	0.59	----	----	1.58	----	----	----	2.17
0.83	6.56	77.31 <<	13.65	0.62	----	----	6.67	----	----	----	7.28 <<
1.00	4.20	77.25	13.60	0.61	----	----	4.83	----	----	----	5.44
1.17	3.03	77.19	13.54	0.60	----	----	3.15	----	----	----	3.75
1.33	2.52	77.15	13.51	0.59	----	----	2.36	----	----	----	2.95
1.50	2.35	77.13	13.49	0.59	----	----	1.94	----	----	----	2.53
1.67	2.19	77.12	13.48	0.59	----	----	1.73	----	----	----	2.32
1.83	0.00	77.07	13.44	0.58	----	----	0.88	----	----	----	1.46
2.00	0.00	77.01	13.38	0.57	----	----	0.08	----	----	----	0.65
2.17	0.00	76.96	13.34	0.56	----	----	----	----	----	----	0.56
2.33	0.00	76.92	13.30	0.56	----	----	----	----	----	----	0.56
2.50	0.00	76.88	13.27	0.55	----	----	----	----	----	----	0.55
2.67	0.00	76.85	13.23	0.54	----	----	----	----	----	----	0.54
2.83	0.00	76.81	13.19	0.54	----	----	----	----	----	----	0.54
3.00	0.00	76.77	13.16	0.53	----	----	----	----	----	----	0.53
3.17	0.00	76.73	13.12	0.53	----	----	----	----	----	----	0.53
3.33	0.00	76.69	13.09	0.52	----	----	----	----	----	----	0.52
3.50	0.00	76.66	13.06	0.51	----	----	----	----	----	----	0.51
3.67	0.00	76.62	13.02	0.51	----	----	----	----	----	----	0.51
3.83	0.00	76.58	12.99	0.50	----	----	----	----	----	----	0.50
4.00	0.00	76.55	12.96	0.49	----	----	----	----	----	----	0.49
4.17	0.00	76.51	12.92	0.49	----	----	----	----	----	----	0.49
4.33	0.00	76.48	12.89	0.48	----	----	----	----	----	----	0.48
4.50	0.00	76.45	12.86	0.47	----	----	----	----	----	----	0.47
4.67	0.00	76.41	12.83	0.47	----	----	----	----	----	----	0.47
4.83	0.00	76.38	12.79	0.46	----	----	----	----	----	----	0.46
5.00	0.00	76.35	12.76	0.46	----	----	----	----	----	----	0.46
5.17	0.00	76.31	12.73	0.45	----	----	----	----	----	----	0.45
5.33	0.00	76.28	12.70	0.44	----	----	----	----	----	----	0.44
5.50	0.00	76.25	12.67	0.44	----	----	----	----	----	----	0.44
5.67	0.00	76.22	12.64	0.43	----	----	----	----	----	----	0.43
5.83	0.00	76.19	12.61	0.42	----	----	----	----	----	----	0.42
6.00	0.00	76.16	12.58	0.42	----	----	----	----	----	----	0.42
6.17	0.00	76.13	12.56	0.41	----	----	----	----	----	----	0.41

Continues on next page...

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
6.33	0.00	76.10	12.53	0.41	----	----	----	----	----	----	0.41
6.50	0.00	76.07	12.50	0.40	----	----	----	----	----	----	0.40
6.67	0.00	76.04	12.47	0.39	----	----	----	----	----	----	0.39
6.83	0.00	76.01	12.44	0.39	----	----	----	----	----	----	0.39
7.00	0.00	75.98	12.42	0.38	----	----	----	----	----	----	0.38
7.17	0.00	75.95	12.39	0.37	----	----	----	----	----	----	0.37
7.33	0.00	75.92	12.36	0.37	----	----	----	----	----	----	0.37
7.50	0.00	75.89	12.33	0.36	----	----	----	----	----	----	0.36
7.67	0.00	75.87	12.30	0.35	----	----	----	----	----	----	0.35
7.83	0.00	75.84	12.27	0.34	----	----	----	----	----	----	0.34
8.00	0.00	75.81	12.24	0.34	----	----	----	----	----	----	0.34
8.17	0.00	75.78	12.22	0.33	----	----	----	----	----	----	0.33
8.33	0.00	75.76	12.19	0.32	----	----	----	----	----	----	0.32
8.50	0.00	75.73	12.17	0.32	----	----	----	----	----	----	0.32
8.67	0.00	75.71	12.14	0.31	----	----	----	----	----	----	0.31
8.83	0.00	75.68	12.12	0.30	----	----	----	----	----	----	0.30
9.00	0.00	75.66	12.09	0.29	----	----	----	----	----	----	0.29
9.17	0.00	75.63	12.07	0.29	----	----	----	----	----	----	0.29
9.33	0.00	75.61	12.04	0.28	----	----	----	----	----	----	0.28
9.50	0.00	75.59	12.02	0.27	----	----	----	----	----	----	0.27
9.67	0.00	75.57	12.00	0.26	----	----	----	----	----	----	0.26
9.83	0.00	75.55	11.98	0.25	----	----	----	----	----	----	0.25
10.00	0.00	75.53	11.96	0.24	----	----	----	----	----	----	0.24
10.17	0.00	75.51	11.94	0.23	----	----	----	----	----	----	0.23
10.33	0.00	75.49	11.92	0.22	----	----	----	----	----	----	0.22
10.50	0.00	75.47	11.90	0.21	----	----	----	----	----	----	0.21
10.67	0.00	75.45	11.89	0.19	----	----	----	----	----	----	0.19
10.83	0.00	75.44	11.87	0.18	----	----	----	----	----	----	0.18
11.00	0.00	75.42	11.86	0.17	----	----	----	----	----	----	0.17
11.17	0.00	75.41	11.84	0.16	----	----	----	----	----	----	0.16
11.33	0.00	75.40	11.83	0.15	----	----	----	----	----	----	0.15
11.50	0.00	75.39	11.82	0.14	----	----	----	----	----	----	0.14
11.67	0.00	75.38	11.81	0.13	----	----	----	----	----	----	0.13
11.83	0.00	75.37	11.80	0.12	----	----	----	----	----	----	0.12
12.00	0.00	75.36	11.79	0.11	----	----	----	----	----	----	0.11
12.17	0.00	75.35	11.78	0.10	----	----	----	----	----	----	0.10
12.33	0.00	75.34	11.77	0.09	----	----	----	----	----	----	0.09
12.50	0.00	75.33	11.76	0.09	----	----	----	----	----	----	0.09
12.67	0.00	75.33	11.76	0.08	----	----	----	----	----	----	0.08

...End

Reservoir Report

Page 1

English

Reservoir No. 1 - BMP

Pond Data

Pond storage is based on known contour areas

Stage / Storage Table

Stage ft	Elevation ft	Contour area sqft	Incr. Storage cuft	Total storage cuft
0.00	75.00	6,918	0	0
1.00	76.00	7,865	7,392	7,392
2.00	77.00	8,926	8,396	15,787
3.00	78.00	9,986	9,456	25,243
3.50	78.50	10,684	5,168	30,411
5.00	80.00	12,776	17,595	48,006

Culvert / Orifice Structures

	[A]	[B]	[C]	[D]
Rise in	= 15.0	4.0	0.0	0.0
Span in	= 15.0	4.0	0.0	0.0
No. Barrels	= 1	1	0	0
Invert El. ft	= 69.00	75.00	0.00	0.00
Length ft	= 100.0	1.0	0.0	0.0
Slope %	= 1.00	1.00	0.00	0.00
N-Value	= .013	.013	.000	.000
Orif. Coeff.	= 0.50	0.60	0.00	0.00
Multi-Stage	= -----	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len ft	= 12.56	8.00	0.00	0.00
Crest El. ft	= 77.00	78.50	0.00	0.00
Weir Coeff.	= 3.00	3.00	0.00	0.00
Eqn. Exp.	= 1.50	1.50	0.00	0.00
Multi-Stage	= Yes	Yes	No	No

Tailwater Elevation = 0.00 ft

Note: All outflows have been analyzed under inlet and outlet control.

Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Discharge cfs
0.00	0	75.00	11.41	0.00	---	---	0.00	0.00	---	---	0.00
1.00	7,392	76.00	12.43	0.38	---	---	0.00	0.00	---	---	0.38
2.00	15,787	77.00	13.37	0.57	---	---	0.00	0.00	---	---	0.57
3.00	25,243	78.00	14.25	0.00	---	---	37.68	0.00	---	---	14.25
3.50	30,411	78.50	14.67	0.00	---	---	69.22	0.00	---	---	14.67
5.00	48,006	80.00	15.86	0.00	---	---	195.79	44.09	---	---	15.86

Hydrograph Report

Page 1

English

Hyd. No. 11

Pond 1 - 10-year storm

Hydrograph type = Reservoir
Storm frequency = 10 yrs
Inflow hyd. No. = 2
Max. Elevation = 77.44 ft

Peak discharge = 11.71 cfs
Time interval = 10 min
Reservoir name = BMP
Max. Storage = 19,971 cuft

Storage Indication method used.

Total Volume = 44,340 cuft

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
0.33	6.74	75.64	12.08	0.29	----	----	----	----	----	----	0.29
0.50	22.46 <<	76.70	13.10	0.52	----	----	----	----	----	----	0.52
0.67	12.13	77.44 <<	13.77	0.63	----	----	11.14	----	----	----	11.71 <<
0.83	8.76	77.41	13.73	0.63	----	----	9.73	----	----	----	10.35
1.00	5.62	77.31	13.65	0.61	----	----	6.47	----	----	----	7.08
1.17	4.04	77.23	13.58	0.60	----	----	4.32	----	----	----	4.93
1.33	3.37	77.19	13.54	0.60	----	----	3.20	----	----	----	3.80
1.50	3.14	77.17	13.53	0.59	----	----	2.76	----	----	----	3.35
1.67	2.92	77.16	13.51	0.59	----	----	2.49	----	----	----	3.09
1.83	0.00	77.10	13.46	0.58	----	----	1.18	----	----	----	1.76
2.00	0.00	77.02	13.39	0.57	----	----	0.21	----	----	----	0.79
2.17	0.00	76.97	13.35	0.56	----	----	----	----	----	----	0.56
2.33	0.00	76.93	13.31	0.56	----	----	----	----	----	----	0.56
2.50	0.00	76.89	13.27	0.55	----	----	----	----	----	----	0.55
2.67	0.00	76.85	13.24	0.55	----	----	----	----	----	----	0.55
2.83	0.00	76.81	13.20	0.54	----	----	----	----	----	----	0.54
3.00	0.00	76.78	13.17	0.53	----	----	----	----	----	----	0.53
3.17	0.00	76.74	13.13	0.53	----	----	----	----	----	----	0.53
3.33	0.00	76.70	13.10	0.52	----	----	----	----	----	----	0.52
3.50	0.00	76.66	13.06	0.51	----	----	----	----	----	----	0.51
3.67	0.00	76.63	13.03	0.51	----	----	----	----	----	----	0.51
3.83	0.00	76.59	12.99	0.50	----	----	----	----	----	----	0.50
4.00	0.00	76.56	12.96	0.50	----	----	----	----	----	----	0.50
4.17	0.00	76.52	12.93	0.49	----	----	----	----	----	----	0.49
4.33	0.00	76.49	12.90	0.48	----	----	----	----	----	----	0.48
4.50	0.00	76.45	12.86	0.48	----	----	----	----	----	----	0.48
4.67	0.00	76.42	12.83	0.47	----	----	----	----	----	----	0.47
4.83	0.00	76.38	12.80	0.46	----	----	----	----	----	----	0.46
5.00	0.00	76.35	12.77	0.46	----	----	----	----	----	----	0.46
5.17	0.00	76.32	12.74	0.45	----	----	----	----	----	----	0.45
5.33	0.00	76.29	12.71	0.44	----	----	----	----	----	----	0.44
5.50	0.00	76.26	12.68	0.44	----	----	----	----	----	----	0.44
5.67	0.00	76.22	12.65	0.43	----	----	----	----	----	----	0.43
5.83	0.00	76.19	12.62	0.43	----	----	----	----	----	----	0.43
6.00	0.00	76.16	12.59	0.42	----	----	----	----	----	----	0.42
6.17	0.00	76.13	12.56	0.41	----	----	----	----	----	----	0.41

Continues on next page...

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
6.33	0.00	76.10	12.53	0.41	----	----	----	----	----	----	0.41
6.50	0.00	76.08	12.50	0.40	----	----	----	----	----	----	0.40
6.67	0.00	76.05	12.48	0.39	----	----	----	----	----	----	0.39
6.83	0.00	76.02	12.45	0.39	----	----	----	----	----	----	0.39
7.00	0.00	75.99	12.42	0.38	----	----	----	----	----	----	0.38
7.17	0.00	75.96	12.39	0.37	----	----	----	----	----	----	0.37
7.33	0.00	75.93	12.36	0.37	----	----	----	----	----	----	0.37
7.50	0.00	75.90	12.33	0.36	----	----	----	----	----	----	0.36
7.67	0.00	75.87	12.30	0.35	----	----	----	----	----	----	0.35
7.83	0.00	75.84	12.28	0.35	----	----	----	----	----	----	0.35
8.00	0.00	75.82	12.25	0.34	----	----	----	----	----	----	0.34
8.17	0.00	75.79	12.22	0.33	----	----	----	----	----	----	0.33
8.33	0.00	75.76	12.20	0.32	----	----	----	----	----	----	0.32
8.50	0.00	75.74	12.17	0.32	----	----	----	----	----	----	0.32
8.67	0.00	75.71	12.15	0.31	----	----	----	----	----	----	0.31
8.83	0.00	75.69	12.12	0.30	----	----	----	----	----	----	0.30
9.00	0.00	75.66	12.10	0.30	----	----	----	----	----	----	0.30
9.17	0.00	75.64	12.07	0.29	----	----	----	----	----	----	0.29
9.33	0.00	75.61	12.05	0.28	----	----	----	----	----	----	0.28
9.50	0.00	75.59	12.03	0.27	----	----	----	----	----	----	0.27
9.67	0.00	75.57	12.00	0.26	----	----	----	----	----	----	0.26
9.83	0.00	75.55	11.98	0.25	----	----	----	----	----	----	0.25
10.00	0.00	75.53	11.96	0.24	----	----	----	----	----	----	0.24
10.17	0.00	75.51	11.94	0.23	----	----	----	----	----	----	0.23
10.33	0.00	75.49	11.92	0.22	----	----	----	----	----	----	0.22
10.50	0.00	75.47	11.91	0.21	----	----	----	----	----	----	0.21
10.67	0.00	75.46	11.89	0.20	----	----	----	----	----	----	0.20
10.83	0.00	75.44	11.87	0.18	----	----	----	----	----	----	0.18
11.00	0.00	75.43	11.86	0.17	----	----	----	----	----	----	0.17
11.17	0.00	75.41	11.85	0.16	----	----	----	----	----	----	0.16
11.33	0.00	75.40	11.83	0.15	----	----	----	----	----	----	0.15
11.50	0.00	75.39	11.82	0.14	----	----	----	----	----	----	0.14
11.67	0.00	75.38	11.81	0.13	----	----	----	----	----	----	0.13
11.83	0.00	75.37	11.80	0.12	----	----	----	----	----	----	0.12

...End

Reservoir Report

Page 1

Reservoir No. 1 - BMP

English

Pond Data

Pond storage is based on known contour areas

Stage / Storage Table

Stage ft	Elevation ft	Contour area sqft	Incr. Storage cuft	Total storage cuft
0.00	75.00	6,918	0	0
1.00	76.00	7,865	7,392	7,392
2.00	77.00	8,926	8,396	15,787
3.00	78.00	9,986	9,456	25,243
3.50	78.50	10,684	5,168	30,411
5.00	80.00	12,776	17,595	48,006

Culvert / Orifice Structures

Weir Structures

	[A]	[B]	[C]	[D]
Rise in	= 15.0	4.0	0.0	0.0
Span in	= 15.0	4.0	0.0	0.0
No. Barrels	= 1	1	0	0
Invert El. ft	= 69.00	75.00	0.00	0.00
Length ft	= 100.0	1.0	0.0	0.0
Slope %	= 1.00	1.00	0.00	0.00
N-Value	= .013	.013	.000	.000
Orif. Coeff.	= 0.50	0.60	0.00	0.00
Multi-Stage	= ----	Yes	No	No

	[A]	[B]	[C]	[D]
Crest Len ft	= 12.56	8.00	0.00	0.00
Crest El. ft	= 77.00	78.50	0.00	0.00
Weir Coeff.	= 3.00	3.00	0.00	0.00
Eqn. Exp.	= 1.50	1.50	0.00	0.00
Multi-Stage	= Yes	Yes	No	No

Tailwater Elevation = 0.00 ft

Note: All outflows have been analyzed under inlet and outlet control.

Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Discharge cfs
0.00	0	75.00	11.41	0.00	---	---	0.00	0.00	---	---	0.00
1.00	7,392	76.00	12.43	0.38	---	---	0.00	0.00	---	---	0.38
2.00	15,787	77.00	13.37	0.57	---	---	0.00	0.00	---	---	0.57
3.00	25,243	78.00	14.25	0.00	---	---	37.68	0.00	---	---	14.25
3.50	30,411	78.50	14.67	0.00	---	---	69.22	0.00	---	---	14.67
5.00	48,006	80.00	15.86	0.00	---	---	195.79	44.09	---	---	15.86

Hydrograph Report

Page 1

English

Hyd. No. 12

Pond 1 - 25-Year Storm

Hydrograph type = Reservoir
Storm frequency = 25 yrs
Inflow hyd. No. = 3
Max. Elevation = 77.69 ft

Peak discharge = 13.99 cfs
Time interval = 10 min
Reservoir name = BMP
Max. Storage = 22,356 cuft

Storage Indication method used.

Total Volume = 50,142 cuft

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
0.33	7.61	75.73	12.16	0.31	----	----	----	----	----	----	0.31
0.50	25.37 <<	76.91	13.29	0.55	----	----	----	----	----	----	0.55
0.67	13.70	77.69 <<	13.99	----	----	----	21.83	----	----	----	13.99 <<
0.83	9.89	77.56	13.87	0.26	----	----	15.81	----	----	----	13.87
1.00	6.34	77.36	13.69	0.62	----	----	8.11	----	----	----	8.73
1.17	4.57	77.25	13.60	0.61	----	----	4.86	----	----	----	5.47
1.33	3.91	77.21	13.56	0.60	----	----	3.70	----	----	----	4.31
1.50	3.55	77.19	13.54	0.60	----	----	3.19	----	----	----	3.79
1.67	3.30	77.18	13.53	0.60	----	----	2.89	----	----	----	3.49
1.83	0.00	77.11	13.47	0.59	----	----	1.39	----	----	----	1.98
2.00	0.00	77.02	13.39	0.57	----	----	0.25	----	----	----	0.82
2.17	0.00	76.97	13.35	0.56	----	----	----	----	----	----	0.56
2.33	0.00	76.93	13.31	0.56	----	----	----	----	----	----	0.56
2.50	0.00	76.89	13.27	0.55	----	----	----	----	----	----	0.55
2.67	0.00	76.85	13.24	0.55	----	----	----	----	----	----	0.55
2.83	0.00	76.82	13.20	0.54	----	----	----	----	----	----	0.54
3.00	0.00	76.78	13.17	0.53	----	----	----	----	----	----	0.53
3.17	0.00	76.74	13.13	0.53	----	----	----	----	----	----	0.53
3.33	0.00	76.70	13.10	0.52	----	----	----	----	----	----	0.52
3.50	0.00	76.67	13.06	0.51	----	----	----	----	----	----	0.51
3.67	0.00	76.63	13.03	0.51	----	----	----	----	----	----	0.51
3.83	0.00	76.59	13.00	0.50	----	----	----	----	----	----	0.50
4.00	0.00	76.56	12.96	0.50	----	----	----	----	----	----	0.50
4.17	0.00	76.52	12.93	0.49	----	----	----	----	----	----	0.49
4.33	0.00	76.49	12.90	0.48	----	----	----	----	----	----	0.48
4.50	0.00	76.45	12.87	0.48	----	----	----	----	----	----	0.48
4.67	0.00	76.42	12.83	0.47	----	----	----	----	----	----	0.47
4.83	0.00	76.39	12.80	0.46	----	----	----	----	----	----	0.46
5.00	0.00	76.35	12.77	0.46	----	----	----	----	----	----	0.46
5.17	0.00	76.32	12.74	0.45	----	----	----	----	----	----	0.45
5.33	0.00	76.29	12.71	0.44	----	----	----	----	----	----	0.44
5.50	0.00	76.26	12.68	0.44	----	----	----	----	----	----	0.44
5.67	0.00	76.23	12.65	0.43	----	----	----	----	----	----	0.43
5.83	0.00	76.19	12.62	0.43	----	----	----	----	----	----	0.43
6.00	0.00	76.16	12.59	0.42	----	----	----	----	----	----	0.42
6.17	0.00	76.13	12.56	0.41	----	----	----	----	----	----	0.41

Continues on next page...

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
6.33	0.00	76.11	12.53	0.41	----	----	----	----	----	----	0.41
6.50	0.00	76.08	12.51	0.40	----	----	----	----	----	----	0.40
6.67	0.00	76.05	12.48	0.39	----	----	----	----	----	----	0.39
6.83	0.00	76.02	12.45	0.39	----	----	----	----	----	----	0.39
7.00	0.00	75.99	12.42	0.38	----	----	----	----	----	----	0.38
7.17	0.00	75.96	12.39	0.37	----	----	----	----	----	----	0.37
7.33	0.00	75.93	12.36	0.37	----	----	----	----	----	----	0.37
7.50	0.00	75.90	12.33	0.36	----	----	----	----	----	----	0.36
7.67	0.00	75.87	12.31	0.35	----	----	----	----	----	----	0.35
7.83	0.00	75.84	12.28	0.35	----	----	----	----	----	----	0.35
8.00	0.00	75.82	12.25	0.34	----	----	----	----	----	----	0.34
8.17	0.00	75.79	12.22	0.33	----	----	----	----	----	----	0.33
8.33	0.00	75.76	12.20	0.32	----	----	----	----	----	----	0.32
8.50	0.00	75.74	12.17	0.32	----	----	----	----	----	----	0.32
8.67	0.00	75.71	12.15	0.31	----	----	----	----	----	----	0.31
8.83	0.00	75.69	12.12	0.30	----	----	----	----	----	----	0.30
9.00	0.00	75.66	12.10	0.30	----	----	----	----	----	----	0.30
9.17	0.00	75.64	12.07	0.29	----	----	----	----	----	----	0.29
9.33	0.00	75.62	12.05	0.28	----	----	----	----	----	----	0.28
9.50	0.00	75.59	12.03	0.27	----	----	----	----	----	----	0.27
9.67	0.00	75.57	12.01	0.26	----	----	----	----	----	----	0.26
9.83	0.00	75.55	11.98	0.25	----	----	----	----	----	----	0.25
10.00	0.00	75.53	11.96	0.24	----	----	----	----	----	----	0.24
10.17	0.00	75.51	11.94	0.24	----	----	----	----	----	----	0.24
10.33	0.00	75.49	11.93	0.22	----	----	----	----	----	----	0.22
10.50	0.00	75.47	11.91	0.21	----	----	----	----	----	----	0.21
10.67	0.00	75.46	11.89	0.20	----	----	----	----	----	----	0.20
10.83	0.00	75.44	11.87	0.18	----	----	----	----	----	----	0.18
11.00	0.00	75.43	11.86	0.17	----	----	----	----	----	----	0.17
11.17	0.00	75.41	11.85	0.16	----	----	----	----	----	----	0.16
11.33	0.00	75.40	11.83	0.15	----	----	----	----	----	----	0.15
11.50	0.00	75.39	11.82	0.14	----	----	----	----	----	----	0.14

...End

Reservoir Report

Page 1

Reservoir No. 1 - BMP

English

Pond Data

Pond storage is based on known contour areas

Stage / Storage Table

Stage ft	Elevation ft	Contour area sqft	Incr. Storage cuft	Total storage cuft
0.00	75.00	6,918	0	0
1.00	76.00	7,865	7,392	7,392
2.00	77.00	8,926	8,396	15,787
3.00	78.00	9,986	9,456	25,243
3.50	78.50	10,684	5,168	30,411
5.00	80.00	12,776	17,595	48,006

Culvert / Orifice Structures

	[A]	[B]	[C]	[D]
Rise in	= 15.0	4.0	0.0	0.0
Span in	= 15.0	4.0	0.0	0.0
No. Barrels	= 1	1	0	0
Invert El. ft	= 69.00	75.00	0.00	0.00
Length ft	= 100.0	1.0	0.0	0.0
Slope %	= 1.00	1.00	0.00	0.00
N-Value	= .013	.013	.000	.000
Orif. Coeff.	= 0.50	0.60	0.00	0.00
Multi-Stage	= ----	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len ft	= 12.56	8.00	0.00	0.00
Crest El. ft	= 77.00	78.50	0.00	0.00
Weir Coeff.	= 3.00	3.00	0.00	0.00
Eqn. Exp.	= 1.50	1.50	0.00	0.00
Multi-Stage	= Yes	Yes	No	No

Tailwater Elevation = 0.00 ft

Note: All outflows have been analyzed under inlet and outlet control.

Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Discharge cfs
0.00	0	75.00	11.41	0.00	---	---	0.00	0.00	---	---	0.00
1.00	7,392	76.00	12.43	0.38	---	---	0.00	0.00	---	---	0.38
2.00	15,787	77.00	13.37	0.57	---	---	0.00	0.00	---	---	0.57
3.00	25,243	78.00	14.25	0.00	---	---	37.68	0.00	---	---	14.25
3.50	30,411	78.50	14.67	0.00	---	---	69.22	0.00	---	---	14.67
5.00	48,006	80.00	15.86	0.00	---	---	195.79	44.09	---	---	15.86

Hydrograph Report

Page 1

English

Hyd. No. 13

Pond 1- 100-Year Storm

Hydrograph type = Reservoir
Storm frequency = 100 yrs
Inflow hyd. No. = 4
Max. Elevation = 78.06 ft

Peak discharge = 14.30 cfs
Time interval = 10 min
Reservoir name = BMP
Max. Storage = 25,840 cuft

Storage Indication method used.

Total Volume = 59,046 cuft

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
0.33	8.97	75.86	12.29	0.35	----	----	----	----	----	----	0.35
0.50	29.91 <<	77.14	13.50	0.59	----	----	2.04	----	----	----	2.63
0.67	16.15	78.06 <<	14.30	----	----	----	41.00	----	----	----	14.30 <<
0.83	11.67	78.04	14.28	----	----	----	39.73	----	----	----	14.28
1.00	7.48	77.75	14.03	----	----	----	24.44	----	----	----	14.03
1.17	5.38	77.39	13.72	0.63	----	----	9.35	----	----	----	9.98
1.33	4.49	77.23	13.58	0.60	----	----	4.34	----	----	----	4.94
1.50	4.19	77.21	13.56	0.60	----	----	3.77	----	----	----	4.37
1.67	3.89	77.20	13.55	0.60	----	----	3.46	----	----	----	4.06
1.83	0.00	77.12	13.48	0.59	----	----	1.72	----	----	----	2.31
2.00	0.00	77.02	13.39	0.57	----	----	0.28	----	----	----	0.86
2.17	0.00	76.98	13.35	0.57	----	----	----	----	----	----	0.57
2.33	0.00	76.94	13.31	0.56	----	----	----	----	----	----	0.56
2.50	0.00	76.90	13.28	0.55	----	----	----	----	----	----	0.55
2.67	0.00	76.86	13.24	0.55	----	----	----	----	----	----	0.55
2.83	0.00	76.82	13.20	0.54	----	----	----	----	----	----	0.54
3.00	0.00	76.78	13.17	0.53	----	----	----	----	----	----	0.53
3.17	0.00	76.74	13.13	0.53	----	----	----	----	----	----	0.53
3.33	0.00	76.70	13.10	0.52	----	----	----	----	----	----	0.52
3.50	0.00	76.67	13.07	0.51	----	----	----	----	----	----	0.51
3.67	0.00	76.63	13.03	0.51	----	----	----	----	----	----	0.51
3.83	0.00	76.59	13.00	0.50	----	----	----	----	----	----	0.50
4.00	0.00	76.56	12.96	0.50	----	----	----	----	----	----	0.50
4.17	0.00	76.52	12.93	0.49	----	----	----	----	----	----	0.49
4.33	0.00	76.49	12.90	0.48	----	----	----	----	----	----	0.48
4.50	0.00	76.45	12.87	0.48	----	----	----	----	----	----	0.48
4.67	0.00	76.42	12.83	0.47	----	----	----	----	----	----	0.47
4.83	0.00	76.39	12.80	0.46	----	----	----	----	----	----	0.46
5.00	0.00	76.35	12.77	0.46	----	----	----	----	----	----	0.46
5.17	0.00	76.32	12.74	0.45	----	----	----	----	----	----	0.45
5.33	0.00	76.29	12.71	0.45	----	----	----	----	----	----	0.45
5.50	0.00	76.26	12.68	0.44	----	----	----	----	----	----	0.44
5.67	0.00	76.23	12.65	0.43	----	----	----	----	----	----	0.43
5.83	0.00	76.20	12.62	0.43	----	----	----	----	----	----	0.43
6.00	0.00	76.17	12.59	0.42	----	----	----	----	----	----	0.42
6.17	0.00	76.14	12.56	0.41	----	----	----	----	----	----	0.41

Continues on next page...

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
6.33	0.00	76.11	12.54	0.41	----	----	----	----	----	----	0.41
6.50	0.00	76.08	12.51	0.40	----	----	----	----	----	----	0.40
6.67	0.00	76.05	12.48	0.39	----	----	----	----	----	----	0.39
6.83	0.00	76.02	12.45	0.39	----	----	----	----	----	----	0.39
7.00	0.00	75.99	12.42	0.38	----	----	----	----	----	----	0.38
7.17	0.00	75.96	12.39	0.37	----	----	----	----	----	----	0.37
7.33	0.00	75.93	12.37	0.37	----	----	----	----	----	----	0.37
7.50	0.00	75.90	12.34	0.36	----	----	----	----	----	----	0.36
7.67	0.00	75.87	12.31	0.35	----	----	----	----	----	----	0.35
7.83	0.00	75.85	12.28	0.35	----	----	----	----	----	----	0.35
8.00	0.00	75.82	12.25	0.34	----	----	----	----	----	----	0.34
8.17	0.00	75.79	12.23	0.33	----	----	----	----	----	----	0.33
8.33	0.00	75.76	12.20	0.32	----	----	----	----	----	----	0.32
8.50	0.00	75.74	12.17	0.32	----	----	----	----	----	----	0.32
8.67	0.00	75.71	12.15	0.31	----	----	----	----	----	----	0.31
8.83	0.00	75.69	12.12	0.30	----	----	----	----	----	----	0.30
9.00	0.00	75.66	12.10	0.30	----	----	----	----	----	----	0.30
9.17	0.00	75.64	12.07	0.29	----	----	----	----	----	----	0.29
9.33	0.00	75.62	12.05	0.28	----	----	----	----	----	----	0.28
9.50	0.00	75.59	12.03	0.27	----	----	----	----	----	----	0.27
9.67	0.00	75.57	12.01	0.26	----	----	----	----	----	----	0.26
9.83	0.00	75.55	11.99	0.25	----	----	----	----	----	----	0.25
10.00	0.00	75.53	11.97	0.24	----	----	----	----	----	----	0.24
10.17	0.00	75.51	11.95	0.24	----	----	----	----	----	----	0.24
10.33	0.00	75.49	11.93	0.22	----	----	----	----	----	----	0.22
10.50	0.00	75.48	11.91	0.21	----	----	----	----	----	----	0.21
10.67	0.00	75.46	11.89	0.20	----	----	----	----	----	----	0.20
10.83	0.00	75.44	11.88	0.19	----	----	----	----	----	----	0.19
11.00	0.00	75.43	11.86	0.17	----	----	----	----	----	----	0.17
11.17	0.00	75.41	11.85	0.16	----	----	----	----	----	----	0.16
11.33	0.00	75.40	11.83	0.15	----	----	----	----	----	----	0.15

...End

Reservoir Report

Page 1

Reservoir No. 1 - BMP

English

Pond Data

Pond storage is based on known contour areas

Stage / Storage Table

Stage ft	Elevation ft	Contour area sqft	Incr. Storage cuft	Total storage cuft
0.00	75.00	6,918	0	0
1.00	76.00	7,865	7,392	7,392
2.00	77.00	8,926	8,396	15,787
3.00	78.00	9,986	9,456	25,243
3.50	78.50	10,684	5,168	30,411
5.00	80.00	12,776	17,595	48,006

Culvert / Orifice Structures

	[A]	[B]	[C]	[D]
Rise in	= 15.0	4.0	0.0	0.0
Span in	= 15.0	4.0	0.0	0.0
No. Barrels	= 1	1	0	0
Invert El. ft	= 69.00	75.00	0.00	0.00
Length ft	= 100.0	1.0	0.0	0.0
Slope %	= 1.00	1.00	0.00	0.00
N-Value	= .013	.013	.000	.000
Orif. Coeff.	= 0.50	0.60	0.00	0.00
Multi-Stage	= ----	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len ft	= 12.56	8.00	0.00	0.00
Crest El. ft	= 77.00	78.50	0.00	0.00
Weir Coeff.	= 3.00	3.00	0.00	0.00
Eqn. Exp.	= 1.50	1.50	0.00	0.00
Multi-Stage	= Yes	Yes	No	No

Tailwater Elevation = 0.00 ft

Note: All outflows have been analyzed under inlet and outlet control.

Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Discharge cfs
0.00	0	75.00	11.41	0.00	---	---	0.00	0.00	---	---	0.00
1.00	7,392	76.00	12.43	0.38	---	---	0.00	0.00	---	---	0.38
2.00	15,787	77.00	13.37	0.57	---	---	0.00	0.00	---	---	0.57
3.00	25,243	78.00	14.25	0.00	---	---	37.68	0.00	---	---	14.25
3.50	30,411	78.50	14.67	0.00	---	---	69.22	0.00	---	---	14.67
5.00	48,006	80.00	15.86	0.00	---	---	195.79	44.09	---	---	15.86

AES CALCULATIONS

STREAM CHANNEL PROTECTION CALCULATIONS
for
Ironbound Village
AES Project No.: 8914-1

PROPOSED POND VOLUME

Eleva	Depth	Area (sq. ft.)	Incremental Volume (cu. ft.)	Sum Volume (cu. ft.)	Sum Volume (cu. yd.)	Volume Above NPE
70.0	0.0	1,094	0	0	0	
72.0	2.0	2,396	3,490	3,490	129	
73.7	1.7	4,303	5,694	9,184	340	
74.0	0.3	5,971	1,541	10,725	397	
75.0	1.0	6,918	6,445	17,170	636	0
76.0	1.0	7,865	7,392	24,561	910	7,391
77.0	1.0	8,926	8,395	32,957	1,221	15,787
78.0	1.0	9,986	9,456	42,412	1,571	25,242
78.5	0.5	10,684	5,168	47,580	1,762	30,410
80.0	1.5	12,776	17,595	65,175	2,414	48,005

RELEASE RATE REQUIRED TO DETAINED VOLUME FOR 24 HOURS

Required Volume based upon 1-Year, 24-Hour Storm Hydrograph =

15,026 cubic feet ✓

Volume provided based upon above table =

15,787 cubic feet

Elevation of water surface associated with provided volume =

77.0

Elevation of Low Flow Orifice =

75.0

Average Head, in feet =

1.0

Average Release Rate Calculation

$$\frac{15,787 \text{ cubic feet}}{(24 \text{ hours} \times 60 \text{ minutes/hour} \times 60 \text{ seconds/minute})} =$$

0.2 cfs

*MODERATIONAL
CRITICAL
STORM DFR.*

LOW FLOW ORIFICE DIAMETER REQUIRED TO MAINTAIN AVERAGE RELEASE RATE

$$\text{Diameter of Low Flow Orifice} = 2 * (Q / ((64.32 * (h / 2)) ^ (1/2) * 0.6 * 3.14))) ^ (1/2)$$

where, Q equals average release rate (cfs), h equals average head (feet)

Diameter of Low Flow Orifice =

0.30

feet, or

4 inches

*CALEB Hurst /
CJ BOONAR
CANDORATIC*

Type.... Mod. Rational Hyg
 Name.... DRAINAGE AREA Tag: Dev..1
 File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\
 Storm... e, b, d Tag: Dev..1

Page 5.01
 Event: 1 yr

MODIFIED RATIONAL METHOD HYDROGRAPH ✓

$Q = CiA * \text{Units Conversion}$; Where Conversion = 43560 / (12 * 3600)

Tag	Freq	File	IDF Curve
Dev..1	1	JCC.IDQ	e = .9050 b = 63.0330 d = 12.2000

Td = .5333 hrs

Tag	Freq (years)	C	C adj factor	C final	I in/hr	Area acres	Peak Q cfs
Dev..1	1	.550	1.000	.550	2.0439	6.900	7.82

HYG file = S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\IBV-MR.HYG
 HYG ID = DRAINAGE AREA
 HYG Tag = Dev..1

Peak Discharge = 7.82 cfs

Time to Peak = .1700 hrs

HYG Volume = .345 ac-ft

* *

* * = 15,028 CF ✓

HYDROGRAPH ORDINATES (cfs)

Output Time increment = .0100 hrs

Time on left represents time for first value in each row.

Time hrs	HYDROGRAPH ORDINATES (cfs)				
.0000	.00	.46	.92	1.38	1.84
.0500	2.30	2.76	3.22	3.68	4.14
.1000	4.60	5.06	5.52	5.98	6.44
.1500	6.90	7.36	7.82	7.82	7.82
.2000	7.82	7.82	7.82	7.82	7.82
.2500	7.82	7.82	7.82	7.82	7.82
.3000	7.82	7.82	7.82	7.82	7.82
.3500	7.82	7.82	7.82	7.82	7.82
.4000	7.82	7.82	7.82	7.82	7.82
.4500	7.82	7.82	7.82	7.82	7.82
.5000	7.82	7.82	7.82	7.82	7.51
.5500	7.05	6.59	6.13	5.67	5.21
.6000	4.75	4.29	3.83	3.37	2.91

 *
 *
 *
 MODIFIED RATIONAL METHOD
 *
 ---- Grand Summary For All Storm Frequencies ----
 *
 *

$Q = C_i A * \text{Units Conversion; Where Conversion} = 43560 / (12 * 3600)$

Area = 6.900 acres

$T_c = .1700 \text{ hrs}$

10.2 min.

Freq. years	Adjusted 'C'	Duration hrs	I in/hr	VOLUMES		Inflow ac-ft	Storage ac-ft
				Post Qpeak cfs	Pre Allowable cfs		
1	.550	.5333	2.0439	7.82	5.38	.345	.189
2	.550	.5833	2.3405	8.96	6.31	.432	.235
10	.550	.6667	3.0634	11.72	8.43	.646	.355
25	.550	.7167	3.4127	13.06	9.52	.773	.425
100	.550	.7833	3.9690	15.19	11.22	.983	.541

Name.... Watershed

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

MASTER DESIGN STORM SUMMARY

Default Network Design Storm File, ID JCC.IDQ jcc

$$i = b / ((T + d)**e)$$

Where: i = rainfall intensity (in/hr)

T = rainfall duration (min)

e, b, d = rainfall equation coefficients

Return Event	Rainfall Type	e coeff	b coeff	d coeff
Dev..1	I-D-F from e, b, d coeff.	.9050	63.0330	12.2000
Dev..2	I-D-F from e, b, d coeff.	.9070	79.8580	14.0000
Dev.10	I-D-F from e, b, d coeff.	.9430	143.7170	19.2000
Dev.25	I-D-F from e, b, d coeff.	.9420	172.1050	21.2000
Dev100	I-D-F from e, b, d coeff.	.9860	273.9490	26.3000

MASTER NETWORK SUMMARY
Modified Rational Method Network

(*Node=Outfall; +Node=Diversion;)
(Trun= HYG Truncation: Blank=None; L=Left; R=Rt; LR=Left&Rt)

Storage Node ID	Return Type	Event	HYG Vol ac-ft	Trun	Qpeak hrs	Qpeak cfs	Max WSEL ft	Max Pond ac-ft
DRAINAGE AREA	AREA	1	.345		.1700	7.82		
DRAINAGE AREA	AREA	2	.432		.1700	8.96		
DRAINAGE AREA	AREA	10	.646		.1700	11.72		
DRAINAGE AREA	AREA	25	.773		.1700	13.06		
DRAINAGE AREA	AREA	100	.983		.1700	15.19		
*OUTFALL	JCT	1	.340		.6700	.53		
*OUTFALL	JCT	2	.425		.6900	3.14		
*OUTFALL	JCT	10	.639		.7000	9.60		
*OUTFALL	JCT	25	.766		.7400	11.23		
*OUTFALL	JCT	100	.976		.8000	13.21		
POND	IN POND	1	.345		.1700	7.82		
POND	IN POND	2	.432		.1700	8.96		

S/N: C21602B06A81
PondPack Ver. 7.5 (767)

AES Consulting Engineers
Compute Time: 15:15:03 Date: 10/10/2001

MASTER NETWORK SUMMARY
 Modified Rational Method Network

(*Node=Outfall; +Node=Diversion;)
 (Trun= HYG Truncation: Blank=None; L=Left; R=Rt; LR=Left&Rt)

Storage	Return	HYG Vol	Qpeak	Qpeak	Max WSEL	Max
Node ID	Type Event	ac-ft	Trun	hrs	cfs	Pond
					ft	ac-ft
POND	IN POND	10		.1700	11.72	
POND	IN POND	25		.1700	13.06	
POND	IN POND	100		.1700	15.19	
POND	OUT POND	1		.6700	.53	76.82 .716
POND	OUT POND	2		.6900	3.14	77.13 .780
POND	OUT POND	10		.7000	9.60	77.45 .847
POND	OUT POND	25		.7400	11.23	77.57 .874
POND	OUT POND	100		.8000	13.21	77.80 OHW .925

Q_{out} ELEV.

Type.... Outlet Input
Name.... OUTLET

Page 1.01

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

REQUESTED POND WS ELEVATIONS:

Min. Elev.= 70.00 ft
Increment = .50 ft
Max. Elev.= 80.00 ft

OUTLET CONNECTIVITY

---> Forward Flow Only (UpStream to DnStream)
<--- Reverse Flow Only (DnStream to UpStream)
<---> Forward and Reverse Both Allowed

Structure	No.		Outfall	E1, ft	E2, ft
Weir-Rectangular	SW	--->	TW	78.500	80.000
Stand Pipe	SP	--->	CV	77.000	80.000
Orifice-Circular	OR	--->	CV	75.000	80.000
Culvert-Circular	CV	--->	TW	69.000	80.000
TW SETUP, DS Channel					

S/N: C21602B06A81

PondPack Ver. 7.5 (767)

Compute Time: 17:26:18

Date: 10/04/2001

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

OUTLET STRUCTURE INPUT DATA

Structure ID = SW
Structure Type = Weir-Rectangular

of Openings = 1
Crest Elev. = 78.50 ft
Weir Length = 8.00 ft
Weir Coeff. = 3.000000

Weir TW effects (Use adjustment equation)

Structure ID = SP
Structure Type = Stand Pipe

of Openings = 1
Invert Elev. = 77.00 ft
Diameter = 3.0000 ft
Orifice Area = 7.0686 sq.ft
Orifice Coeff. = .600
Weir Length = 9.42 ft
Weir Coeff. = 3.000
K, Submerged = .000
K, Reverse = 1.000
Kb, Barrel = .000000 (per ft of full flow)
Barrel Length = .00 ft
Mannings n = .0000

Structure ID = OR
Structure Type = Orifice-Circular

of Openings = 1
Invert Elev. = 75.00 ft
Diameter = .3300 ft
Orifice Coeff. = .600

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

OUTLET STRUCTURE INPUT DATA

Structure ID = CV
Structure Type = Culvert-Circular

No. Barrels = 1
Barrel Diameter = 1.2500 ft
Upstream Invert = 69.00 ft
Dnstream Invert = 68.00 ft
Horiz. Length = 100.00 ft
Barrel Length = 100.01 ft
Barrel Slope = .01000 ft/ft

OUTLET CONTROL DATA...

Mannings n = .0130
Ke = .5000 (forward entrance loss)
Kb = .023225 (per ft of full flow)
Kr = .5000 (reverse entrance loss)
HW Convergence = .001 +/- ft

INLET CONTROL DATA...

Equation form = 1
Inlet Control K = .0078
Inlet Control M = 2.0000
Inlet Control c = .02920
Inlet Control Y = .7400
T1 ratio (HW/D) = 1.131
T2 ratio (HW/D) = 1.202
Slope Factor = -.500

Use unsubmerged inlet control Form 1 equ. below T1 elev.
Use submerged inlet control Form 1 equ. above T2 elev.

In transition zone between unsubmerged and submerged inlet control,
interpolate between flows at T1 & T2...

At T1 Elev = 70.41 ft ---> Flow = 4.80 cfs
At T2 Elev = 70.50 ft ---> Flow = 5.49 cfs

Structure ID = TW
Structure Type = TW SETUP, DS Channel

FREE OUTFALL CONDITIONS SPECIFIED

CONVERGENCE TOLERANCES...

Maximum Iterations= 30
Min. TW tolerance = .01 ft
Max. TW tolerance = .01 ft
Min. HW tolerance = .01 ft
Max. HW tolerance = .01 ft
Min. Q tolerance = .10 cfs
Max. Q tolerance = .10 cfs

Type.... Composite Rating Curve
Name.... OUTLET

Page 1.04

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

***** COMPOSITE OUTFLOW SUMMARY *****

WS Elev, Total Q		Converge		Notes
Elev. ft	Q cfs	TW Elev ft	Error +/-ft	Contributing Structures
70.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
70.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
71.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
71.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
72.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
72.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
73.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
73.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
74.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
74.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
75.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
75.50	.24	Free Outfall		OR,CV (no Q: SW,SP)
76.00	.38	Free Outfall		OR,CV (no Q: SW,SP)
76.50	.48	Free Outfall		OR,CV (no Q: SW,SP)
77.00	.56	Free Outfall		OR,CV (no Q: SW,SP)
77.50	10.63	Free Outfall		SP,OR,CV (no Q: SW)
78.00	14.90	Free Outfall		SP,CV (no Q: SW,OR)
78.50	15.32	Free Outfall		SP,CV (no Q: SW,OR)
79.00	24.21	Free Outfall		SW,SP,CV (no Q: OR)
79.50	40.12	Free Outfall		SW,SP,CV (no Q: OR)
80.00	60.60	Free Outfall		SW,SP,CV (no Q: OR)




CONSERVATION ESMNT AREA= 0.97 Ac.



ONSITE AREA TO POND= 6.30 Ac



OFFSITE AREA TO POND= 0.59 Ac

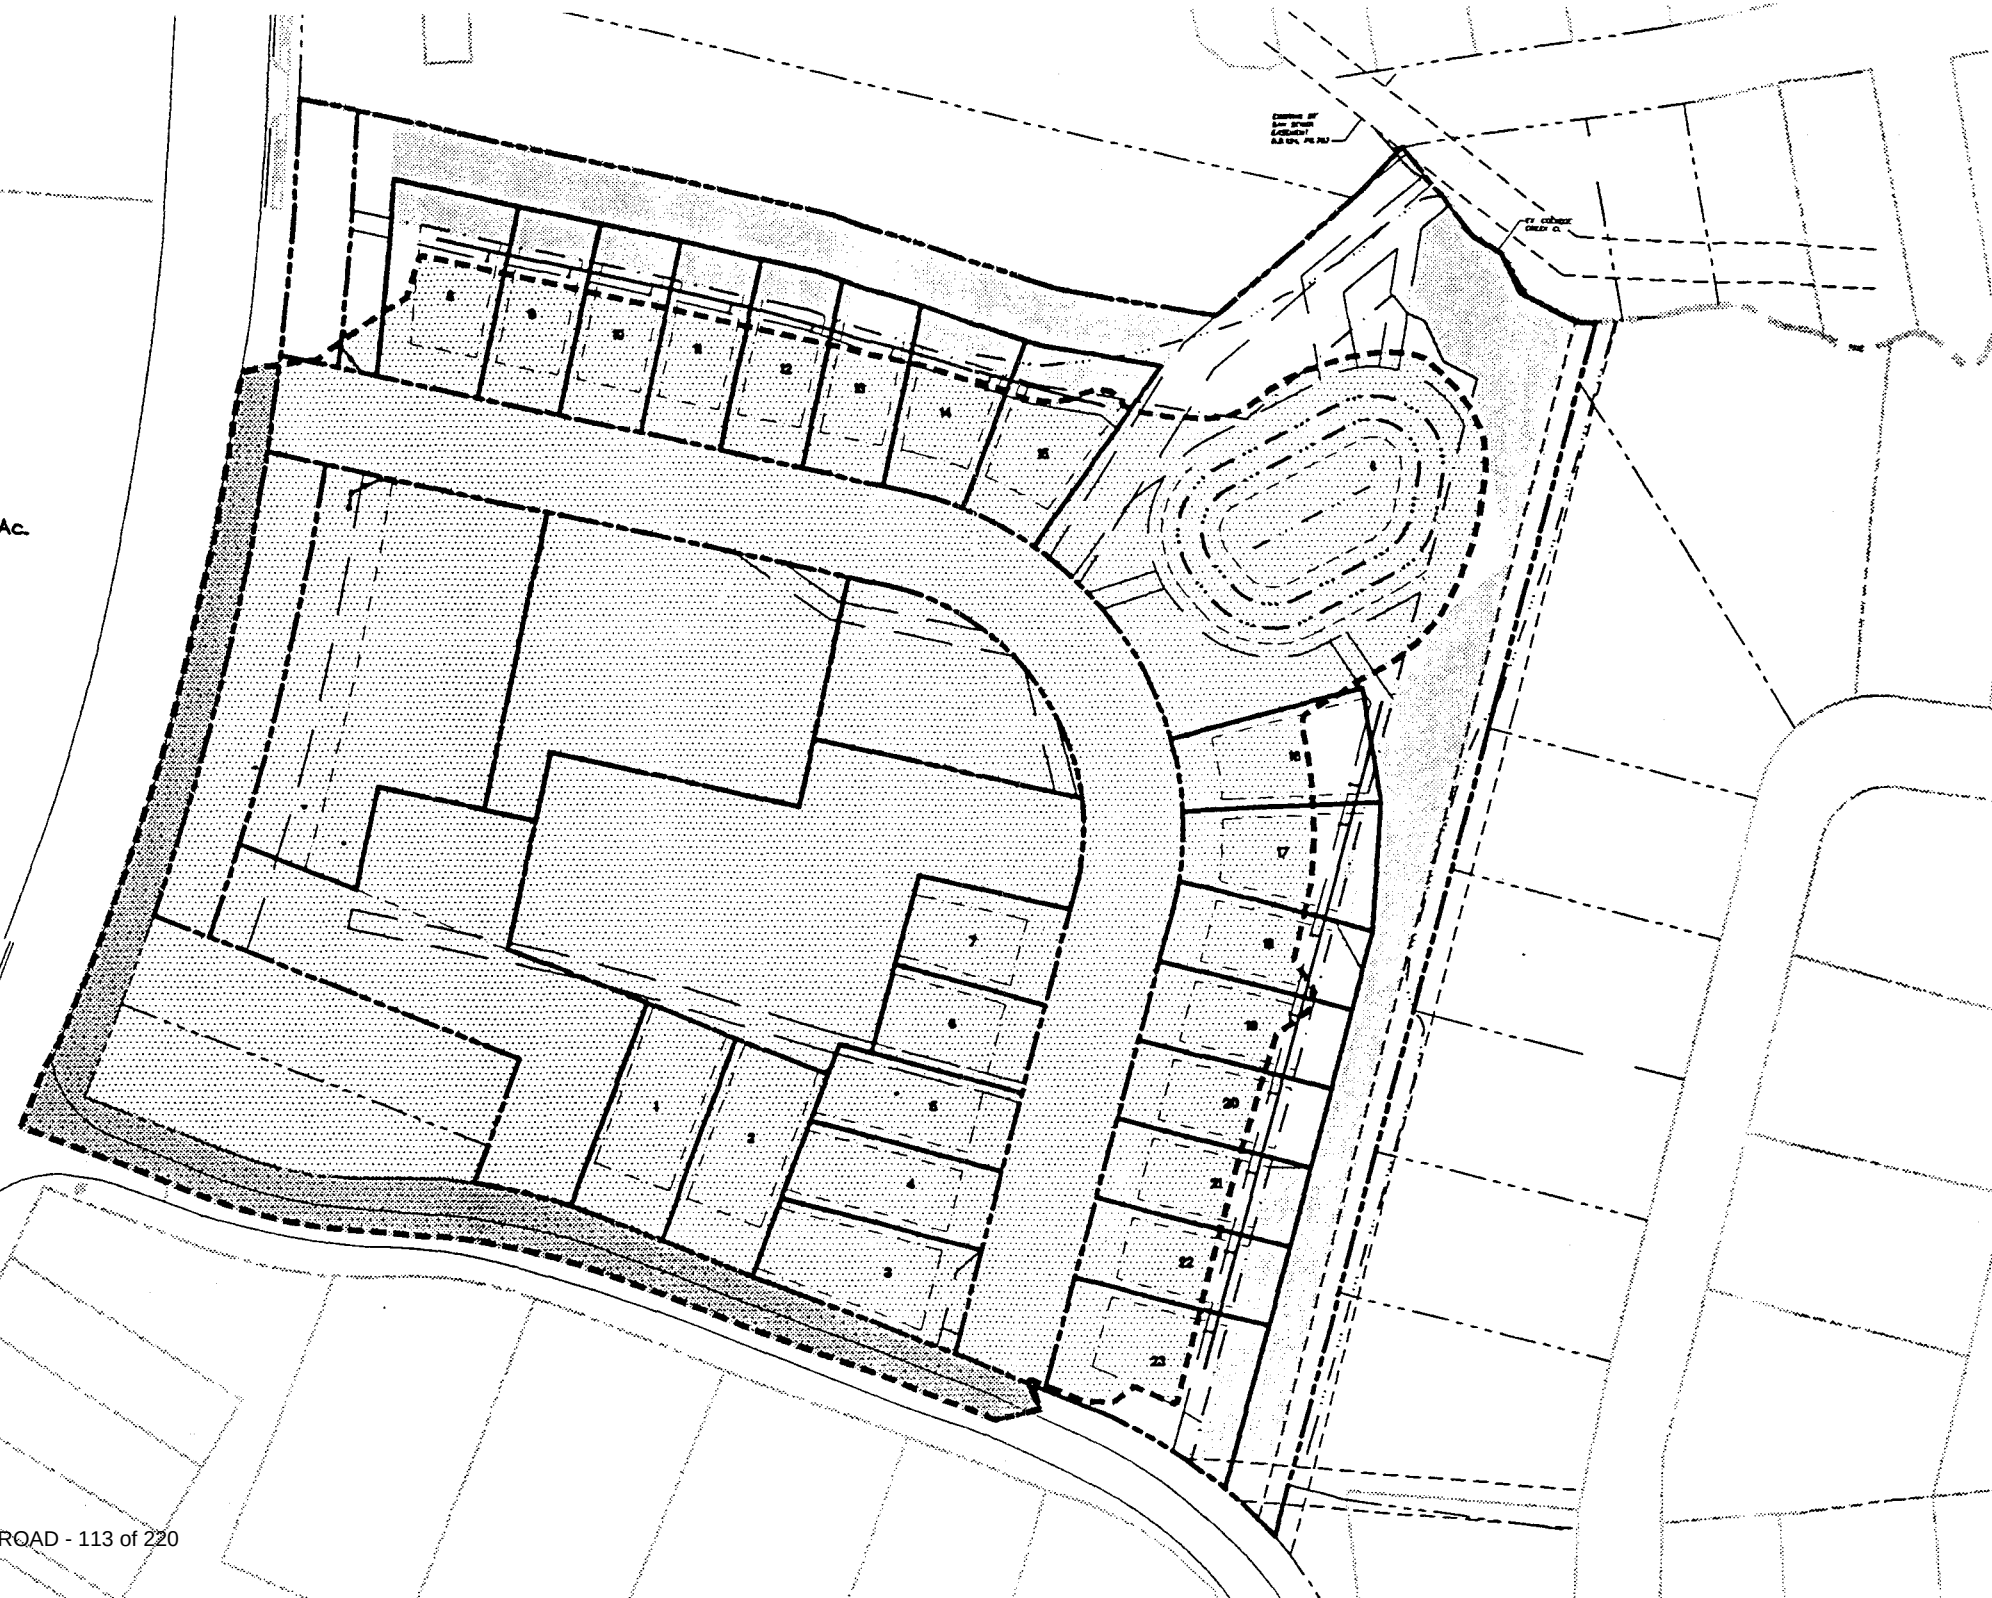

WORKSHEET FOR BMP POINT SYSTEM

TOTAL SITE AREA = 7.75 AC.

A. STRUCTURAL BMP POINT ALLOCATION

<u>BMP</u>	<u>BMP Points</u>	<u>Fraction of Site Served</u>	<u>Weighted BMP Points</u>
Wet Pond (E.D.)	10 ✓	$x (6.30 + 0.59) \div 7.75 =$	<u>8.89</u>
TOTAL WEIGHTED STRUCTURAL BMP POINTS:			8.89

B. NATURAL OPEN SPACE CREDIT

<u>Adjacent To Wetland</u>	<u>Natural Open Space Credit</u>	<u>Fraction of Site</u>	<u>Points for Natural Open Space</u>
No	10	$x 0.94 \div 7.75$	$= 1.21$


C. TOTAL WEIGHTED POINTS

<u>Structural BMP Points</u>		<u>Natural Open Space Points</u>		<u>Total</u>
8.89	+	1.21	=	10.10 ✓

NOTES:

- 1) Natural open space has been placed in a conservation easement.

JOBS\8914\01-IBV\Design\Pond\bmp-pnts.doc

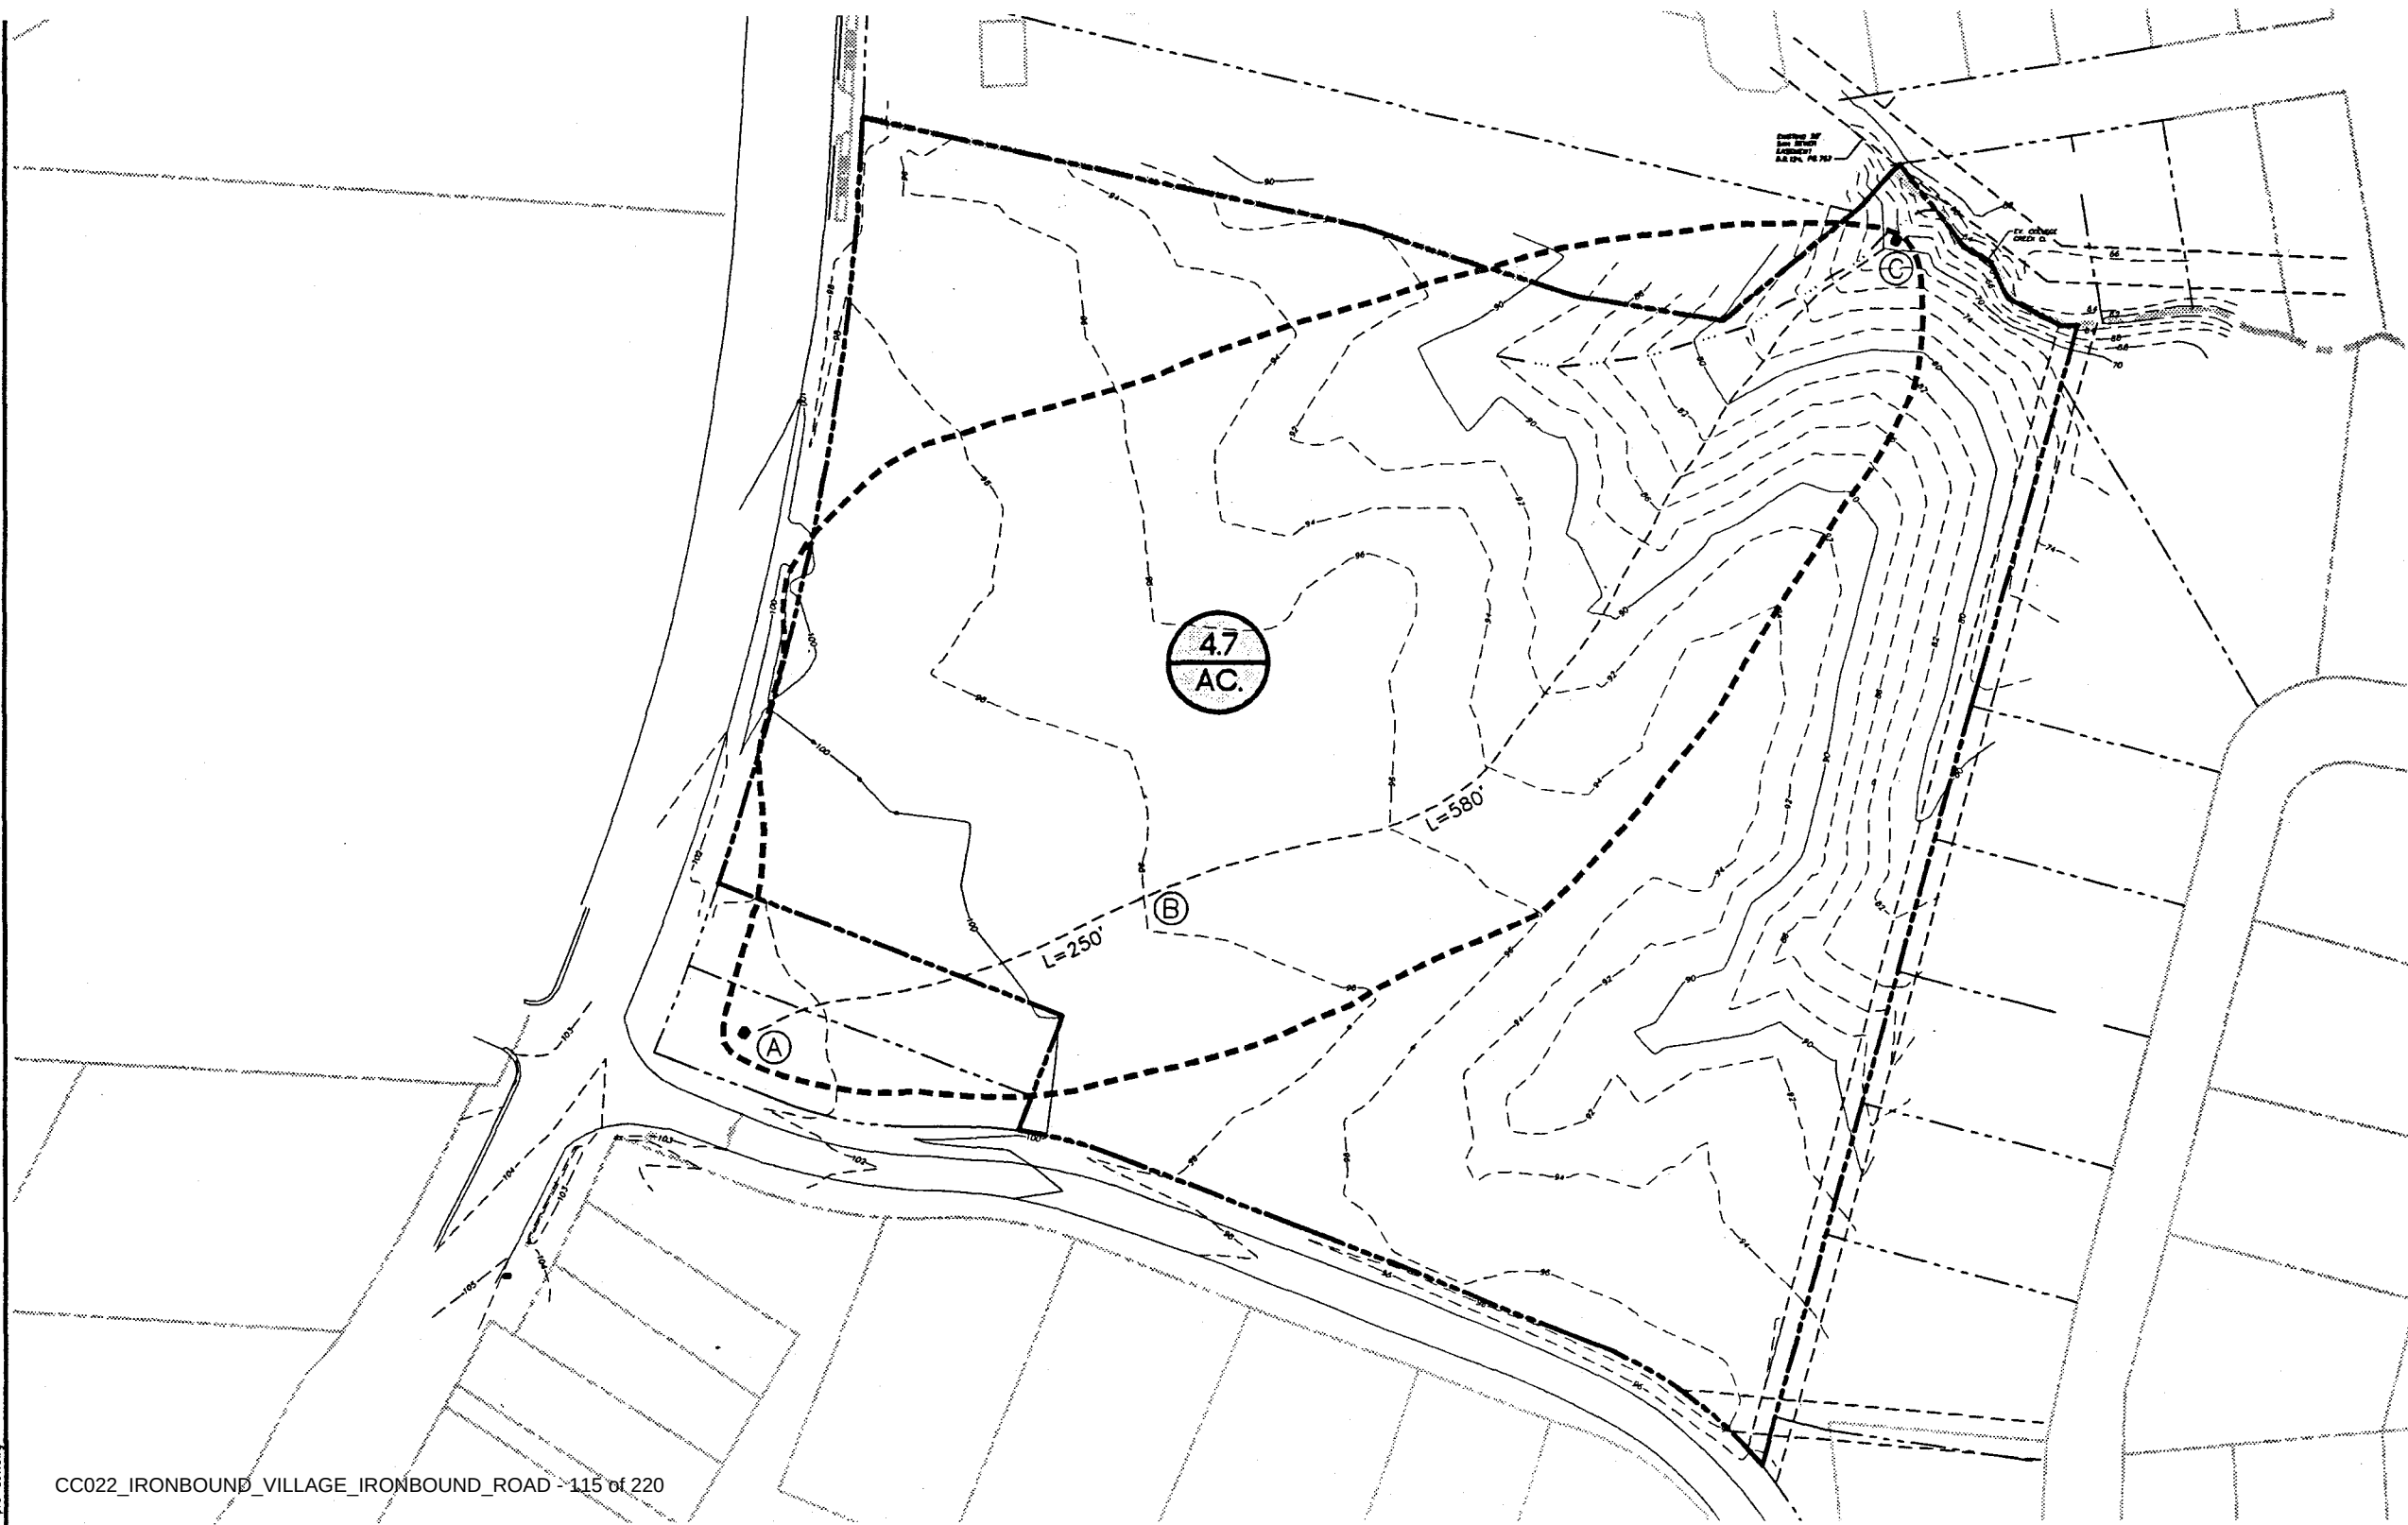

Impervious Area and Required Volume Calculations
for
Ironbound Village
AES# 8914-1

Impervious items	Totals		Acres
Houses	23 Ea	1350 SF	0.71
T.H.	7 Ea	912 SF	0.15
Office	4 Ea	2400 SF	0.22
Driveways	23 Ea	312 SF	0.16
Roads:			
Public	870 LF	31 Width	0.62
Private	530 LF	60 Width	0.73
Pond Access Rd	340 LF	12 Width	0.09
Wet Pond Surface @ N.P.	105 LF	65 Width	0.16
Sidewalks: w/in R/W	850 LF	8 Width	0.16
Offsite Road	500 LF	12 Width	0.14
Total Impervious Area (TIA)			3.14

Area to Pond = 6.8 Acres

Percent Impervious = 46%

Pond's Required Wet Volume = (1")(ft/12")(TIA Ac)(43560 sf/Ac) = 11,390 c.f.

Pond's Required Dry Volume = (1")(ft/12")(TIA Ac)(43560 sf/Ac) = 11,390 c.f.

Sediment Forebay's Required Volume = (0.1")(ft/12")(TIA Ac)(43560 sf/Ac) = 1,139 c.f.

BMP VOLUME CALCULATIONS
for
STONEHOUSE Ph 1, Bent Tree (Sect. V-B) Ph3
AES Project No.: 8878-00

PROPOSED POND VOLUME

Eleva	Depth	Area (sq. ft.)	Incremental Volume (cu. ft.)	Sum Volume (cu. ft.)	Sum Volume (cu. yd.)	Volume Above NPE
70.0	0.0	1,094	0	0	0	
72.0	2.0	2,396	3,490	3,490	129	
73.7	1.7	4,303	5,694	9,184	340	
74.0	0.3	5,971	1,541	10,725	397	
75.0	1.0	6,918	6,445	17,170	636	0
76.0	1.0	7,865	7,392	24,561	910	7,391
77.0	1.0	8,926	8,396	32,957	1,221	15,787
78.0	1.0	9,986	9,456	42,413	1,571	25,243
78.5	0.5	10,684	5,168	47,580	1,762	30,410
80.0	1.5	12,776	17,595	65,175	2,414	48,005

RELEASE RATE REQUIRED TO DETAINED VOLUME FOR 24 HOURS

Required BMP Volume (based upon Impervious Area) = 11,390 cubic feet

Volume Provided (based upon above table) = 15,787 cubic feet

Elevation of water surface associated with provided volume = 77.0

Elevation of Low Flow Orifice = 75.0

Average Head, in feet = 1.0

Average Release Rate Calculation $\frac{15,787 \text{ cubic feet}}{(24 \text{ hours} \times 60 \text{ minutes/hour} \times 60 \text{ seconds/minute})} = 0.2 \text{ cfs}$

LOW FLOW ORIFICE DIAMETER REQUIRED TO MAINTAIN AVERAGE RELEASE RATE

$$\text{Diameter of Low Flow Orifice} = 2 * (Q / ((64.32 * (h / 2))^{(1/2)} * 0.6 * 3.14)))^{(1/2)}$$

where, Q equals average release rate (cfs), h equals average head (feet)

Diameter of Low Flow Orifice = 0.30 feet, or 4 inches

Hydrograph Summary Report

Page 1

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to peak (min)	Volume (cuft)	Return period (yrs)	Inflow hyd(s)	Maximum elevation (ft)	Maximum storage (cuft)	Hydrograph description
1	Rational	7.8 ✓	1	5	2,922	2	—	—	—	2yr Pre
2	Rational	10.0 ✓	1	5	3,768	10	—	—	—	10yr Pre
3	Rational	13.0 ✓	1	5	4,858	100	—	—	—	100yr Pre
5	Rational	18.2 ✓	1	5	6,830	1	—	—	—	1yr Post
6	Rational	21.0 ✓	1	5	7,864	2	—	—	—	2yr Post
7	Rational	27.0 ✓	1	5	10,141	10	—	—	—	10yr Post
8	Rational	34.9 ✓	1	5	13,074	100	—	—	—	100yr Post
10	Reservoir	0.4	1	12	6,406	1	5	75.87	23,584	1yr routing
11	Reservoir	0.4	1	12	7,385	2	6	76.00	24,861	2yr routing
12	Reservoir	0.4	1	12	9,538	10	7	76.26	26,718	10yr routing
13	Reservoir	0.5	1	12	12,312	100	8	76.59 ^{DHW}	29,503	100yr routing
Proj. file: Pond.gpw					IDF file: JCChydrographs.IDF			Run date: 06-21-2001		

IRONBOUND VILLAGE

IRONBOUND ROAD

PHASES 1 AND 2

DECEMBER 2001

LMDG FILE NO. 2001112-000.07

SUPPORTING ENGINEERING DOCUMENTS

- DRAINAGE CALCULATIONS
 - SUMMARY OF DATA
 - LMDG ROUTING CALCULATIONS
 - AES CALCULATIONS

LANDMARK
DESIGN GROUP

SJT CHECK SET.
(FINAL COMPS)
S-36-01
SP-29-01
REVISED
COMPS, RISER
SIZE CHANGE
36" to 48"
OK 8/11
1-23-02

Engineers ♦ Planners ♦ Surveyors ♦ Landscape Architects ♦ Environmental Consultants
4029 Ironbound Road, Suite 100, Williamsburg, VA 23188 (757) 253-2975 FAX: (757) 229-0049 lmdg@landmarkdgb.com

SUMMARY OF DATA

Storm Event

AES Results

LMDG Results

2-year pre-developed
2-year post-developed
2-year routed outflow
2-year rise elevation

6.31 ? 7.8
8.96 ✓
~~8.96~~ (3.14) ✓
77.13 ✓

6.31 ✓
16.82 ✓
7.28 ✓
77.31 ✓

10-year pre-developed
10-year post-developed
10-year routed outflow
10-year rise elevation

8.43 ? 10.0
11.72 ✓
9.60 ✓
(77.45) ✓

8.43 ✓
22.46 ✓
11.71 ✓
77.44 ✓

25-year pre-developed
25-year post-developed
25-year routed outflow
25-year rise elevation

9.52 ?
13.06 ✓
11.23 ✓
77.57 ✓

9.52 ✓
25.37 ✓
13.99 ✓
77.69 ✓

100-year pre-developed
100-year post-developed
100-year routed outflow
100-year rise elevation

11.22 ? 13.0
15.19 ✓
13.21 ✓
77.80 ✓

11.22 ✓
29.91 ✓
14.30 ✓
78.06 ✓ DHW

FINAL ROUTED
2-YEAR 7.28 cfs @ 77.31
10-YEAR 11.71 cfs @ 77.44
100-YEAR 14.30 cfs @ 78.06
2-YEAR 7.28 cfs < 7.8 cfs
AES PRE-2 = 7.8 cfs
LDG PRE-2 = 6.31 cfs

DA pre - 4.7 AC
DA post - 6.90 AC. C=0.55
Tc=10.2min

4.74 AC.

imprvd to post = 3.14 AC (46%)

• MEETS PRE-2 7.8 cfs
• NO CHANGE IN EXT
DET (WQV) SCV)
ALL ORIF. OR
POND VOLUME/
GRADING.
• FOOTING OK

LMDG ROUTING CALCULATIONS

File: Universal Pre.xls
PROJECT: IRONBOUND VILLAGE
 Description: **Pre-development to BMP**
 Date: 19-Dec-01
 Revised

LandMark Deisgn Group
 4029 Ironbound Road, Suite 100
 Williamsburg, VA 23188

UNIVERSAL RATIONAL METHOD FOR HYDROGRAPH GENERATION

Drainage Area = 4.74 Acres ✓
 Runoff Coefficient = 0.30
 Time of Concentration = 10.20 Min

2 Yr computed peak discharge = 6.31 cfs *≠ 7.8 CFS PER AES*
 10 Yr computed peak discharge = 8.43 cfs
 25 Yr computed peak discharge = 9.52 cfs
 100 Yr computed peak discharge = 11.22 cfs

COMPUTED HYDROGRAPH VERTEX POINTS

2 Yr Frequency		10 Yr Frequency		25 Yr Frequency		100 Yr Frequency	
Time (min)	Q (cfs)	Time (min)	Q (cfs)	Time (min)	Q (cfs)	Time (min)	Q (cfs)
0.0	0.00	0.0	0.00	0.0	0.00	0.0	0.00
10.2	1.33	10.2	1.77	10.2	2.00	10.2	2.36
20.4	1.89	20.4	2.53	20.4	2.86	20.4	3.37
30.6	6.31	30.6	8.43	30.6	9.52	30.6	11.22
40.8	3.41	40.8	4.55	40.8	5.14	40.8	6.06
51.0	2.46	51.0	3.29	51.0	3.71	51.0	4.38
61.2	1.58	61.2	2.11	61.2	2.38	61.2	2.81
71.4	1.14	71.4	1.52	71.4	1.71	71.4	2.02
81.6	0.95	81.6	1.26	81.6	1.43	81.6	1.68
91.8	0.88	91.8	1.18	91.8	1.33	91.8	1.57
102.0	0.82	102.0	1.10	102.0	1.24	102.0	1.46
112.2	0.00	112.2	0.00	112.2	0.00	112.2	0.00

EQUATIONS

$$I = B / (tc + D)^E$$

B,D,E constants based on NWS Hydro 35

$$tp = 3 * tc$$

$$tb = 11 * tc$$

$$Qp = C * I * A$$

File: Universal Post.xls
PROJECT: IRONBOUND VILLAGE
Description: **Postdevelopment to BMP**

LandMark Design Group
4029 Ironbound Road, Suite 100
Williamsburg, VA 23188

Date: 19-Dec-01
Revised:

UNIVERSAL RATIONAL METHOD FOR HYDROGRAPH GENERATION

Drainage Area = 6.89 Acres
Runoff Coefficient = 0.55
Time of Concentration = 10.20 Min

2 Yr computed peak discharge = 16.82 cfs
10 Yr computed peak discharge = 22.46 cfs
25 Yr computed peak discharge = 25.37 cfs
100 Yr computed peak discharge = 29.91 cfs

COMPUTED HYDROGRAPH VERTEX POINTS

2 Yr Frequency		10 Yr Frequency		25 Yr Frequency		100 Yr Frequency	
Time (min)	Q (cfs)	Time (min)	Q (cfs)	Time (min)	Q (cfs)	Time (min)	Q (cfs)
0.0	0.00	0.0	0.00	0.0	0.00	0.0	0.00
10.2	3.53	10.2	4.72	10.2	5.33	10.2	6.28
20.4	5.05	20.4	6.74	20.4	7.61	20.4	8.97
30.6	16.82	30.6	22.46	30.6	25.37	30.6	29.91
40.8	9.08	40.8	12.13	40.8	13.70	40.8	16.15
51.0	6.56	51.0	8.76	51.0	9.89	51.0	11.67
61.2	4.20	61.2	5.62	61.2	6.34	61.2	7.48
71.4	3.03	71.4	4.04	71.4	4.57	71.4	5.38
81.6	2.52	81.6	3.37	81.6	3.81	81.6	4.49
91.8	2.35	91.8	3.14	91.8	3.55	91.8	4.19
102.0	2.19	102.0	2.92	102.0	3.30	102.0	3.89
112.2	0.00	112.2	0.00	112.2	0.00	112.2	0.00

EQUATIONS

$$I = B / (t_c + D)^E$$

$$t_p = 3 * t_c$$

$$t_b = 11 * t_c$$

$$Q_p = C * I * A$$

B, D, E constants based on NWS Hydro 35

Hydrograph Summary Report

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to peak (min)	Volume (cuft)	Return period (yrs)	Inflow hyd(s)	Maximum elevation (ft)	Maximum storage (cuft)	Hydrograph description
1	Manual	16.82	10	30	33,198	2	---	----	----	2-Year Post-Develo
2	Manual	22.46	10	30	44,340	10	---	----	----	10-Year Post-Devel
3	Manual	25.37	10	30	50,142	25	---	----	----	25-Year Post-Devel
4	Manual	29.91	10	30	59,046	100	---	----	----	100-Year Post-Deve
5	Manual	6.31	10	30	12,462	2	---	----	----	2-Year Pre-Develop
6	Manual	8.43	10	30	16,644	10	---	----	----	10-Year Pre-Develo
7	Manual	9.52	10	30	18,792	25	---	----	----	25-Year Pre-Develo
8	Manual	11.22	10	30	22,158	100	---	----	----	100-Year Pre-Devel
10	Reservoir	7.28	10	50	33,198	2	1	77.31	18,759	Pond 1 - 2-Year St
11	Reservoir	11.71	10	40	44,340	10	2	77.44	19,971	Pond 1 - 10-year s
12	Reservoir	13.99	10	40	50,142	25	3	77.69	22,356	Pond 1 - 25-Year S
13	Reservoir	14.30	10	40	59,046	100	4	78.06	25,840	Pond 1- 100-Year S
Proj. file: ironboundpond.GPW			IDF file: Norfolk.IDF					Run date: 12-19-2001		

POST
INFLOW

PRE

Routed

Hydrograph Report

Page 1

English

Hyd. No. 1

2-Year Post-Developed

Hydrograph type = Manual

Storm frequency = 2 yrs

Peak discharge = 16.82 cfs

Time interval = 10 min

Total Volume = 33,198 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	3.53
0.33	5.05
0.50	16.82 <<
0.67	9.08
0.83	6.56
1.00	4.20
1.17	3.03
1.33	2.52
1.50	2.35
1.67	2.19

...End

Hydrograph Report

Page 1

English

Hyd. No. 2

10-Year Post-Developed

Hydrograph type = Manual

Storm frequency = 10 yrs

Peak discharge = 22.46 cfs

Time interval = 10 min

Total Volume = 44,340 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	4.72
0.33	6.74
0.50	22.46 <<
0.67	12.13
0.83	8.76
1.00	5.62
1.17	4.04
1.33	3.37
1.50	3.14
1.67	2.92

...End

Hydrograph Report

Page 1

English

Hyd. No. 3

25-Year Post-Developed

Hydrograph type = Manual

Storm frequency = 25 yrs

Peak discharge = 25.37 cfs

Time interval = 10 min

Total Volume = 50,142 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	5.33
0.33	7.61
0.50	25.37 <<
0.67	13.70
0.83	9.89
1.00	6.34
1.17	4.57
1.33	3.91
1.50	3.55
1.67	3.30

...End

Hydrograph Report

Page 1

English

Hyd. No. 4

100-Year Post-Developed

Hydrograph type = Manual

Storm frequency = 100 yrs

Peak discharge = 29.91 cfs

Time interval = 10 min

Total Volume = 59,046 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	6.28
0.33	8.97
0.50	29.91 <<
0.67	16.15
0.83	11.67
1.00	7.48
1.17	5.38
1.33	4.49
1.50	4.19
1.67	3.89

...End

Hydrograph Report

Page 1

English

Hyd. No. 5

2-Year Pre-Developed

Hydrograph type = Manual

Storm frequency = 2 yrs

Peak discharge = 6.31 cfs

Time interval = 10 min

Total Volume = 12,462 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	1.33
0.33	1.89
0.50	6.31 <<
0.67	3.41
0.83	2.46
1.00	1.58
1.17	1.14
1.33	0.95
1.50	0.88
1.67	0.82

...End

Hydrograph Report

Page 1

English

Hyd. No. 6

10-Year Pre-Developed

Hydrograph type = Manual

Storm frequency = 10 yrs

Peak discharge = 8.43 cfs

Time interval = 10 min

Total Volume = 16,644 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	1.77
0.33	2.53
0.50	8.43 <<
0.67	4.55
0.83	3.29
1.00	2.11
1.17	1.52
1.33	1.26
1.50	1.18
1.67	1.10

...End

Hydrograph Report

Page 1

English

Hyd. No. 7

25-Year Pre-Developed

Hydrograph type = Manual

Storm frequency = 25 yrs

Peak discharge = 9.52 cfs

Time interval = 10 min

Total Volume = 18,792 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	2.00
0.33	2.86
0.50	9.52 <<
0.67	5.14
0.83	3.71
1.00	2.38
1.17	1.71
1.33	1.43
1.50	1.33
1.67	1.24

...End

Hydrograph Report

Page 1

English

Hyd. No. 8

100-Year Pre-Developed

Hydrograph type = Manual

Storm frequency = 100 yrs

Peak discharge = 11.22 cfs

Time interval = 10 min

Total Volume = 22,158 cuft

Hydrograph Discharge Table

Time -- Outflow
(hrs cfs)

0.17	2.36
0.33	3.37
0.50	11.22 <<
0.67	6.06
0.83	4.38
1.00	2.81
1.17	2.02
1.33	1.68
1.50	1.57
1.67	1.46

...End

Hydrograph Report

Page 1

English

Hyd. No. 10

Pond 1 - 2-Year Storm

Hydrograph type = Reservoir
Storm frequency = 2 yrs
Inflow hyd. No. = 1
Max. Elevation = 77.31 ft

Peak discharge = 7.28 cfs
Time interval = 10 min
Reservoir name = BMP
Max. Storage = 18,759 cuft

Storage Indication method used.

Total Volume = 33,198 cuft

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
0.33	5.05	75.48	11.91	0.22	----	----	----	----	----	----	0.22
0.50	16.82 <<	76.30	12.72	0.45	----	----	----	----	----	----	0.45
0.67	9.08	77.12	13.48	0.59	----	----	1.58	----	----	----	2.17
0.83	6.56	77.31 <<	13.65	0.62	----	----	6.67	----	----	----	7.28 <<
1.00	4.20	77.25	13.60	0.61	----	----	4.83	----	----	----	5.44
1.17	3.03	77.19	13.54	0.60	----	----	3.15	----	----	----	3.75
1.33	2.52	77.15	13.51	0.59	----	----	2.36	----	----	----	2.95
1.50	2.35	77.13	13.49	0.59	----	----	1.94	----	----	----	2.53
1.67	2.19	77.12	13.48	0.59	----	----	1.73	----	----	----	2.32
1.83	0.00	77.07	13.44	0.58	----	----	0.88	----	----	----	1.46
2.00	0.00	77.01	13.38	0.57	----	----	0.08	----	----	----	0.65
2.17	0.00	76.96	13.34	0.56	----	----	----	----	----	----	0.56
2.33	0.00	76.92	13.30	0.56	----	----	----	----	----	----	0.56
2.50	0.00	76.88	13.27	0.55	----	----	----	----	----	----	0.55
2.67	0.00	76.85	13.23	0.54	----	----	----	----	----	----	0.54
2.83	0.00	76.81	13.19	0.54	----	----	----	----	----	----	0.54
3.00	0.00	76.77	13.16	0.53	----	----	----	----	----	----	0.53
3.17	0.00	76.73	13.12	0.53	----	----	----	----	----	----	0.53
3.33	0.00	76.69	13.09	0.52	----	----	----	----	----	----	0.52
3.50	0.00	76.66	13.06	0.51	----	----	----	----	----	----	0.51
3.67	0.00	76.62	13.02	0.51	----	----	----	----	----	----	0.51
3.83	0.00	76.58	12.99	0.50	----	----	----	----	----	----	0.50
4.00	0.00	76.55	12.96	0.49	----	----	----	----	----	----	0.49
4.17	0.00	76.51	12.92	0.49	----	----	----	----	----	----	0.49
4.33	0.00	76.48	12.89	0.48	----	----	----	----	----	----	0.48
4.50	0.00	76.45	12.86	0.47	----	----	----	----	----	----	0.47
4.67	0.00	76.41	12.83	0.47	----	----	----	----	----	----	0.47
4.83	0.00	76.38	12.79	0.46	----	----	----	----	----	----	0.46
5.00	0.00	76.35	12.76	0.46	----	----	----	----	----	----	0.46
5.17	0.00	76.31	12.73	0.45	----	----	----	----	----	----	0.45
5.33	0.00	76.28	12.70	0.44	----	----	----	----	----	----	0.44
5.50	0.00	76.25	12.67	0.44	----	----	----	----	----	----	0.44
5.67	0.00	76.22	12.64	0.43	----	----	----	----	----	----	0.43
5.83	0.00	76.19	12.61	0.42	----	----	----	----	----	----	0.42
6.00	0.00	76.16	12.58	0.42	----	----	----	----	----	----	0.42
6.17	0.00	76.13	12.56	0.41	----	----	----	----	----	----	0.41

Continues on next page...

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
6.33	0.00	76.10	12.53	0.41	----	----	----	----	----	----	0.41
6.50	0.00	76.07	12.50	0.40	----	----	----	----	----	----	0.40
6.67	0.00	76.04	12.47	0.39	----	----	----	----	----	----	0.39
6.83	0.00	76.01	12.44	0.39	----	----	----	----	----	----	0.39
7.00	0.00	75.98	12.42	0.38	----	----	----	----	----	----	0.38
7.17	0.00	75.95	12.39	0.37	----	----	----	----	----	----	0.37
7.33	0.00	75.92	12.36	0.37	----	----	----	----	----	----	0.37
7.50	0.00	75.89	12.33	0.36	----	----	----	----	----	----	0.36
7.67	0.00	75.87	12.30	0.35	----	----	----	----	----	----	0.35
7.83	0.00	75.84	12.27	0.34	----	----	----	----	----	----	0.34
8.00	0.00	75.81	12.24	0.34	----	----	----	----	----	----	0.34
8.17	0.00	75.78	12.22	0.33	----	----	----	----	----	----	0.33
8.33	0.00	75.76	12.19	0.32	----	----	----	----	----	----	0.32
8.50	0.00	75.73	12.17	0.32	----	----	----	----	----	----	0.32
8.67	0.00	75.71	12.14	0.31	----	----	----	----	----	----	0.31
8.83	0.00	75.68	12.12	0.30	----	----	----	----	----	----	0.30
9.00	0.00	75.66	12.09	0.29	----	----	----	----	----	----	0.29
9.17	0.00	75.63	12.07	0.29	----	----	----	----	----	----	0.29
9.33	0.00	75.61	12.04	0.28	----	----	----	----	----	----	0.28
9.50	0.00	75.59	12.02	0.27	----	----	----	----	----	----	0.27
9.67	0.00	75.57	12.00	0.26	----	----	----	----	----	----	0.26
9.83	0.00	75.55	11.98	0.25	----	----	----	----	----	----	0.25
10.00	0.00	75.53	11.96	0.24	----	----	----	----	----	----	0.24
10.17	0.00	75.51	11.94	0.23	----	----	----	----	----	----	0.23
10.33	0.00	75.49	11.92	0.22	----	----	----	----	----	----	0.22
10.50	0.00	75.47	11.90	0.21	----	----	----	----	----	----	0.21
10.67	0.00	75.45	11.89	0.19	----	----	----	----	----	----	0.19
10.83	0.00	75.44	11.87	0.18	----	----	----	----	----	----	0.18
11.00	0.00	75.42	11.86	0.17	----	----	----	----	----	----	0.17
11.17	0.00	75.41	11.84	0.16	----	----	----	----	----	----	0.16
11.33	0.00	75.40	11.83	0.15	----	----	----	----	----	----	0.15
11.50	0.00	75.39	11.82	0.14	----	----	----	----	----	----	0.14
11.67	0.00	75.38	11.81	0.13	----	----	----	----	----	----	0.13
11.83	0.00	75.37	11.80	0.12	----	----	----	----	----	----	0.12
12.00	0.00	75.36	11.79	0.11	----	----	----	----	----	----	0.11
12.17	0.00	75.35	11.78	0.10	----	----	----	----	----	----	0.10
12.33	0.00	75.34	11.77	0.09	----	----	----	----	----	----	0.09
12.50	0.00	75.33	11.76	0.09	----	----	----	----	----	----	0.09
12.67	0.00	75.33	11.76	0.08	----	----	----	----	----	----	0.08

...End

Reservoir Report

Page 1

Reservoir No. 1 - BMP

English

Pond Data

Pond storage is based on known contour areas

Stage / Storage Table

Stage ft	Elevation ft	Contour area sqft	Incr. Storage cuft	Total storage cuft
0.00	75.00 ✓	6,918 ✓	0	0
1.00	76.00 ✓	7,865 ✓	7,392	7,392
2.00	77.00 ✓	8,926 ✓	8,396	15,787
3.00	78.00 ✓	9,986 ✓	9,456	25,243
3.50	78.50 ✓	10,684 ✓	5,168	30,411
5.00	80.00 ✓	12,776 ✓	17,595	48,006 ✓

Culvert / Orifice Structures

	[A]	[B]	[C]	[D]
Rise in	= 15.0 ✓	4.0 ✓	0.0	0.0
Span in	= 15.0	4.0 ✓	0.0	0.0
No. Barrels	= 1	1	0	0
Invert El. ft	= 69.00 ✓	75.00 ✓	0.00	0.00
Length ft	= 100.0 ✓	1.0	0.0	0.0
Slope %	= 1.00 ✓	1.00	0.00	0.00
N-Value	= .013 ✓	.013	.000	.000
Orif. Coeff.	= 0.50 ✓	0.60 ✓	0.00	0.00
Multi-Stage	= ----	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len ft	= 12.56 ✓	8.00 ✓	0.00	0.00
Crest El. ft	= 77.00 ✓	78.50 ✓	0.00	0.00
Weir Coeff.	= 3.00 ✓	3.00 ✓	0.00	0.00
Eqn. Exp.	= 1.50 ✓	1.50 ✓	0.00	0.00
Multi-Stage	= Yes	Yes	No	No

Tailwater Elevation = 0.00 ft

Note: All outflows have been analyzed under inlet and outlet control.

Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Discharge cfs
0.00	0	75.00	11.41	0.00	---	---	0.00	0.00	---	---	0.00
1.00	7,392	76.00	12.43	0.38	---	---	0.00	0.00	---	---	0.38
2.00	15,787	77.00	13.37	0.57	---	---	0.00	0.00	---	---	0.57
3.00	25,243	78.00	14.25	0.00	---	---	37.68	0.00	---	---	14.25
3.50	30,411	78.50	14.67	0.00	---	---	69.22	0.00	---	---	14.67
5.00	48,006	80.00	15.86	0.00	---	---	195.79	44.09	---	---	15.86

Hydrograph Report

Page 1

English

Hyd. No. 11

Pond 1 - 10-year storm

Hydrograph type = Reservoir
Storm frequency = 10 yrs
Inflow hyd. No. = 2
Max. Elevation = 77.44 ft

Peak discharge = 11.71 cfs
Time interval = 10 min
Reservoir name = BMP
Max. Storage = 19,971 cuft

Storage Indication method used.

Total Volume = 44,340 cuft

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
0.33	6.74	75.64	12.08	0.29	----	----	----	----	----	----	0.29
0.50	22.46 <<	76.70	13.10	0.52	----	----	----	----	----	----	0.52
0.67	12.13	77.44 <<	13.77	0.63	----	----	11.14	----	----	----	11.71 <<
0.83	8.76	77.41	13.73	0.63	----	----	9.73	----	----	----	10.35
1.00	5.62	77.31	13.65	0.61	----	----	6.47	----	----	----	7.08
1.17	4.04	77.23	13.58	0.60	----	----	4.32	----	----	----	4.93
1.33	3.37	77.19	13.54	0.60	----	----	3.20	----	----	----	3.80
1.50	3.14	77.17	13.53	0.59	----	----	2.76	----	----	----	3.35
1.67	2.92	77.16	13.51	0.59	----	----	2.49	----	----	----	3.09
1.83	0.00	77.10	13.46	0.58	----	----	1.18	----	----	----	1.76
2.00	0.00	77.02	13.39	0.57	----	----	0.21	----	----	----	0.79
2.17	0.00	76.97	13.35	0.56	----	----	----	----	----	----	0.56
2.33	0.00	76.93	13.31	0.56	----	----	----	----	----	----	0.56
2.50	0.00	76.89	13.27	0.55	----	----	----	----	----	----	0.55
2.67	0.00	76.85	13.24	0.55	----	----	----	----	----	----	0.55
2.83	0.00	76.81	13.20	0.54	----	----	----	----	----	----	0.54
3.00	0.00	76.78	13.17	0.53	----	----	----	----	----	----	0.53
3.17	0.00	76.74	13.13	0.53	----	----	----	----	----	----	0.53
3.33	0.00	76.70	13.10	0.52	----	----	----	----	----	----	0.52
3.50	0.00	76.66	13.06	0.51	----	----	----	----	----	----	0.51
3.67	0.00	76.63	13.03	0.51	----	----	----	----	----	----	0.51
3.83	0.00	76.59	12.99	0.50	----	----	----	----	----	----	0.50
4.00	0.00	76.56	12.96	0.50	----	----	----	----	----	----	0.50
4.17	0.00	76.52	12.93	0.49	----	----	----	----	----	----	0.49
4.33	0.00	76.49	12.90	0.48	----	----	----	----	----	----	0.48
4.50	0.00	76.45	12.86	0.48	----	----	----	----	----	----	0.48
4.67	0.00	76.42	12.83	0.47	----	----	----	----	----	----	0.47
4.83	0.00	76.38	12.80	0.46	----	----	----	----	----	----	0.46
5.00	0.00	76.35	12.77	0.46	----	----	----	----	----	----	0.46
5.17	0.00	76.32	12.74	0.45	----	----	----	----	----	----	0.45
5.33	0.00	76.29	12.71	0.44	----	----	----	----	----	----	0.44
5.50	0.00	76.26	12.68	0.44	----	----	----	----	----	----	0.44
5.67	0.00	76.22	12.65	0.43	----	----	----	----	----	----	0.43
5.83	0.00	76.19	12.62	0.43	----	----	----	----	----	----	0.43
6.00	0.00	76.16	12.59	0.42	----	----	----	----	----	----	0.42
6.17	0.00	76.13	12.56	0.41	----	----	----	----	----	----	0.41

Continues on next page...

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
6.33	0.00	76.10	12.53	0.41	----	----	----	----	----	----	0.41
6.50	0.00	76.08	12.50	0.40	----	----	----	----	----	----	0.40
6.67	0.00	76.05	12.48	0.39	----	----	----	----	----	----	0.39
6.83	0.00	76.02	12.45	0.39	----	----	----	----	----	----	0.39
7.00	0.00	75.99	12.42	0.38	----	----	----	----	----	----	0.38
7.17	0.00	75.96	12.39	0.37	----	----	----	----	----	----	0.37
7.33	0.00	75.93	12.36	0.37	----	----	----	----	----	----	0.37
7.50	0.00	75.90	12.33	0.36	----	----	----	----	----	----	0.36
7.67	0.00	75.87	12.30	0.35	----	----	----	----	----	----	0.35
7.83	0.00	75.84	12.28	0.35	----	----	----	----	----	----	0.35
8.00	0.00	75.82	12.25	0.34	----	----	----	----	----	----	0.34
8.17	0.00	75.79	12.22	0.33	----	----	----	----	----	----	0.33
8.33	0.00	75.76	12.20	0.32	----	----	----	----	----	----	0.32
8.50	0.00	75.74	12.17	0.32	----	----	----	----	----	----	0.32
8.67	0.00	75.71	12.15	0.31	----	----	----	----	----	----	0.31
8.83	0.00	75.69	12.12	0.30	----	----	----	----	----	----	0.30
9.00	0.00	75.66	12.10	0.30	----	----	----	----	----	----	0.30
9.17	0.00	75.64	12.07	0.29	----	----	----	----	----	----	0.29
9.33	0.00	75.61	12.05	0.28	----	----	----	----	----	----	0.28
9.50	0.00	75.59	12.03	0.27	----	----	----	----	----	----	0.27
9.67	0.00	75.57	12.00	0.26	----	----	----	----	----	----	0.26
9.83	0.00	75.55	11.98	0.25	----	----	----	----	----	----	0.25
10.00	0.00	75.53	11.96	0.24	----	----	----	----	----	----	0.24
10.17	0.00	75.51	11.94	0.23	----	----	----	----	----	----	0.23
10.33	0.00	75.49	11.92	0.22	----	----	----	----	----	----	0.22
10.50	0.00	75.47	11.91	0.21	----	----	----	----	----	----	0.21
10.67	0.00	75.46	11.89	0.20	----	----	----	----	----	----	0.20
10.83	0.00	75.44	11.87	0.18	----	----	----	----	----	----	0.18
11.00	0.00	75.43	11.86	0.17	----	----	----	----	----	----	0.17
11.17	0.00	75.41	11.85	0.16	----	----	----	----	----	----	0.16
11.33	0.00	75.40	11.83	0.15	----	----	----	----	----	----	0.15
11.50	0.00	75.39	11.82	0.14	----	----	----	----	----	----	0.14
11.67	0.00	75.38	11.81	0.13	----	----	----	----	----	----	0.13
11.83	0.00	75.37	11.80	0.12	----	----	----	----	----	----	0.12

...End

Reservoir Report

Page 1

Reservoir No. 1 - BMP

English

Pond Data

Pond storage is based on known contour areas

Stage / Storage Table

Stage ft	Elevation ft	Contour area sqft	Incr. Storage cuft	Total storage cuft
0.00	75.00	6,918	0	0
1.00	76.00	7,865	7,392	7,392
2.00	77.00	8,926	8,396	15,787
3.00	78.00	9,986	9,456	25,243
3.50	78.50	10,684	5,168	30,411
5.00	80.00	12,776	17,595	48,006

Culvert / Orifice Structures

	[A]	[B]	[C]	[D]
Rise in	= 15.0	4.0	0.0	0.0
Span in	= 15.0	4.0	0.0	0.0
No. Barrels	= 1	1	0	0
Invert El. ft	= 69.00	75.00	0.00	0.00
Length ft	= 100.0	1.0	0.0	0.0
Slope %	= 1.00	1.00	0.00	0.00
N-Value	= .013	.013	.000	.000
Orif. Coeff.	= 0.50	0.60	0.00	0.00
Multi-Stage	= ----	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len ft	= 12.56	8.00	0.00	0.00
Crest El. ft	= 77.00	78.50	0.00	0.00
Weir Coeff.	= 3.00	3.00	0.00	0.00
Eqn. Exp.	= 1.50	1.50	0.00	0.00
Multi-Stage	= Yes	Yes	No	No

Tailwater Elevation = 0.00 ft

Note: All outflows have been analyzed under inlet and outlet control.

Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Discharge cfs
0.00	0	75.00	11.41	0.00	---	---	0.00	0.00	---	---	0.00
1.00	7,392	76.00	12.43	0.38	---	---	0.00	0.00	---	---	0.38
2.00	15,787	77.00	13.37	0.57	---	---	0.00	0.00	---	---	0.57
3.00	25,243	78.00	14.25	0.00	---	---	37.68	0.00	---	---	14.25
3.50	30,411	78.50	14.67	0.00	---	---	69.22	0.00	---	---	14.67
5.00	48,006	80.00	15.86	0.00	---	---	195.79	44.09	---	---	15.86

Hydrograph Report

Page 1

English

Hyd. No. 12

Pond 1 - 25-Year Storm

Hydrograph type = Reservoir
Storm frequency = 25 yrs
Inflow hyd. No. = 3
Max. Elevation = 77.69 ft

Peak discharge = 13.99 cfs
Time interval = 10 min
Reservoir name = BMP
Max. Storage = 22,356 cuft

Storage Indication method used.

Total Volume = 50,142 cuft

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
0.33	7.61	75.73	12.16	0.31	----	----	----	----	----	----	0.31
0.50	25.37 <<	76.91	13.29	0.55	----	----	----	----	----	----	0.55
0.67	13.70	77.69 <<	13.99	----	----	----	21.83	----	----	----	13.99 <<
0.83	9.89	77.56	13.87	0.26	----	----	15.81	----	----	----	13.87
1.00	6.34	77.36	13.69	0.62	----	----	8.11	----	----	----	8.73
1.17	4.57	77.25	13.60	0.61	----	----	4.86	----	----	----	5.47
1.33	3.91	77.21	13.56	0.60	----	----	3.70	----	----	----	4.31
1.50	3.55	77.19	13.54	0.60	----	----	3.19	----	----	----	3.79
1.67	3.30	77.18	13.53	0.60	----	----	2.89	----	----	----	3.49
1.83	0.00	77.11	13.47	0.59	----	----	1.39	----	----	----	1.98
2.00	0.00	77.02	13.39	0.57	----	----	0.25	----	----	----	0.82
2.17	0.00	76.97	13.35	0.56	----	----	----	----	----	----	0.56
2.33	0.00	76.93	13.31	0.56	----	----	----	----	----	----	0.56
2.50	0.00	76.89	13.27	0.55	----	----	----	----	----	----	0.55
2.67	0.00	76.85	13.24	0.55	----	----	----	----	----	----	0.55
2.83	0.00	76.82	13.20	0.54	----	----	----	----	----	----	0.54
3.00	0.00	76.78	13.17	0.53	----	----	----	----	----	----	0.53
3.17	0.00	76.74	13.13	0.53	----	----	----	----	----	----	0.53
3.33	0.00	76.70	13.10	0.52	----	----	----	----	----	----	0.52
3.50	0.00	76.67	13.06	0.51	----	----	----	----	----	----	0.51
3.67	0.00	76.63	13.03	0.51	----	----	----	----	----	----	0.51
3.83	0.00	76.59	13.00	0.50	----	----	----	----	----	----	0.50
4.00	0.00	76.56	12.96	0.50	----	----	----	----	----	----	0.50
4.17	0.00	76.52	12.93	0.49	----	----	----	----	----	----	0.49
4.33	0.00	76.49	12.90	0.48	----	----	----	----	----	----	0.48
4.50	0.00	76.45	12.87	0.48	----	----	----	----	----	----	0.48
4.67	0.00	76.42	12.83	0.47	----	----	----	----	----	----	0.47
4.83	0.00	76.39	12.80	0.46	----	----	----	----	----	----	0.46
5.00	0.00	76.35	12.77	0.46	----	----	----	----	----	----	0.46
5.17	0.00	76.32	12.74	0.45	----	----	----	----	----	----	0.45
5.33	0.00	76.29	12.71	0.44	----	----	----	----	----	----	0.44
5.50	0.00	76.26	12.68	0.44	----	----	----	----	----	----	0.44
5.67	0.00	76.23	12.65	0.43	----	----	----	----	----	----	0.43
5.83	0.00	76.19	12.62	0.43	----	----	----	----	----	----	0.43
6.00	0.00	76.16	12.59	0.42	----	----	----	----	----	----	0.42
6.17	0.00	76.13	12.56	0.41	----	----	----	----	----	----	0.41

Continues on next page...

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
6.33	0.00	76.11	12.53	0.41	----	----	----	----	----	----	0.41
6.50	0.00	76.08	12.51	0.40	----	----	----	----	----	----	0.40
6.67	0.00	76.05	12.48	0.39	----	----	----	----	----	----	0.39
6.83	0.00	76.02	12.45	0.39	----	----	----	----	----	----	0.39
7.00	0.00	75.99	12.42	0.38	----	----	----	----	----	----	0.38
7.17	0.00	75.96	12.39	0.37	----	----	----	----	----	----	0.37
7.33	0.00	75.93	12.36	0.37	----	----	----	----	----	----	0.37
7.50	0.00	75.90	12.33	0.36	----	----	----	----	----	----	0.36
7.67	0.00	75.87	12.31	0.35	----	----	----	----	----	----	0.35
7.83	0.00	75.84	12.28	0.35	----	----	----	----	----	----	0.35
8.00	0.00	75.82	12.25	0.34	----	----	----	----	----	----	0.34
8.17	0.00	75.79	12.22	0.33	----	----	----	----	----	----	0.33
8.33	0.00	75.76	12.20	0.32	----	----	----	----	----	----	0.32
8.50	0.00	75.74	12.17	0.32	----	----	----	----	----	----	0.32
8.67	0.00	75.71	12.15	0.31	----	----	----	----	----	----	0.31
8.83	0.00	75.69	12.12	0.30	----	----	----	----	----	----	0.30
9.00	0.00	75.66	12.10	0.30	----	----	----	----	----	----	0.30
9.17	0.00	75.64	12.07	0.29	----	----	----	----	----	----	0.29
9.33	0.00	75.62	12.05	0.28	----	----	----	----	----	----	0.28
9.50	0.00	75.59	12.03	0.27	----	----	----	----	----	----	0.27
9.67	0.00	75.57	12.01	0.26	----	----	----	----	----	----	0.26
9.83	0.00	75.55	11.98	0.25	----	----	----	----	----	----	0.25
10.00	0.00	75.53	11.96	0.24	----	----	----	----	----	----	0.24
10.17	0.00	75.51	11.94	0.24	----	----	----	----	----	----	0.24
10.33	0.00	75.49	11.93	0.22	----	----	----	----	----	----	0.22
10.50	0.00	75.47	11.91	0.21	----	----	----	----	----	----	0.21
10.67	0.00	75.46	11.89	0.20	----	----	----	----	----	----	0.20
10.83	0.00	75.44	11.87	0.18	----	----	----	----	----	----	0.18
11.00	0.00	75.43	11.86	0.17	----	----	----	----	----	----	0.17
11.17	0.00	75.41	11.85	0.16	----	----	----	----	----	----	0.16
11.33	0.00	75.40	11.83	0.15	----	----	----	----	----	----	0.15
11.50	0.00	75.39	11.82	0.14	----	----	----	----	----	----	0.14

...End

Reservoir Report

Page 1

Reservoir No. 1 - BMP

English

Pond Data

Pond storage is based on known contour areas

Stage / Storage Table

Stage ft	Elevation ft	Contour area sqft	Incr. Storage cuft	Total storage cuft
0.00	75.00	6,918	0	0
1.00	76.00	7,865	7,392	7,392
2.00	77.00	8,926	8,396	15,787
3.00	78.00	9,986	9,456	25,243
3.50	78.50	10,684	5,168	30,411
5.00	80.00	12,776	17,595	48,006

Culvert / Orifice Structures

	[A]	[B]	[C]	[D]
Rise in	= 15.0	4.0	0.0	0.0
Span in	= 15.0	4.0	0.0	0.0
No. Barrels	= 1	1	0	0
Invert El. ft	= 69.00	75.00	0.00	0.00
Length ft	= 100.0	1.0	0.0	0.0
Slope %	= 1.00	1.00	0.00	0.00
N-Value	= .013	.013	.000	.000
Orif. Coeff.	= 0.50	0.60	0.00	0.00
Multi-Stage	= ----	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len ft	= 12.56	8.00	0.00	0.00
Crest El. ft	= 77.00	78.50	0.00	0.00
Weir Coeff.	= 3.00	3.00	0.00	0.00
Eqn. Exp.	= 1.50	1.50	0.00	0.00
Multi-Stage	= Yes	Yes	No	No

Tailwater Elevation = 0.00 ft

Note: All outflows have been analyzed under inlet and outlet control.

Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Discharge cfs
0.00	0	75.00	11.41	0.00	---	---	0.00	0.00	---	---	0.00
1.00	7,392	76.00	12.43	0.38	---	---	0.00	0.00	---	---	0.38
2.00	15,787	77.00	13.37	0.57	---	---	0.00	0.00	---	---	0.57
3.00	25,243	78.00	14.25	0.00	---	---	37.68	0.00	---	---	14.25
3.50	30,411	78.50	14.67	0.00	---	---	69.22	0.00	---	---	14.67
5.00	48,006	80.00	15.86	0.00	---	---	195.79	44.09	---	---	15.86

Hydrograph Report

Page 1

English

Hyd. No. 13

Pond 1- 100-Year Storm

Hydrograph type = Reservoir
Storm frequency = 100 yrs
Inflow hyd. No. = 4
Max. Elevation = 78.06 ft

Peak discharge = 14.30 cfs
Time interval = 10 min
Reservoir name = BMP
Max. Storage = 25,840 cuft

Storage Indication method used.

Total Volume = 59,046 cuft

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
0.33	8.97	75.86	12.29	0.35	----	----	----	----	----	----	0.35
0.50	29.91 <<	77.14	13.50	0.59	----	----	2.04	----	----	----	2.63
0.67	16.15	78.06 <<	14.30	----	----	----	41.00	----	----	----	14.30 <<
0.83	11.67	78.04	14.28	----	----	----	39.73	----	----	----	14.28
1.00	7.48	77.75	14.03	----	----	----	24.44	----	----	----	14.03
1.17	5.38	77.39	13.72	0.63	----	----	9.35	----	----	----	9.98
1.33	4.49	77.23	13.58	0.60	----	----	4.34	----	----	----	4.94
1.50	4.19	77.21	13.56	0.60	----	----	3.77	----	----	----	4.37
1.67	3.89	77.20	13.55	0.60	----	----	3.46	----	----	----	4.06
1.83	0.00	77.12	13.48	0.59	----	----	1.72	----	----	----	2.31
2.00	0.00	77.02	13.39	0.57	----	----	0.28	----	----	----	0.86
2.17	0.00	76.98	13.35	0.57	----	----	----	----	----	----	0.57
2.33	0.00	76.94	13.31	0.56	----	----	----	----	----	----	0.56
2.50	0.00	76.90	13.28	0.55	----	----	----	----	----	----	0.55
2.67	0.00	76.86	13.24	0.55	----	----	----	----	----	----	0.55
2.83	0.00	76.82	13.20	0.54	----	----	----	----	----	----	0.54
3.00	0.00	76.78	13.17	0.53	----	----	----	----	----	----	0.53
3.17	0.00	76.74	13.13	0.53	----	----	----	----	----	----	0.53
3.33	0.00	76.70	13.10	0.52	----	----	----	----	----	----	0.52
3.50	0.00	76.67	13.07	0.51	----	----	----	----	----	----	0.51
3.67	0.00	76.63	13.03	0.51	----	----	----	----	----	----	0.51
3.83	0.00	76.59	13.00	0.50	----	----	----	----	----	----	0.50
4.00	0.00	76.56	12.96	0.50	----	----	----	----	----	----	0.50
4.17	0.00	76.52	12.93	0.49	----	----	----	----	----	----	0.49
4.33	0.00	76.49	12.90	0.48	----	----	----	----	----	----	0.48
4.50	0.00	76.45	12.87	0.48	----	----	----	----	----	----	0.48
4.67	0.00	76.42	12.83	0.47	----	----	----	----	----	----	0.47
4.83	0.00	76.39	12.80	0.46	----	----	----	----	----	----	0.46
5.00	0.00	76.35	12.77	0.46	----	----	----	----	----	----	0.46
5.17	0.00	76.32	12.74	0.45	----	----	----	----	----	----	0.45
5.33	0.00	76.29	12.71	0.45	----	----	----	----	----	----	0.45
5.50	0.00	76.26	12.68	0.44	----	----	----	----	----	----	0.44
5.67	0.00	76.23	12.65	0.43	----	----	----	----	----	----	0.43
5.83	0.00	76.20	12.62	0.43	----	----	----	----	----	----	0.43
6.00	0.00	76.17	12.59	0.42	----	----	----	----	----	----	0.42
6.17	0.00	76.14	12.56	0.41	----	----	----	----	----	----	0.41

Continues on next page...

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
6.33	0.00	76.11	12.54	0.41	----	----	----	----	----	----	0.41
6.50	0.00	76.08	12.51	0.40	----	----	----	----	----	----	0.40
6.67	0.00	76.05	12.48	0.39	----	----	----	----	----	----	0.39
6.83	0.00	76.02	12.45	0.39	----	----	----	----	----	----	0.39
7.00	0.00	75.99	12.42	0.38	----	----	----	----	----	----	0.38
7.17	0.00	75.96	12.39	0.37	----	----	----	----	----	----	0.37
7.33	0.00	75.93	12.37	0.37	----	----	----	----	----	----	0.37
7.50	0.00	75.90	12.34	0.36	----	----	----	----	----	----	0.36
7.67	0.00	75.87	12.31	0.35	----	----	----	----	----	----	0.35
7.83	0.00	75.85	12.28	0.35	----	----	----	----	----	----	0.35
8.00	0.00	75.82	12.25	0.34	----	----	----	----	----	----	0.34
8.17	0.00	75.79	12.23	0.33	----	----	----	----	----	----	0.33
8.33	0.00	75.76	12.20	0.32	----	----	----	----	----	----	0.32
8.50	0.00	75.74	12.17	0.32	----	----	----	----	----	----	0.32
8.67	0.00	75.71	12.15	0.31	----	----	----	----	----	----	0.31
8.83	0.00	75.69	12.12	0.30	----	----	----	----	----	----	0.30
9.00	0.00	75.66	12.10	0.30	----	----	----	----	----	----	0.30
9.17	0.00	75.64	12.07	0.29	----	----	----	----	----	----	0.29
9.33	0.00	75.62	12.05	0.28	----	----	----	----	----	----	0.28
9.50	0.00	75.59	12.03	0.27	----	----	----	----	----	----	0.27
9.67	0.00	75.57	12.01	0.26	----	----	----	----	----	----	0.26
9.83	0.00	75.55	11.99	0.25	----	----	----	----	----	----	0.25
10.00	0.00	75.53	11.97	0.24	----	----	----	----	----	----	0.24
10.17	0.00	75.51	11.95	0.24	----	----	----	----	----	----	0.24
10.33	0.00	75.49	11.93	0.22	----	----	----	----	----	----	0.22
10.50	0.00	75.48	11.91	0.21	----	----	----	----	----	----	0.21
10.67	0.00	75.46	11.89	0.20	----	----	----	----	----	----	0.20
10.83	0.00	75.44	11.88	0.19	----	----	----	----	----	----	0.19
11.00	0.00	75.43	11.86	0.17	----	----	----	----	----	----	0.17
11.17	0.00	75.41	11.85	0.16	----	----	----	----	----	----	0.16
11.33	0.00	75.40	11.83	0.15	----	----	----	----	----	----	0.15

...End

Reservoir Report

Page 1

Reservoir No. 1 - BMP

English

Pond Data

Pond storage is based on known contour areas

Stage / Storage Table

Stage ft	Elevation ft	Contour area sqft	Incr. Storage cuft	Total storage cuft
0.00	75.00	6,918	0	0
1.00	76.00	7,865	7,392	7,392
2.00	77.00	8,926	8,396	15,787
3.00	78.00	9,986	9,456	25,243
3.50	78.50	10,684	5,168	30,411
5.00	80.00	12,776	17,595	48,006

Culvert / Orifice Structures

	[A]	[B]	[C]	[D]
Rise in	= 15.0	4.0	0.0	0.0
Span in	= 15.0	4.0	0.0	0.0
No. Barrels	= 1	1	0	0
Invert El. ft	= 69.00	75.00	0.00	0.00
Length ft	= 100.0	1.0	0.0	0.0
Slope %	= 1.00	1.00	0.00	0.00
N-Value	= .013	.013	.000	.000
Orif. Coeff.	= 0.50	0.60	0.00	0.00
Multi-Stage	= ----	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len ft	= 12.56	8.00	0.00	0.00
Crest El. ft	= 77.00	78.50	0.00	0.00
Weir Coeff.	= 3.00	3.00	0.00	0.00
Eqn. Exp.	= 1.50	1.50	0.00	0.00
Multi-Stage	= Yes	Yes	No	No

Tailwater Elevation = 0.00 ft

Note: All outflows have been analyzed under inlet and outlet control.

Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Discharge cfs
0.00	0	75.00	11.41	0.00	---	---	0.00	0.00	---	---	0.00
1.00	7,392	76.00	12.43	0.38	---	---	0.00	0.00	---	---	0.38
2.00	15,787	77.00	13.37	0.57	---	---	0.00	0.00	---	---	0.57
3.00	25,243	78.00	14.25	0.00	---	---	37.68	0.00	---	---	14.25
3.50	30,411	78.50	14.67	0.00	---	---	69.22	0.00	---	---	14.67
5.00	48,006	80.00	15.86	0.00	---	---	195.79	44.09	---	---	15.86

AES CALCULATIONS

STREAM CHANNEL PROTECTION CALCULATIONS
for
Ironbound Village
AES Project No.: 8914-1

PROPOSED POND VOLUME

Eleva	Depth	Area (sq. ft.)	Incremental Volume (cu. ft.)	Sum Volume (cu. ft.)	Sum Volume (cu. yd.)	Volume Above NPE
70.0	0.0	1,094	0	0	0	
72.0	2.0	2,396	3,490	3,490	129	
73.7	1.7	4,303	5,694	9,184	340	
74.0	0.3	5,971	1,541	10,725	397	
75.0	1.0	6,918	6,445	17,170	636	0
76.0	1.0	7,865	7,392	24,561	910	7,391
77.0	1.0	8,926	8,395	32,957	1,221	15,787
78.0	1.0	9,986	9,456	42,412	1,571	25,242
78.5	0.5	10,684	5,168	47,580	1,762	30,410
80.0	1.5	12,776	17,595	65,175	2,414	48,005

RELEASE RATE REQUIRED TO DETAINED VOLUME FOR 24 HOURS

Required Volume based upon 1-Year, 24-Hour Storm Hydrograph =

15,028 cubic feet ✓

*MODERATIONAL
CRITICAL
STORM OVR.*

Volume provided based upon above table =

15,787 cubic feet

Elevation of water surface associated with provided volume =

77.0

Elevation of Low Flow Orifice =

75.0

Average Head, in feet =

1.0

Average Release Rate Calculation

$$\frac{15,787 \text{ cubic feet}}{(24 \text{ hours} \times 60 \text{ minutes/hour} \times 60 \text{ seconds/minute})} =$$

0.2 cfs

LOW FLOW ORIFICE DIAMETER REQUIRED TO MAINTAIN AVERAGE RELEASE RATE

$$\text{Diameter of Low Flow Orifice} = 2 * (Q / ((64.32 * (h / 2)) ^ (1/2) * 0.6 * 3.14))) ^ (1/2)$$

where, Q equals average release rate (cfs), h equals average head (feet)

Diameter of Low Flow Orifice =

0.30

feet, or

4 inches

*CALEB Hurst /
CJ BOONAR
LAND MAREIC*

Type.... Mod. Rational Hyg
 Name.... DRAINAGE AREA Tag: Dev..1
 File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\
 Storm... e, b, d Tag: Dev..1

Page 5.01
 Event: 1 yr

MODIFIED RATIONAL METHOD HYDROGRAPH ✓

$Q = CiA * \text{Units Conversion; Where Conversion} = 43560 / (12 * 3600)$

Tag	Freq	File	IDF Curve
Dev..1	1	JCC.IDQ	e = .9050 b = 63.0330 d = 12.2000

Td = .5333 hrs

Tag	Freq (years)	C	C adj factor	C final	I in/hr	Area acres	Peak Q cfs
Dev..1	1	.550	1.000	.550	2.0439	6.900	7.82

HYG file = S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\IBV-MR.HYG
 HYG ID = DRAINAGE AREA
 HYG Tag = Dev..1

Peak Discharge = 7.82 cfs
 Time to Peak = .1700 hrs
 HYG Volume = .345 ac-ft

* *

* * = 15,028 CF ✓

HYDROGRAPH ORDINATES (cfs)

Time hrs	Output Time increment = .0100 hrs Time on left represents time for first value in each row.				
.0000	.00	.46	.92	1.38	1.84
.0500	2.30	2.76	3.22	3.68	4.14
.1000	4.60	5.06	5.52	5.98	6.44
.1500	6.90	7.36	7.82	7.82	7.82
.2000	7.82	7.82	7.82	7.82	7.82
.2500	7.82	7.82	7.82	7.82	7.82
.3000	7.82	7.82	7.82	7.82	7.82
.3500	7.82	7.82	7.82	7.82	7.82
.4000	7.82	7.82	7.82	7.82	7.82
.4500	7.82	7.82	7.82	7.82	7.82
.5000	7.82	7.82	7.82	7.82	7.51
.5500	7.05	6.59	6.13	5.67	5.21
.6000	4.75	4.29	3.83	3.37	2.91

Name.... Watershed

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

MASTER DESIGN STORM SUMMARY

Default Network Design Storm File, ID JCC.IDQ

jcc

$$i = b / ((T + d)**e)$$

Where: i = rainfall intensity (in/hr)

T = rainfall duration (min)

e, b, d = rainfall equation coefficients

Return Event	Rainfall Type	e coeff	b coeff	d coeff
Dev..1	I-D-F from e, b, d coeff.	.9050	63.0330	12.2000
Dev..2	I-D-F from e, b, d coeff.	.9070	79.8580	14.0000
Dev.10	I-D-F from e, b, d coeff.	.9430	143.7170	19.2000
Dev.25	I-D-F from e, b, d coeff.	.9420	172.1050	21.2000
Dev100	I-D-F from e, b, d coeff.	.9860	273.9490	26.3000

MASTER NETWORK SUMMARY
Modified Rational Method Network

(*Node=Outfall; +Node=Diversion;)
(Trun= HYG Truncation: Blank=None; L=Left; R=Rt; LR=Left&Rt)

Storage Node ID	Return Type Event	HYG Vol ac-ft	Trun	Qpeak hrs	Qpeak cfs	Max WSEL ft	Max Pond ac-ft
DRAINAGE AREA	AREA 1	.345		.1700	7.82		
DRAINAGE AREA	AREA 2	.432		.1700	8.96		
DRAINAGE AREA	AREA 10	.646		.1700	11.72		
DRAINAGE AREA	AREA 25	.773		.1700	13.06		
DRAINAGE AREA	AREA 100	.983		.1700	15.19		
*OUTFALL	JCT 1	.340		.6700	.53		
*OUTFALL	JCT 2	.425		.6900	3.14		
*OUTFALL	JCT 10	.639		.7000	9.60		
*OUTFALL	JCT 25	.766		.7400	11.23		
*OUTFALL	JCT 100	.976		.8000	13.21		
POND	IN POND 1	.345		.1700	7.82		
POND	IN POND 2	.432		.1700	8.96		

MASTER NETWORK SUMMARY
 Modified Rational Method Network

(*Node=Outfall; +Node=Diversion;)
 (Trun= HYG Truncation: Blank=None; L=Left; R=Rt; LR=Left&Rt)

Storage Node ID	Return		HYG Vol		Qpeak		Max WSEL	Max Pond
	Type	Event	ac-ft	Trun	hrs	cfs	ft	ac-ft
POND	IN	POND	10		.1700	11.72		
POND	IN	POND	25		.1700	13.06		
POND	IN	POND	100		.1700	15.19		
POND	OUT	POND	1		.6700	.53	76.82	.716
POND	OUT	POND	2		.6900	3.14	77.13	.780
POND	OUT	POND	10		.7000	9.60	77.45	.847
POND	OUT	POND	25		.7400	11.23	77.57	.874
POND	OUT	POND	100		.8000	13.21	77.80	.925

Q_{out} *ELEV.*

DHW

Type.... Outlet Input Data
Name.... OUTLET

Page 1.01

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

REQUESTED POND WS ELEVATIONS:

Min. Elev.= 70.00 ft
Increment = .50 ft
Max. Elev.= 80.00 ft

OUTLET CONNECTIVITY

---> Forward Flow Only (UpStream to DnStream)
<--- Reverse Flow Only (DnStream to UpStream)
<---> Forward and Reverse Both Allowed

Structure	No.		Outfall	E1, ft	E2, ft
Weir-Rectangular	SW	--->	TW	78.500	80.000
Stand Pipe	SP	--->	CV	77.000	80.000
Orifice-Circular	OR	--->	CV	75.000	80.000
Culvert-Circular	CV	--->	TW	69.000	80.000
TW SETUP, DS Channel					

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

OUTLET STRUCTURE INPUT DATA

Structure ID = SW
Structure Type = Weir-Rectangular

of Openings = 1
Crest Elev. = 78.50 ft
Weir Length = 8.00 ft
Weir Coeff. = 3.000000

Weir TW effects (Use adjustment equation)

Structure ID = SP
Structure Type = Stand Pipe

of Openings = 1
Invert Elev. = 77.00 ft
Diameter = 3.0000 ft
Orifice Area = 7.0686 sq.ft
Orifice Coeff. = .600
Weir Length = 9.42 ft
Weir Coeff. = 3.000
K, Submerged = .000
K, Reverse = 1.000
Kb, Barrel = .000000 (per ft of full flow)
Barrel Length = .00 ft
Mannings n = .0000

Structure ID = OR
Structure Type = Orifice-Circular

of Openings = 1
Invert Elev. = 75.00 ft
Diameter = .3300 ft
Orifice Coeff. = .600

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

OUTLET STRUCTURE INPUT DATA

Structure ID = CV
Structure Type = Culvert-Circular

No. Barrels = 1
Barrel Diameter = 1.2500 ft
Upstream Invert = 69.00 ft
Dnstream Invert = 68.00 ft
Horiz. Length = 100.00 ft
Barrel Length = 100.01 ft
Barrel Slope = .01000 ft/ft

OUTLET CONTROL DATA...

Mannings n = .0130
Ke = .5000 (forward entrance loss)
Kb = .023225 (per ft of full flow)
Kr = .5000 (reverse entrance loss)
HW Convergence = .001 +/- ft

INLET CONTROL DATA...

Equation form = 1
Inlet Control K = .0078
Inlet Control M = 2.0000
Inlet Control c = .02920
Inlet Control Y = .7400
T1 ratio (HW/D) = 1.131
T2 ratio (HW/D) = 1.202
Slope Factor = -.500

Use unsubmerged inlet control Form 1 equ. below T1 elev.
Use submerged inlet control Form 1 equ. above T2 elev.

In transition zone between unsubmerged and submerged inlet control,
interpolate between flows at T1 & T2...

At T1 Elev = 70.41 ft ---> Flow = 4.80 cfs
At T2 Elev = 70.50 ft ---> Flow = 5.49 cfs

Structure ID = TW
Structure Type = TW SETUP, DS Channel

FREE OUTFALL CONDITIONS SPECIFIED

CONVERGENCE TOLERANCES...

Maximum Iterations= 30
Min. TW tolerance = .01 ft
Max. TW tolerance = .01 ft
Min. HW tolerance = .01 ft
Max. HW tolerance = .01 ft
Min. Q tolerance = .10 cfs
Max. Q tolerance = .10 cfs

Type.... Composite Rating Curve
Name.... OUTLET

Page 1.04

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

***** COMPOSITE OUTFLOW SUMMARY *****

WS Elev, Total Q		Converge		Notes
Elev. ft	Q cfs	TW Elev ft	Error +/-ft	Contributing Structures
70.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
70.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
71.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
71.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
72.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
72.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
73.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
73.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
74.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
74.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
75.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
75.50	.24	Free Outfall		OR,CV (no Q: SW,SP)
76.00	.38	Free Outfall		OR,CV (no Q: SW,SP)
76.50	.48	Free Outfall		OR,CV (no Q: SW,SP)
77.00	.56	Free Outfall		OR,CV (no Q: SW,SP)
77.50	10.63	Free Outfall		SP,OR,CV (no Q: SW)
78.00	14.90	Free Outfall		SP,CV (no Q: SW,OR)
78.50	15.32	Free Outfall		SP,CV (no Q: SW,OR)
79.00	24.21	Free Outfall		SW,SP,CV (no Q: OR)
79.50	40.12	Free Outfall		SW,SP,CV (no Q: OR)
80.00	60.60	Free Outfall		SW,SP,CV (no Q: OR)

S/N: C21602B06A81

PondPack Ver 7.5 (767) Compute Time: 17:26:18 Date: 10/04/2001

CC022_IRONBOUND_VILLAGE_IRONBOUND_ROAD-1546.mxd

WORKSHEET FOR BMP POINT SYSTEM

TOTAL SITE AREA = 7.75 AC.

A. STRUCTURAL BMP POINT ALLOCATION

<u>BMP</u>	<u>BMP Points</u>	<u>Fraction of Site Served</u>	<u>Weighted BMP Points</u>
Wet Pond (E.D.)	10 ✓	$x (6.30 + 0.59) \div 7.75 =$	<u>8.89</u>
TOTAL WEIGHTED STRUCTURAL BMP POINTS:			8.89

B. NATURAL OPEN SPACE CREDIT

<u>Adjacent To Wetland</u>	<u>Natural Open Space Credit</u>	<u>Fraction of Site</u>	<u>Points for Natural Open Space</u>
No	10	$x 0.94 \div 7.75$	$= 1.21$


C. TOTAL WEIGHTED POINTS



<u>Structural BMP Points</u>		<u>Natural Open Space Points</u>	<u>Total</u>
8.89	+	1.21	$= 10.10$ ✓

NOTES:

- 1) Natural open space has been placed in a conservation easement.

JOBS\8914\01-IBV\Design\Pond\bmp-pnts.doc

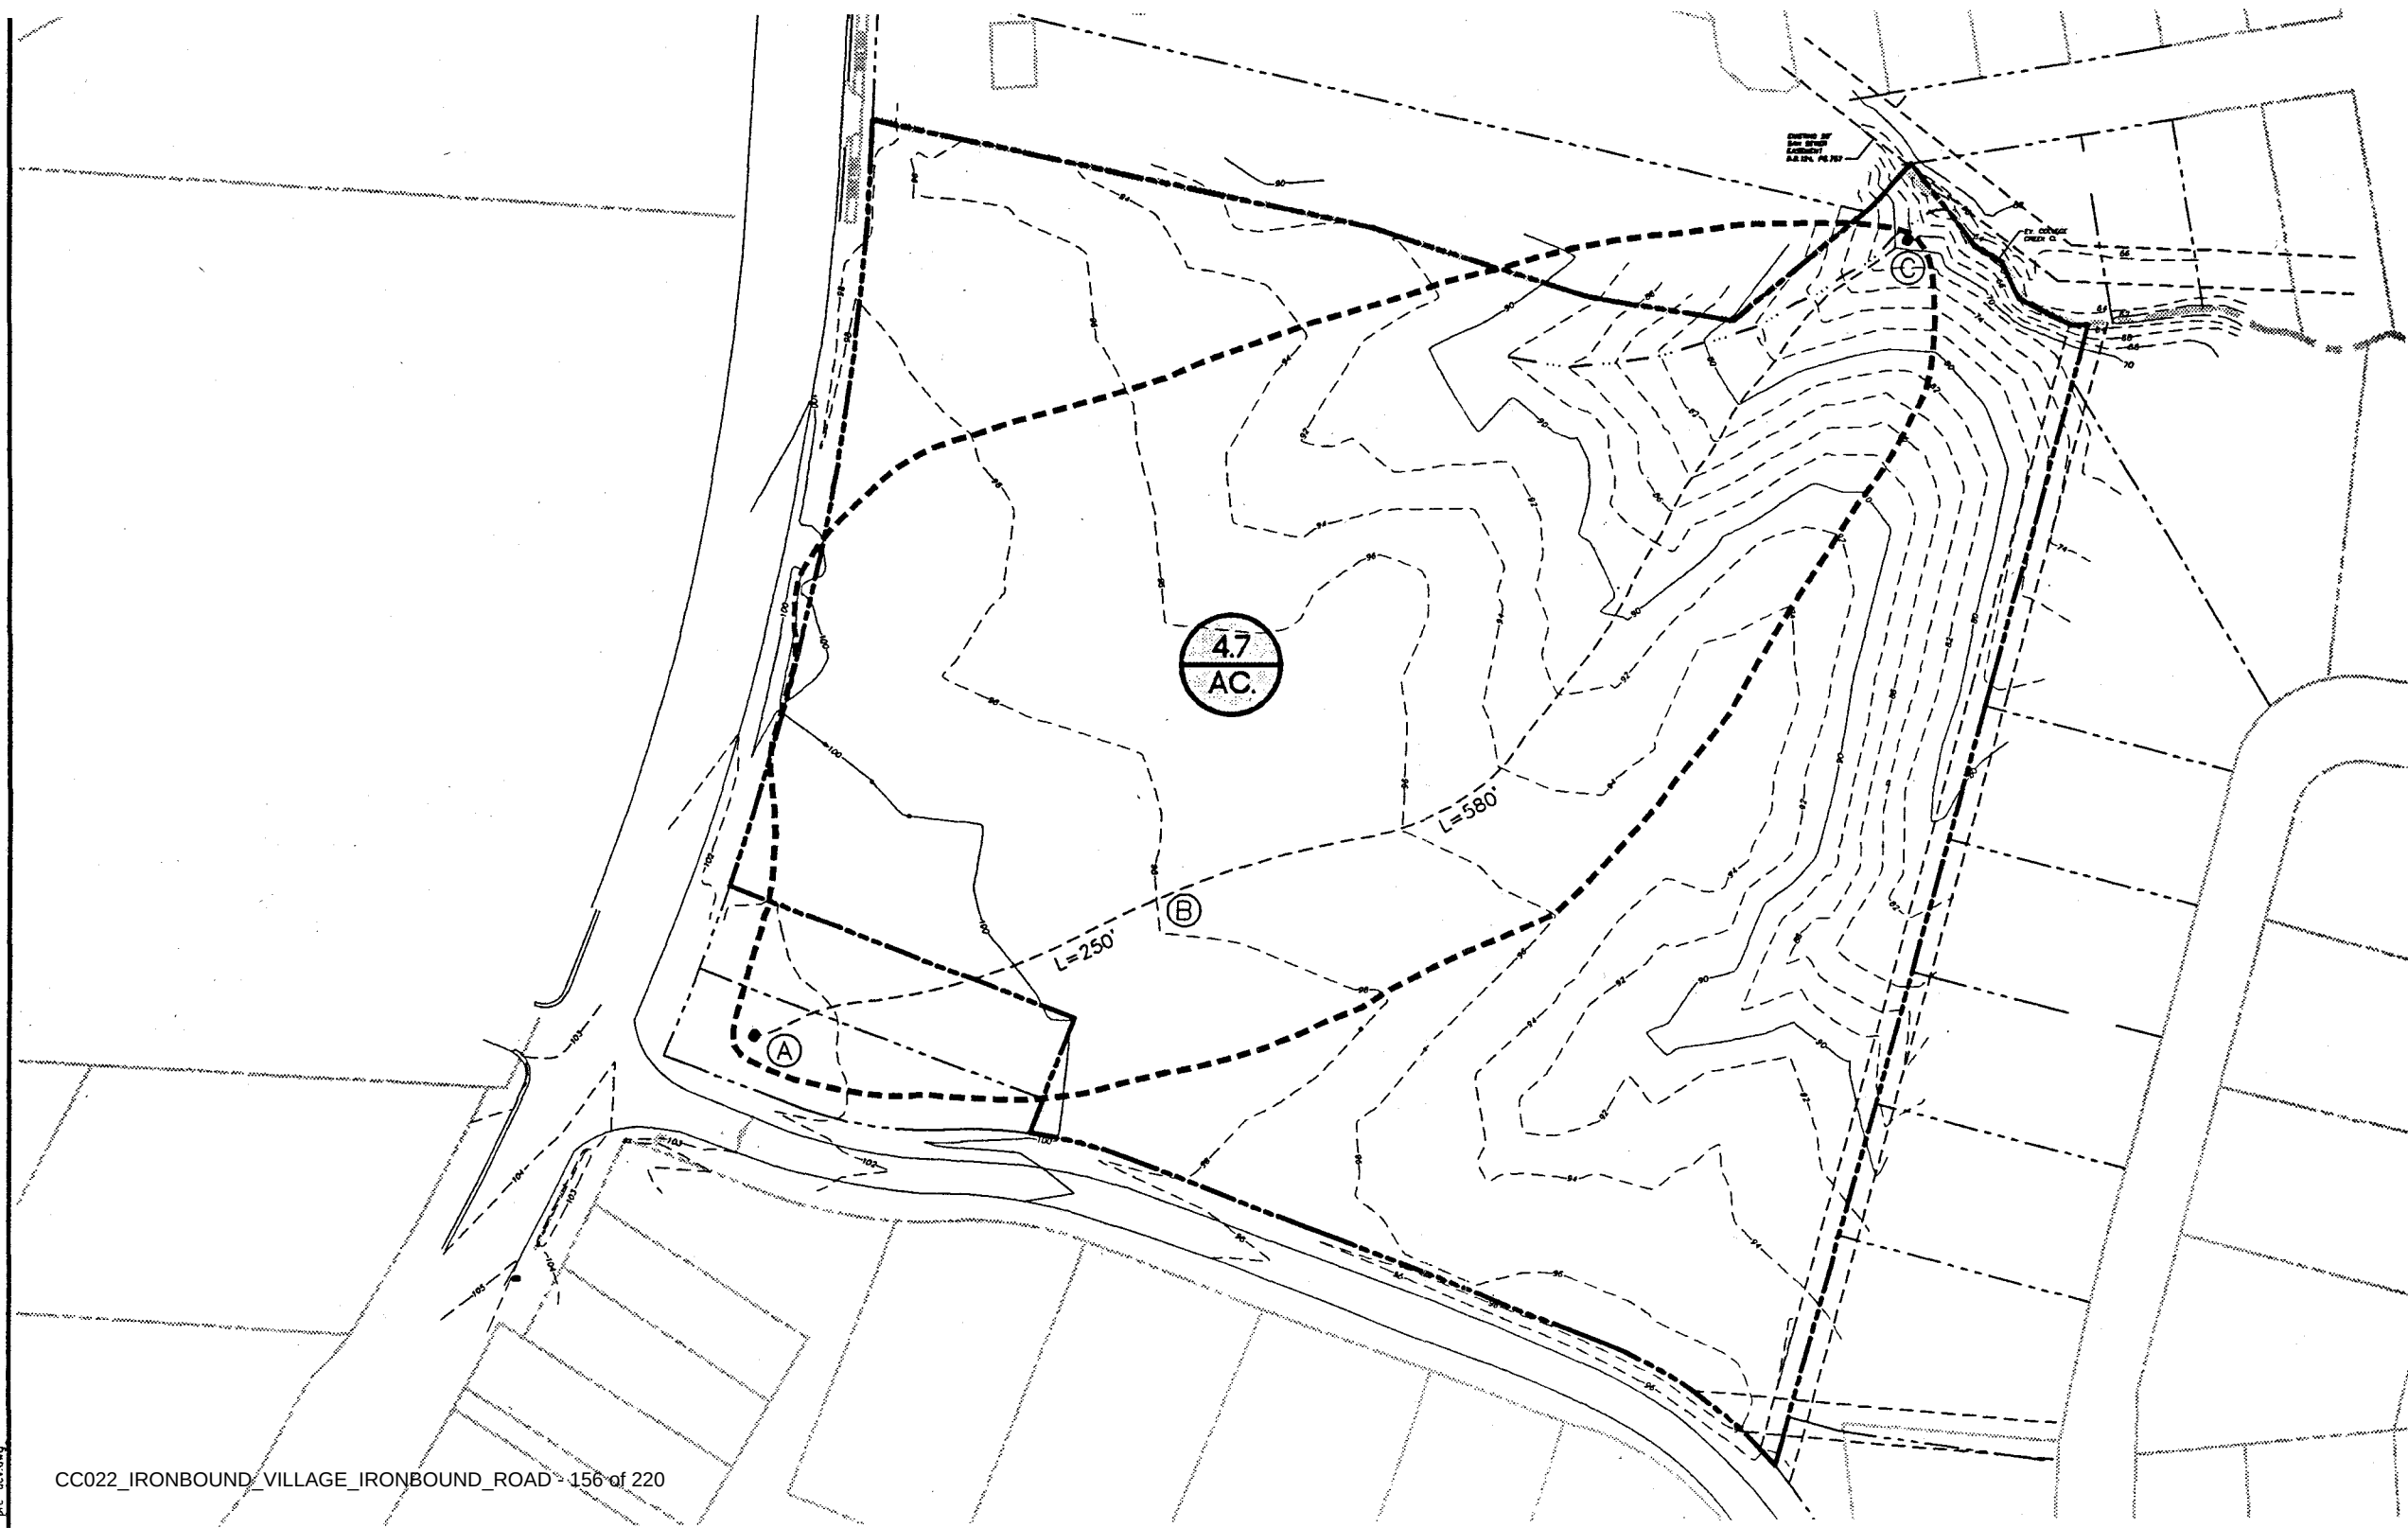

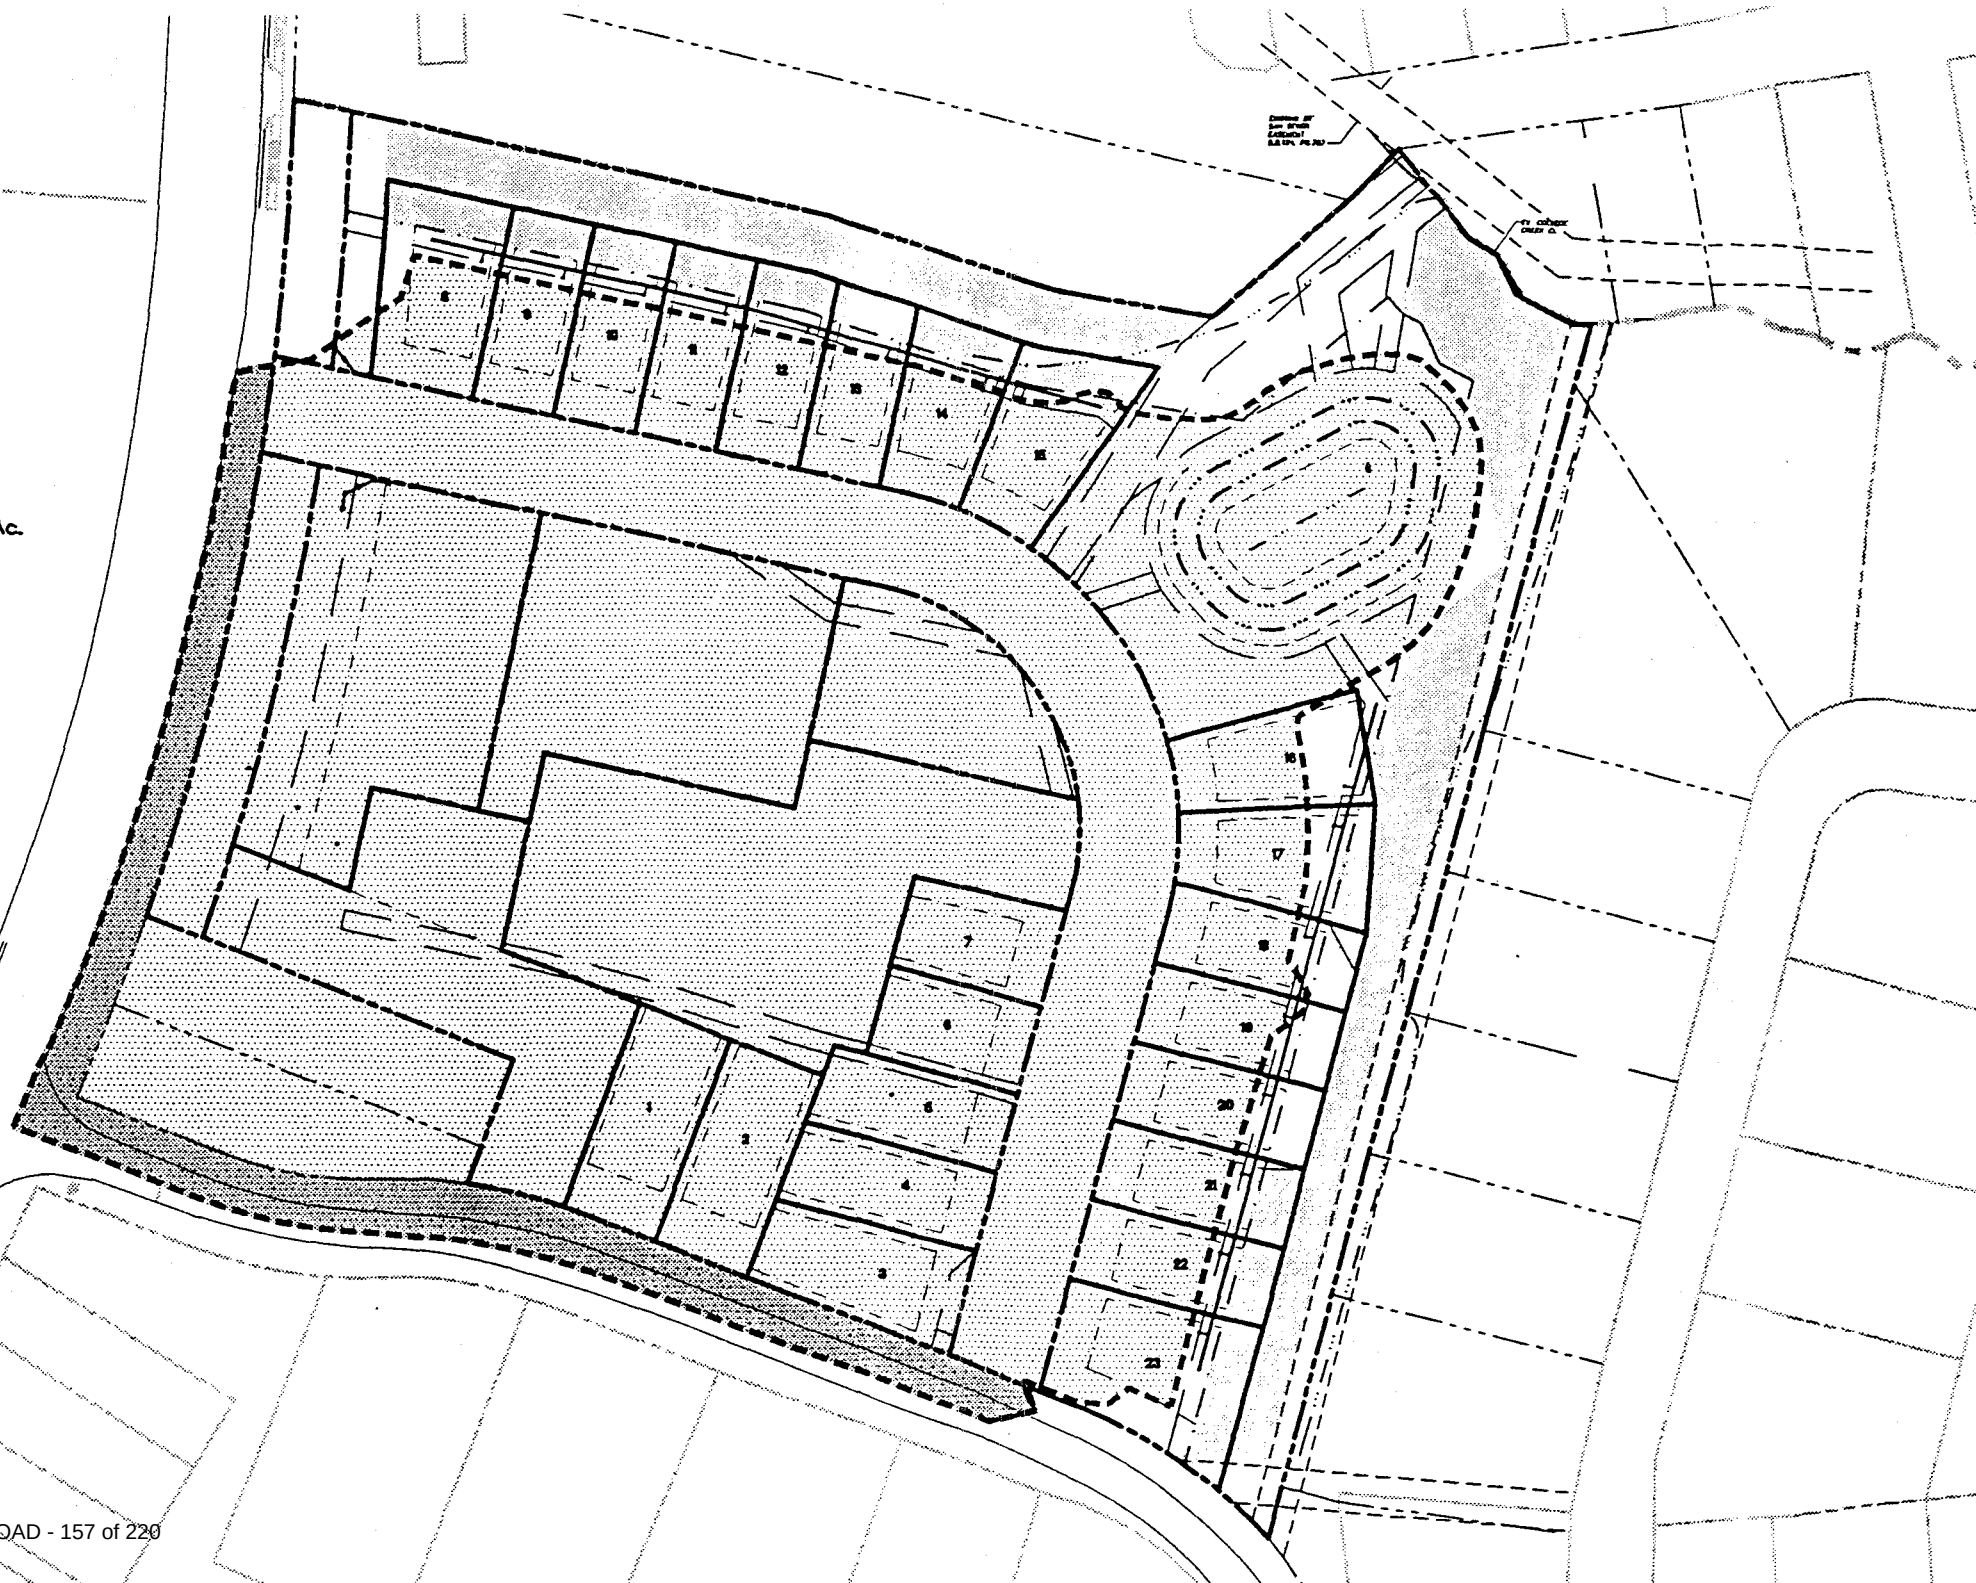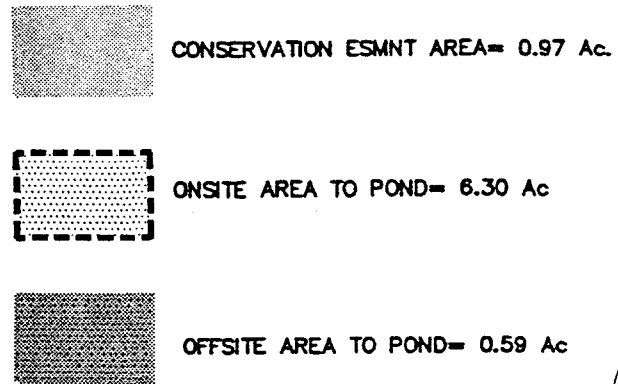

Impervious Area and Required Volume Calculations
for
Ironbound Village
AES# 8914-1

Impervious items	Totals		Acres
Houses	23 Ea	1350 SF	0.71
T.H.	7 Ea	912 SF	0.15
Office	4 Ea	2400 SF	0.22
Driveways	23 Ea	312 SF	0.16
Roads:			
Public	870 LF	31 Width	0.62
Private	530 LF	60 Width	0.73
Pond Access Rd	340 LF	12 Width	0.09
Wet Pond Surface @ N.P.	105 LF	65 Width	0.16
Sidewalks: w/in R/W	850 LF	8 Width	0.16
Offsite Road	500 LF	12 Width	0.14
Total Impervious Area (TIA)			3.14

Area to Pond = 6.8 Acres

Percent Impervious = 46%

Pond's Required Wet Volume = (1")(ft/12")(TIA Ac)(43560 sf/Ac) = 11,390 c.f.

Pond's Required Dry Volume = (1")(ft/12")(TIA Ac)(43560 sf/Ac) = 11,390 c.f.

Sediment Forebay's Required Volume = (0.1")(ft/12")(TIA Ac)(43560 sf/Ac) = 1,139 c.f.

BMP VOLUME CALCULATIONS
for
STONEHOUSE Ph 1, Bent Tree (Sect. V-B) Ph3
AES Project No.: 8878-00

PROPOSED POND VOLUME

Eleva	Depth	Area (sq. ft.)	Incremental Volume (cu. ft.)	Sum Volume (cu. ft.)	Sum Volume (cu. yd.)	Volume Above NPE
70.0	0.0	1,094	0	0	0	
72.0	2.0	2,396	3,490	3,490	129	
73.7	1.7	4,303	5,694	9,184	340	
74.0	0.3	5,971	1,541	10,725	397	
75.0	1.0	6,918	6,445	17,170	636	0
76.0	1.0	7,865	7,392	24,561	910	7,391
77.0	1.0	8,926	8,396	32,957	1,221	15,787
78.0	1.0	9,986	9,456	42,413	1,571	25,243
78.5	0.5	10,684	5,168	47,580	1,762	30,410
80.0	1.5	12,776	17,595	65,175	2,414	48,005

RELEASE RATE REQUIRED TO DETAINED VOLUME FOR 24 HOURS

Required BMP Volume (based upon Impervious Area) = 11,390 cubic feet

Volume Provided (based upon above table) = 15,787 cubic feet

Elevation of water surface associated with provided volume = 77.0

Elevation of Low Flow Orifice = 75.0

Average Head, in feet = 1.0

Average Release Rate Calculation $\frac{15,787 \text{ cubic feet}}{(24 \text{ hours} \times 60 \text{ minutes/hour} \times 60 \text{ seconds/minute})} = 0.2 \text{ cfs}$

LOW FLOW ORIFICE DIAMETER REQUIRED TO MAINTAIN AVERAGE RELEASE RATE

$$\text{Diameter of Low Flow Orifice} = 2 * (Q / ((64.32 * (h / 2)) ^ (1/2) * 0.6 * 3.14))) ^ (1/2)$$

where, Q equals average release rate (cfs), h equals average head (feet)

Diameter of Low Flow Orifice = 0.30 feet, or 4 inches

Hydrograph Summary Report

Page 1


Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to peak (min)	Volume (cuft)	Return period (yrs)	Inflow hyd(s)	Maximum elevation (ft)	Maximum storage (cuft)	Hydrograph description
1	Rational	7.8 ✓	1	5	2,922	2	—	—	—	2yr Pre
2	Rational	10.0 ✓	1	5	3,768	10	—	—	—	10yr Pre
3	Rational	13.0 ✓	1	5	4,858	100	—	—	—	100yr Pre
5	Rational	18.2 ✓	1	5	6,830	1	—	—	—	1yr Post
6	Rational	21.0 ✓	1	5	7,864	2	—	—	—	2yr Post
7	Rational	27.0 ✓	1	5	10,141	10	—	—	—	10yr Post
8	Rational	34.9 ✓	1	5	13,074	100	—	—	—	100yr Post
10	Reservoir	0.4	1	12	6,406	1	5	75.87	23,584	1yr routing
11	Reservoir	0.4	1	12	7,385	2	6	76.00	24,861	2yr routing
12	Reservoir	0.4	1	12	9,538	10	7	76.26	26,718	10yr routing
13	Reservoir	0.5	1	12	12,312	100	8	76.59 <i>DHW</i>	29,503	100yr routing
Proj. file: Pond.gpw					IDF file: JCChydrographs.IDF			Run date: 06-21-2001		

LANDMARK DESIGN GROUP

CC022
FINAL COMPS.

January 16, 2002

Mr. Scott Thomas, P.E.
James City County Environmental Division
P.O. Box 8784
Williamsburg, VA 23187-8784

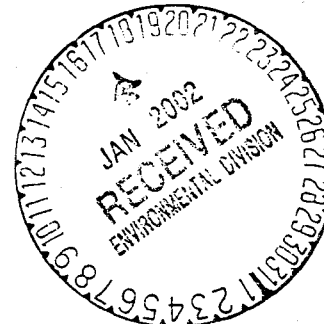

Re: Ironbound Village Subdivision and Site Plan
Case Nos. S-36-01 and SP-29-01
LMDG Job No. 2001112-000.07

Dear Scott:

We are pleased to submit, for approval, two (2) copies of the revised pond routing calculations for the above referenced project. As previously discussed, Cutting Edge Development, L.L.C. has employed our firm to assist them in obtaining final approval for these projects. The information we are submitting to you is a supplement to the plans and calculations that were previously submitted by Cutting Edge's original consultant, AES Consulting Engineers.

As we discussed last month, the developer is concerned with maintenance of the outfall structure due to the riser being thirty-six (36) inches in diameter. We have revised the calculations, per our discussions, to show the effects of using a forty-eight (48) inch riser. The calculations show no detrimental rise in the pond due to the increase in riser diameter.

If any questions or comments should arise, please do not hesitate to contact us.

Best regards,
The LandMark Design Group Inc.

Charles J. Bodnar, P.E.
Project Manager

Enclosures

CJB/cb

File: 2001112-000.07
Cutting Edge Development, L.L.C.

Approval

Based on a review of supporting information received January 17th 2002, a request to change riser structure from 36-inch diameter concrete to 48-inch diameter concrete reviewed and found acceptable. This revision is considered a minor plan change, as based on our review of information, there is no considerable change in BMP hydraulics or layout and configuration. Riser shall be reinforced concrete pipe with O-ring gaskets meeting the requirements of ASTM C361 or ASTM C76 with gaskets meeting ASTM C443; or precast manhole meeting ASTM C478 with profile gaskets meeting ASTM C443. Anti-vortex/trash rack device size shall also change appropriately consistent with the riser size change and details as shown on the previously approved plan. Record drawings (as-builts) shall reflect final riser type and size used in the field.

Scott J. Thomas, P.E.
Civil Engineer
Environmental Division

1-23-02
Date

Engineers • Planners • Surveyors • Landscape Architects • Environmental Consultants
4029 Ironbound Road, Suite 100, Williamsburg, VA 23188 (757) 253-2975 FAX: (757) 229-0049 lmdg@landmarkdgwb.com

IRONBOUND VILLAGE

IRONBOUND ROAD

PHASES 1 AND 2

DECEMBER 2001

LMDG FILE NO. 2001112-000.07

SUPPORTING ENGINEERING DOCUMENTS

- DRAINAGE CALCULATIONS
 - SUMMARY OF DATA
 - LMDG ROUTING CALCULATIONS
 - AES CALCULATIONS

LANDMARK
DESIGN GROUP

SIT CHECK SET.
(FINAL COMPS)

S-36-01
SP-29-01

REVISED
COMPS, RISER
SIZE CHANGE

36" to 48" d

OK *[Signature]*
1-23-02

SUMMARY OF DATA

Storm Event

AES Results

LMDG Results

2-year pre-developed
2-year post-developed
2-year routed outflow
2-year rise elevation

6.31 ? 7.8
8.96 ✓
~~3.14~~ (3.14) ✓
77.13 ✓

6.31 ✓
16.82 ✓
7.28 ✓
77.31 ✓

10-year pre-developed
10-year post-developed
10-year routed outflow
10-year rise elevation

8.43 ? 10.0
11.72 ✓
9.60 ✓
(77.45) ✓

8.43 ✓
22.46 ✓
11.71 ✓
77.44 ✓

25-year pre-developed
25-year post-developed
25-year routed outflow
25-year rise elevation

9.52 ?
13.06 ✓
11.23 ✓
77.57 ✓

9.52 ✓
25.37 ✓
13.99 ✓
77.69 ✓

100-year pre-developed
100-year post-developed
100-year routed outflow
100-year rise elevation

11.22 ? 13.0
15.19 ✓
13.21 ✓
77.80 ✓

11.22 ✓
29.91 ✓
14.30 ✓
78.06 ✓ DHW

FINAL ROUTED

2-YEAR 7.28 cfs @ 77.31

10-YEAR 11.71 cfs @ 77.44

100-YEAR 14.30 cfs @ 78.06

2-YEAR
7.28 cfs < 7.8 cfs
AES PRE-2 = 7.8 cfs
LDG PRE-2 = 6.31 cfs

OA pre - 4.7 AC
DA post - 6.90 AC. C=0.55
Tc=10.2min

4.74 AC.

imprv to post = 3.14 AC (46%)

• MEETS PRE-2 7.8 cfs
• NO CHANGE IN EXT
DET (WRV) SCV)
ALL ORIF. OR
POND VOLUME/
GRADING.
• FUTURE OK

File: Universal Post.xls
PROJECT: IRONBOUND VILLAGE
 Description: **Postdevelopment to BMP**

LandMark Design Group
 4029 Ironbound Road, Suite 100
 Williamsburg, VA 23188

Date: 19-Dec-01
 Revised:

UNIVERSAL RATIONAL METHOD FOR HYDROGRAPH GENERATION

Drainage Area = 6.89 Acres
 Runoff Coefficient = 0.55
 Time of Concentration = 10.20 Min

2 Yr computed peak discharge = 16.82 cfs
 10 Yr computed peak discharge = 22.46 cfs
 25 Yr computed peak discharge = 25.37 cfs
 100 Yr computed peak discharge = 29.91 cfs

COMPUTED HYDROGRAPH VERTEX POINTS

2 Yr Frequency		10 Yr Frequency		25 Yr Frequency		100 Yr Frequency	
Time (min)	Q (cfs)	Time (min)	Q (cfs)	Time (min)	Q (cfs)	Time (min)	Q (cfs)
0.0	0.00	0.0	0.00	0.0	0.00	0.0	0.00
10.2	3.53	10.2	4.72	10.2	5.33	10.2	6.28
20.4	5.05	20.4	6.74	20.4	7.61	20.4	8.97
30.6	16.82	30.6	22.46	30.6	25.37	30.6	29.91
40.8	9.08	40.8	12.13	40.8	13.70	40.8	16.15
51.0	6.56	51.0	8.76	51.0	9.89	51.0	11.67
61.2	4.20	61.2	5.62	61.2	6.34	61.2	7.48
71.4	3.03	71.4	4.04	71.4	4.57	71.4	5.38
81.6	2.52	81.6	3.37	81.6	3.81	81.6	4.49
91.8	2.35	91.8	3.14	91.8	3.55	91.8	4.19
102.0	2.19	102.0	2.92	102.0	3.30	102.0	3.89
112.2	0.00	112.2	0.00	112.2	0.00	112.2	0.00

EQUATIONS

$$I=B/(tc+D)^E$$

$$tp=3*tc$$

$$tb=11*tc$$

$$Qp=C*I*A$$

B,D,E constants based on NWS Hydro 35

Hydrograph Summary Report

Page 1

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to peak (min)	Volume (cuft)	Return period (yrs)	Inflow hyd(s)	Maximum elevation (ft)	Maximum storage (cuft)	Hydrograph description
1	Manual	16.82	10	30	33,198	2	---	---	---	2-Year Post-Develo
2	Manual	22.46	10	30	44,340	10	---	---	---	10-Year Post-Devel
3	Manual	25.37	10	30	50,142	25	---	---	---	25-Year Post-Devel
4	Manual	29.91	10	30	59,046	100	---	---	---	100-Year Post-Deve
5	Manual	6.31	10	30	12,462	2	---	---	---	2-Year Pre-Develop
6	Manual	8.43	10	30	16,644	10	---	---	---	10-Year Pre-Develo
7	Manual	9.52	10	30	18,792	25	---	---	---	25-Year Pre-Develo
8	Manual	11.22	10	30	22,158	100	---	---	---	100-Year Pre-Devel
10	Reservoir	7.28	10	50	33,198	2	1	77.31	18,759	Pond 1 - 2-Year St
11	Reservoir	11.71	10	40	44,340	10	2	77.44	19,971	Pond 1 - 10-year s
12	Reservoir	13.99	10	40	50,142	25	3	77.69	22,356	Pond 1 - 25-Year S
13	Reservoir	14.30	10	40	59,046	100	4	78.06	25,840	Pond 1- 100-Year S
Proj. file: ironboundpond.GPW IDF file: Norfolk.IDF Run date: 12-19-2001										

Hydrograph Report

Page 1

English

Hyd. No. 10

Pond 1 - 2-Year Storm

Hydrograph type = Reservoir
Storm frequency = 2 yrs
Inflow hyd. No. = 1
Max. Elevation = 77.31 ft

Peak discharge = 7.28 cfs
Time interval = 10 min
Reservoir name = BMP
Max. Storage = 18,759 cuft

Storage Indication method used.

Total Volume = 33,198 cuft

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
0.33	5.05	75.48	11.91	0.22	----	----	----	----	----	----	0.22
0.50	16.82 <<	76.30	12.72	0.45	----	----	----	----	----	----	0.45
0.67	9.08	77.12	13.48	0.59	----	----	1.58	----	----	----	2.17
0.83	6.56	77.31 <<	13.65	0.62	----	----	6.67	----	----	----	7.28 <<
1.00	4.20	77.25	13.60	0.61	----	----	4.83	----	----	----	5.44
1.17	3.03	77.19	13.54	0.60	----	----	3.15	----	----	----	3.75
1.33	2.52	77.15	13.51	0.59	----	----	2.36	----	----	----	2.95
1.50	2.35	77.13	13.49	0.59	----	----	1.94	----	----	----	2.53
1.67	2.19	77.12	13.48	0.59	----	----	1.73	----	----	----	2.32
1.83	0.00	77.07	13.44	0.58	----	----	0.88	----	----	----	1.46
2.00	0.00	77.01	13.38	0.57	----	----	0.08	----	----	----	0.65
2.17	0.00	76.96	13.34	0.56	----	----	----	----	----	----	0.56
2.33	0.00	76.92	13.30	0.56	----	----	----	----	----	----	0.56
2.50	0.00	76.88	13.27	0.55	----	----	----	----	----	----	0.55
2.67	0.00	76.85	13.23	0.54	----	----	----	----	----	----	0.54
2.83	0.00	76.81	13.19	0.54	----	----	----	----	----	----	0.54
3.00	0.00	76.77	13.16	0.53	----	----	----	----	----	----	0.53
3.17	0.00	76.73	13.12	0.53	----	----	----	----	----	----	0.53
3.33	0.00	76.69	13.09	0.52	----	----	----	----	----	----	0.52
3.50	0.00	76.66	13.06	0.51	----	----	----	----	----	----	0.51
3.67	0.00	76.62	13.02	0.51	----	----	----	----	----	----	0.51
3.83	0.00	76.58	12.99	0.50	----	----	----	----	----	----	0.50
4.00	0.00	76.55	12.96	0.49	----	----	----	----	----	----	0.49
4.17	0.00	76.51	12.92	0.49	----	----	----	----	----	----	0.49
4.33	0.00	76.48	12.89	0.48	----	----	----	----	----	----	0.48
4.50	0.00	76.45	12.86	0.47	----	----	----	----	----	----	0.47
4.67	0.00	76.41	12.83	0.47	----	----	----	----	----	----	0.47
4.83	0.00	76.38	12.79	0.46	----	----	----	----	----	----	0.46
5.00	0.00	76.35	12.76	0.46	----	----	----	----	----	----	0.46
5.17	0.00	76.31	12.73	0.45	----	----	----	----	----	----	0.45
5.33	0.00	76.28	12.70	0.44	----	----	----	----	----	----	0.44
5.50	0.00	76.25	12.67	0.44	----	----	----	----	----	----	0.44
5.67	0.00	76.22	12.64	0.43	----	----	----	----	----	----	0.43
5.83	0.00	76.19	12.61	0.42	----	----	----	----	----	----	0.42
6.00	0.00	76.16	12.58	0.42	----	----	----	----	----	----	0.42
6.17	0.00	76.13	12.56	0.41	----	----	----	----	----	----	0.41

Continues on next page...

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
6.33	0.00	76.10	12.53	0.41	----	----	----	----	----	----	0.41
6.50	0.00	76.07	12.50	0.40	----	----	----	----	----	----	0.40
6.67	0.00	76.04	12.47	0.39	----	----	----	----	----	----	0.39
6.83	0.00	76.01	12.44	0.39	----	----	----	----	----	----	0.39
7.00	0.00	75.98	12.42	0.38	----	----	----	----	----	----	0.38
7.17	0.00	75.95	12.39	0.37	----	----	----	----	----	----	0.37
7.33	0.00	75.92	12.36	0.37	----	----	----	----	----	----	0.37
7.50	0.00	75.89	12.33	0.36	----	----	----	----	----	----	0.36
7.67	0.00	75.87	12.30	0.35	----	----	----	----	----	----	0.35
7.83	0.00	75.84	12.27	0.34	----	----	----	----	----	----	0.34
8.00	0.00	75.81	12.24	0.34	----	----	----	----	----	----	0.34
8.17	0.00	75.78	12.22	0.33	----	----	----	----	----	----	0.33
8.33	0.00	75.76	12.19	0.32	----	----	----	----	----	----	0.32
8.50	0.00	75.73	12.17	0.32	----	----	----	----	----	----	0.32
8.67	0.00	75.71	12.14	0.31	----	----	----	----	----	----	0.31
8.83	0.00	75.68	12.12	0.30	----	----	----	----	----	----	0.30
9.00	0.00	75.66	12.09	0.29	----	----	----	----	----	----	0.29
9.17	0.00	75.63	12.07	0.29	----	----	----	----	----	----	0.29
9.33	0.00	75.61	12.04	0.28	----	----	----	----	----	----	0.28
9.50	0.00	75.59	12.02	0.27	----	----	----	----	----	----	0.27
9.67	0.00	75.57	12.00	0.26	----	----	----	----	----	----	0.26
9.83	0.00	75.55	11.98	0.25	----	----	----	----	----	----	0.25
10.00	0.00	75.53	11.96	0.24	----	----	----	----	----	----	0.24
10.17	0.00	75.51	11.94	0.23	----	----	----	----	----	----	0.23
10.33	0.00	75.49	11.92	0.22	----	----	----	----	----	----	0.22
10.50	0.00	75.47	11.90	0.21	----	----	----	----	----	----	0.21
10.67	0.00	75.45	11.89	0.19	----	----	----	----	----	----	0.19
10.83	0.00	75.44	11.87	0.18	----	----	----	----	----	----	0.18
11.00	0.00	75.42	11.86	0.17	----	----	----	----	----	----	0.17
11.17	0.00	75.41	11.84	0.16	----	----	----	----	----	----	0.16
11.33	0.00	75.40	11.83	0.15	----	----	----	----	----	----	0.15
11.50	0.00	75.39	11.82	0.14	----	----	----	----	----	----	0.14
11.67	0.00	75.38	11.81	0.13	----	----	----	----	----	----	0.13
11.83	0.00	75.37	11.80	0.12	----	----	----	----	----	----	0.12
12.00	0.00	75.36	11.79	0.11	----	----	----	----	----	----	0.11
12.17	0.00	75.35	11.78	0.10	----	----	----	----	----	----	0.10
12.33	0.00	75.34	11.77	0.09	----	----	----	----	----	----	0.09
12.50	0.00	75.33	11.76	0.09	----	----	----	----	----	----	0.09
12.67	0.00	75.33	11.76	0.08	----	----	----	----	----	----	0.08

...End

Reservoir Report

Page 1

English

Reservoir No. 1 - BMP

Pond Data

Pond storage is based on known contour areas

Stage / Storage Table

Stage ft	Elevation ft	Contour area sqft	Incr. Storage cuft	Total storage cuft
0.00	75.00 ✓	6,918 ✓	0	0
1.00	76.00 ✓	7,865 ✓	7,392	7,392
2.00	77.00 ✓	8,926 ✓	8,396	15,787
3.00	78.00 ✓	9,986 ✓	9,456	25,243
3.50	78.50 ✓	10,684 ✓	5,168	30,411
5.00	80.00 ✓	12,776 ✓	17,595	48,006 ✓

Culvert / Orifice Structures

	[A]	[B]	[C]	[D]
Rise in	= 15.0 ✓	4.0 ✓	0.0	0.0
Span in	= 15.0	4.0 ✓	0.0	0.0
No. Barrels	= 1	1	0	0
Invert El. ft	= 69.00 ✓	75.00 ✓	0.00	0.00
Length ft	= 100.0 ✓	1.0	0.0	0.0
Slope %	= 1.00 ✓	1.00	0.00	0.00
N-Value	= .013 ✓	.013	.000	.000
Orif. Coeff.	= 0.50 ✓	0.60 ✓	0.00	0.00
Multi-Stage	= ----	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len ft	= 12.56 ✓	8.00 ✓	0.00	0.00
Crest El. ft	= 77.00 ✓	78.50 ✓	0.00	0.00
Weir Coeff.	= 3.00 ✓	3.00 ✓	0.00	0.00
Eqn. Exp.	= 1.50 ✓	1.50 ✓	0.00	0.00
Multi-Stage	= Yes	Yes	No	No

Tailwater Elevation = 0.00 ft

Note: All outflows have been analyzed under inlet and outlet control.

Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Discharge cfs
0.00	0	75.00	11.41	0.00	---	---	0.00	0.00	---	---	0.00
1.00	7,392	76.00	12.43	0.38	---	---	0.00	0.00	---	---	0.38
2.00	15,787	77.00	13.37	0.57	---	---	0.00	0.00	---	---	0.57
3.00	25,243	78.00	14.25	0.00	---	---	37.68	0.00	---	---	14.25
3.50	30,411	78.50	14.67	0.00	---	---	69.22	0.00	---	---	14.67
5.00	48,006	80.00	15.86	0.00	---	---	195.79	44.09	---	---	15.86

Hydrograph Report

Page 1

English

Hyd. No. 11

Pond 1 - 10-year storm

Hydrograph type = Reservoir
Storm frequency = 10 yrs
Inflow hyd. No. = 2
Max. Elevation = 77.44 ft

Peak discharge = 11.71 cfs
Time interval = 10 min
Reservoir name = BMP
Max. Storage = 19,971 cuft

Storage Indication method used.

Total Volume = 44,340 cuft

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
0.33	6.74	75.64	12.08	0.29	---	---	---	---	---	---	0.29
0.50	22.46 <<	76.70	13.10	0.52	---	---	---	---	---	---	0.52
0.67	12.13	77.44 <<	13.77	0.63	---	---	11.14	---	---	---	11.71 <<
0.83	8.76	77.41	13.73	0.63	---	---	9.73	---	---	---	10.35
1.00	5.62	77.31	13.65	0.61	---	---	6.47	---	---	---	7.08
1.17	4.04	77.23	13.58	0.60	---	---	4.32	---	---	---	4.93
1.33	3.37	77.19	13.54	0.60	---	---	3.20	---	---	---	3.80
1.50	3.14	77.17	13.53	0.59	---	---	2.76	---	---	---	3.35
1.67	2.92	77.16	13.51	0.59	---	---	2.49	---	---	---	3.09
1.83	0.00	77.10	13.46	0.58	---	---	1.18	---	---	---	1.76
2.00	0.00	77.02	13.39	0.57	---	---	0.21	---	---	---	0.79
2.17	0.00	76.97	13.35	0.56	---	---	---	---	---	---	0.56
2.33	0.00	76.93	13.31	0.56	---	---	---	---	---	---	0.56
2.50	0.00	76.89	13.27	0.55	---	---	---	---	---	---	0.55
2.67	0.00	76.85	13.24	0.55	---	---	---	---	---	---	0.55
2.83	0.00	76.81	13.20	0.54	---	---	---	---	---	---	0.54
3.00	0.00	76.78	13.17	0.53	---	---	---	---	---	---	0.53
3.17	0.00	76.74	13.13	0.53	---	---	---	---	---	---	0.53
3.33	0.00	76.70	13.10	0.52	---	---	---	---	---	---	0.52
3.50	0.00	76.66	13.06	0.51	---	---	---	---	---	---	0.51
3.67	0.00	76.63	13.03	0.51	---	---	---	---	---	---	0.51
3.83	0.00	76.59	12.99	0.50	---	---	---	---	---	---	0.50
4.00	0.00	76.56	12.96	0.50	---	---	---	---	---	---	0.50
4.17	0.00	76.52	12.93	0.49	---	---	---	---	---	---	0.49
4.33	0.00	76.49	12.90	0.48	---	---	---	---	---	---	0.48
4.50	0.00	76.45	12.86	0.48	---	---	---	---	---	---	0.48
4.67	0.00	76.42	12.83	0.47	---	---	---	---	---	---	0.47
4.83	0.00	76.38	12.80	0.46	---	---	---	---	---	---	0.46
5.00	0.00	76.35	12.77	0.46	---	---	---	---	---	---	0.46
5.17	0.00	76.32	12.74	0.45	---	---	---	---	---	---	0.45
5.33	0.00	76.29	12.71	0.44	---	---	---	---	---	---	0.44
5.50	0.00	76.26	12.68	0.44	---	---	---	---	---	---	0.44
5.67	0.00	76.22	12.65	0.43	---	---	---	---	---	---	0.43
5.83	0.00	76.19	12.62	0.43	---	---	---	---	---	---	0.43
6.00	0.00	76.16	12.59	0.42	---	---	---	---	---	---	0.42
6.17	0.00	76.13	12.56	0.41	---	---	---	---	---	---	0.41

Continues on next page...

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
6.33	0.00	76.10	12.53	0.41	----	----	----	----	----	----	0.41
6.50	0.00	76.08	12.50	0.40	----	----	----	----	----	----	0.40
6.67	0.00	76.05	12.48	0.39	----	----	----	----	----	----	0.39
6.83	0.00	76.02	12.45	0.39	----	----	----	----	----	----	0.39
7.00	0.00	75.99	12.42	0.38	----	----	----	----	----	----	0.38
7.17	0.00	75.96	12.39	0.37	----	----	----	----	----	----	0.37
7.33	0.00	75.93	12.36	0.37	----	----	----	----	----	----	0.37
7.50	0.00	75.90	12.33	0.36	----	----	----	----	----	----	0.36
7.67	0.00	75.87	12.30	0.35	----	----	----	----	----	----	0.35
7.83	0.00	75.84	12.28	0.35	----	----	----	----	----	----	0.35
8.00	0.00	75.82	12.25	0.34	----	----	----	----	----	----	0.34
8.17	0.00	75.79	12.22	0.33	----	----	----	----	----	----	0.33
8.33	0.00	75.76	12.20	0.32	----	----	----	----	----	----	0.32
8.50	0.00	75.74	12.17	0.32	----	----	----	----	----	----	0.32
8.67	0.00	75.71	12.15	0.31	----	----	----	----	----	----	0.31
8.83	0.00	75.69	12.12	0.30	----	----	----	----	----	----	0.30
9.00	0.00	75.66	12.10	0.30	----	----	----	----	----	----	0.30
9.17	0.00	75.64	12.07	0.29	----	----	----	----	----	----	0.29
9.33	0.00	75.61	12.05	0.28	----	----	----	----	----	----	0.28
9.50	0.00	75.59	12.03	0.27	----	----	----	----	----	----	0.27
9.67	0.00	75.57	12.00	0.26	----	----	----	----	----	----	0.26
9.83	0.00	75.55	11.98	0.25	----	----	----	----	----	----	0.25
10.00	0.00	75.53	11.96	0.24	----	----	----	----	----	----	0.24
10.17	0.00	75.51	11.94	0.23	----	----	----	----	----	----	0.23
10.33	0.00	75.49	11.92	0.22	----	----	----	----	----	----	0.22
10.50	0.00	75.47	11.91	0.21	----	----	----	----	----	----	0.21
10.67	0.00	75.46	11.89	0.20	----	----	----	----	----	----	0.20
10.83	0.00	75.44	11.87	0.18	----	----	----	----	----	----	0.18
11.00	0.00	75.43	11.86	0.17	----	----	----	----	----	----	0.17
11.17	0.00	75.41	11.85	0.16	----	----	----	----	----	----	0.16
11.33	0.00	75.40	11.83	0.15	----	----	----	----	----	----	0.15
11.50	0.00	75.39	11.82	0.14	----	----	----	----	----	----	0.14
11.67	0.00	75.38	11.81	0.13	----	----	----	----	----	----	0.13
11.83	0.00	75.37	11.80	0.12	----	----	----	----	----	----	0.12

...End

Reservoir Report

Page 1

English

Reservoir No. 1 - BMP

Pond Data

Pond storage is based on known contour areas

Stage / Storage Table

Stage ft	Elevation ft	Contour area sqft	Incr. Storage cuft	Total storage cuft
0.00	75.00	6,918	0	0
1.00	76.00	7,865	7,392	7,392
2.00	77.00	8,926	8,396	15,787
3.00	78.00	9,986	9,456	25,243
3.50	78.50	10,684	5,168	30,411
5.00	80.00	12,776	17,595	48,006

Culvert / Orifice Structures

	[A]	[B]	[C]	[D]
Rise in	= 15.0	4.0	0.0	0.0
Span in	= 15.0	4.0	0.0	0.0
No. Barrels	= 1	1	0	0
Invert El. ft	= 69.00	75.00	0.00	0.00
Length ft	= 100.0	1.0	0.0	0.0
Slope %	= 1.00	1.00	0.00	0.00
N-Value	= .013	.013	.000	.000
Orif. Coeff.	= 0.50	0.60	0.00	0.00
Multi-Stage	= ----	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len ft	= 12.56	8.00	0.00	0.00
Crest El. ft	= 77.00	78.50	0.00	0.00
Weir Coeff.	= 3.00	3.00	0.00	0.00
Eqn. Exp.	= 1.50	1.50	0.00	0.00
Multi-Stage	= Yes	Yes	No	No

Tailwater Elevation = 0.00 ft

Note: All outflows have been analyzed under inlet and outlet control.

Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Discharge cfs
0.00	0	75.00	11.41	0.00	---	---	0.00	0.00	---	---	0.00
1.00	7,392	76.00	12.43	0.38	---	---	0.00	0.00	---	---	0.38
2.00	15,787	77.00	13.37	0.57	---	---	0.00	0.00	---	---	0.57
3.00	25,243	78.00	14.25	0.00	---	---	37.68	0.00	---	---	14.25
3.50	30,411	78.50	14.67	0.00	---	---	69.22	0.00	---	---	14.67
5.00	48,006	80.00	15.86	0.00	---	---	195.79	44.09	---	---	15.86

Hydrograph Report

Page 1

English

Hyd. No. 12

Pond 1 - 25-Year Storm

Hydrograph type = Reservoir
Storm frequency = 25 yrs
Inflow hyd. No. = 3
Max. Elevation = 77.69 ft

Peak discharge = 13.99 cfs
Time interval = 10 min
Reservoir name = BMP
Max. Storage = 22,356 cuft

Storage Indication method used.

Total Volume = 50,142 cuft

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
0.33	7.61	75.73	12.16	0.31	----	----	----	----	----	----	0.31
0.50	25.37 <<	76.91	13.29	0.55	----	----	----	----	----	----	0.55
0.67	13.70	77.69 <<	13.99	----	----	----	21.83	----	----	----	13.99 <<
0.83	9.89	77.56	13.87	0.26	----	----	15.81	----	----	----	13.87
1.00	6.34	77.36	13.69	0.62	----	----	8.11	----	----	----	8.73
1.17	4.57	77.25	13.60	0.61	----	----	4.86	----	----	----	5.47
1.33	3.91	77.21	13.56	0.60	----	----	3.70	----	----	----	4.31
1.50	3.55	77.19	13.54	0.60	----	----	3.19	----	----	----	3.79
1.67	3.30	77.18	13.53	0.60	----	----	2.89	----	----	----	3.49
1.83	0.00	77.11	13.47	0.59	----	----	1.39	----	----	----	1.98
2.00	0.00	77.02	13.39	0.57	----	----	0.25	----	----	----	0.82
2.17	0.00	76.97	13.35	0.56	----	----	----	----	----	----	0.56
2.33	0.00	76.93	13.31	0.56	----	----	----	----	----	----	0.56
2.50	0.00	76.89	13.27	0.55	----	----	----	----	----	----	0.55
2.67	0.00	76.85	13.24	0.55	----	----	----	----	----	----	0.55
2.83	0.00	76.82	13.20	0.54	----	----	----	----	----	----	0.54
3.00	0.00	76.78	13.17	0.53	----	----	----	----	----	----	0.53
3.17	0.00	76.74	13.13	0.53	----	----	----	----	----	----	0.53
3.33	0.00	76.70	13.10	0.52	----	----	----	----	----	----	0.52
3.50	0.00	76.67	13.06	0.51	----	----	----	----	----	----	0.51
3.67	0.00	76.63	13.03	0.51	----	----	----	----	----	----	0.51
3.83	0.00	76.59	13.00	0.50	----	----	----	----	----	----	0.50
4.00	0.00	76.56	12.96	0.50	----	----	----	----	----	----	0.50
4.17	0.00	76.52	12.93	0.49	----	----	----	----	----	----	0.49
4.33	0.00	76.49	12.90	0.48	----	----	----	----	----	----	0.48
4.50	0.00	76.45	12.87	0.48	----	----	----	----	----	----	0.48
4.67	0.00	76.42	12.83	0.47	----	----	----	----	----	----	0.47
4.83	0.00	76.39	12.80	0.46	----	----	----	----	----	----	0.46
5.00	0.00	76.35	12.77	0.46	----	----	----	----	----	----	0.46
5.17	0.00	76.32	12.74	0.45	----	----	----	----	----	----	0.45
5.33	0.00	76.29	12.71	0.44	----	----	----	----	----	----	0.44
5.50	0.00	76.26	12.68	0.44	----	----	----	----	----	----	0.44
5.67	0.00	76.23	12.65	0.43	----	----	----	----	----	----	0.43
5.83	0.00	76.19	12.62	0.43	----	----	----	----	----	----	0.43
6.00	0.00	76.16	12.59	0.42	----	----	----	----	----	----	0.42
6.17	0.00	76.13	12.56	0.41	----	----	----	----	----	----	0.41

Continues on next page...

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
6.33	0.00	76.11	12.53	0.41	----	----	----	----	----	----	0.41
6.50	0.00	76.08	12.51	0.40	----	----	----	----	----	----	0.40
6.67	0.00	76.05	12.48	0.39	----	----	----	----	----	----	0.39
6.83	0.00	76.02	12.45	0.39	----	----	----	----	----	----	0.39
7.00	0.00	75.99	12.42	0.38	----	----	----	----	----	----	0.38
7.17	0.00	75.96	12.39	0.37	----	----	----	----	----	----	0.37
7.33	0.00	75.93	12.36	0.37	----	----	----	----	----	----	0.37
7.50	0.00	75.90	12.33	0.36	----	----	----	----	----	----	0.36
7.67	0.00	75.87	12.31	0.35	----	----	----	----	----	----	0.35
7.83	0.00	75.84	12.28	0.35	----	----	----	----	----	----	0.35
8.00	0.00	75.82	12.25	0.34	----	----	----	----	----	----	0.34
8.17	0.00	75.79	12.22	0.33	----	----	----	----	----	----	0.33
8.33	0.00	75.76	12.20	0.32	----	----	----	----	----	----	0.32
8.50	0.00	75.74	12.17	0.32	----	----	----	----	----	----	0.32
8.67	0.00	75.71	12.15	0.31	----	----	----	----	----	----	0.31
8.83	0.00	75.69	12.12	0.30	----	----	----	----	----	----	0.30
9.00	0.00	75.66	12.10	0.30	----	----	----	----	----	----	0.30
9.17	0.00	75.64	12.07	0.29	----	----	----	----	----	----	0.29
9.33	0.00	75.62	12.05	0.28	----	----	----	----	----	----	0.28
9.50	0.00	75.59	12.03	0.27	----	----	----	----	----	----	0.27
9.67	0.00	75.57	12.01	0.26	----	----	----	----	----	----	0.26
9.83	0.00	75.55	11.98	0.25	----	----	----	----	----	----	0.25
10.00	0.00	75.53	11.96	0.24	----	----	----	----	----	----	0.24
10.17	0.00	75.51	11.94	0.24	----	----	----	----	----	----	0.24
10.33	0.00	75.49	11.93	0.22	----	----	----	----	----	----	0.22
10.50	0.00	75.47	11.91	0.21	----	----	----	----	----	----	0.21
10.67	0.00	75.46	11.89	0.20	----	----	----	----	----	----	0.20
10.83	0.00	75.44	11.87	0.18	----	----	----	----	----	----	0.18
11.00	0.00	75.43	11.86	0.17	----	----	----	----	----	----	0.17
11.17	0.00	75.41	11.85	0.16	----	----	----	----	----	----	0.16
11.33	0.00	75.40	11.83	0.15	----	----	----	----	----	----	0.15
11.50	0.00	75.39	11.82	0.14	----	----	----	----	----	----	0.14

...End

Reservoir Report

Page 1

Reservoir No. 1 - BMP

English

Pond Data

Pond storage is based on known contour areas

Stage / Storage Table

Stage ft	Elevation ft	Contour area sqft	Incr. Storage cuft	Total storage cuft
0.00	75.00	6,918	0	0
1.00	76.00	7,865	7,392	7,392
2.00	77.00	8,926	8,396	15,787
3.00	78.00	9,986	9,456	25,243
3.50	78.50	10,684	5,168	30,411
5.00	80.00	12,776	17,595	48,006

Culvert / Orifice Structures

	[A]	[B]	[C]	[D]
Rise in	= 15.0	4.0	0.0	0.0
Span in	= 15.0	4.0	0.0	0.0
No. Barrels	= 1	1	0	0
Invert El. ft	= 69.00	75.00	0.00	0.00
Length ft	= 100.0	1.0	0.0	0.0
Slope %	= 1.00	1.00	0.00	0.00
N-Value	= .013	.013	.000	.000
Orif. Coeff.	= 0.50	0.60	0.00	0.00
Multi-Stage	= ----	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len ft	= 12.56	8.00	0.00	0.00
Crest El. ft	= 77.00	78.50	0.00	0.00
Weir Coeff.	= 3.00	3.00	0.00	0.00
Eqn. Exp.	= 1.50	1.50	0.00	0.00
Multi-Stage	= Yes	Yes	No	No

Tailwater Elevation = 0.00 ft

Note: All outflows have been analyzed under inlet and outlet control.

Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Discharge cfs
0.00	0	75.00	11.41	0.00	---	---	0.00	0.00	---	---	0.00
1.00	7,392	76.00	12.43	0.38	---	---	0.00	0.00	---	---	0.38
2.00	15,787	77.00	13.37	0.57	---	---	0.00	0.00	---	---	0.57
3.00	25,243	78.00	14.25	0.00	---	---	37.68	0.00	---	---	14.25
3.50	30,411	78.50	14.67	0.00	---	---	69.22	0.00	---	---	14.67
5.00	48,006	80.00	15.86	0.00	---	---	195.79	44.09	---	---	15.86

Hydrograph Report

Page 1

English

Hyd. No. 13

Pond 1- 100-Year Storm

Hydrograph type = Reservoir
Storm frequency = 100 yrs
Inflow hyd. No. = 4
Max. Elevation = 78.06 ft

Peak discharge = 14.30 cfs
Time interval = 10 min
Reservoir name = BMP
Max. Storage = 25,840 cuft

Storage Indication method used.

Total Volume = 59,046 cuft

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
0.33	8.97	75.86	12.29	0.35	----	----	----	----	----	----	0.35
0.50	29.91 <<	77.14	13.50	0.59	----	----	2.04	----	----	----	2.63
0.67	16.15	78.06 <<	14.30	----	----	----	41.00	----	----	----	14.30 <<
0.83	11.67	78.04	14.28	----	----	----	39.73	----	----	----	14.28
1.00	7.48	77.75	14.03	----	----	----	24.44	----	----	----	14.03
1.17	5.38	77.39	13.72	0.63	----	----	9.35	----	----	----	9.98
1.33	4.49	77.23	13.58	0.60	----	----	4.34	----	----	----	4.94
1.50	4.19	77.21	13.56	0.60	----	----	3.77	----	----	----	4.37
1.67	3.89	77.20	13.55	0.60	----	----	3.46	----	----	----	4.06
1.83	0.00	77.12	13.48	0.59	----	----	1.72	----	----	----	2.31
2.00	0.00	77.02	13.39	0.57	----	----	0.28	----	----	----	0.86
2.17	0.00	76.98	13.35	0.57	----	----	----	----	----	----	0.57
2.33	0.00	76.94	13.31	0.56	----	----	----	----	----	----	0.56
2.50	0.00	76.90	13.28	0.55	----	----	----	----	----	----	0.55
2.67	0.00	76.86	13.24	0.55	----	----	----	----	----	----	0.55
2.83	0.00	76.82	13.20	0.54	----	----	----	----	----	----	0.54
3.00	0.00	76.78	13.17	0.53	----	----	----	----	----	----	0.53
3.17	0.00	76.74	13.13	0.53	----	----	----	----	----	----	0.53
3.33	0.00	76.70	13.10	0.52	----	----	----	----	----	----	0.52
3.50	0.00	76.67	13.07	0.51	----	----	----	----	----	----	0.51
3.67	0.00	76.63	13.03	0.51	----	----	----	----	----	----	0.51
3.83	0.00	76.59	13.00	0.50	----	----	----	----	----	----	0.50
4.00	0.00	76.56	12.96	0.50	----	----	----	----	----	----	0.50
4.17	0.00	76.52	12.93	0.49	----	----	----	----	----	----	0.49
4.33	0.00	76.49	12.90	0.48	----	----	----	----	----	----	0.48
4.50	0.00	76.45	12.87	0.48	----	----	----	----	----	----	0.48
4.67	0.00	76.42	12.83	0.47	----	----	----	----	----	----	0.47
4.83	0.00	76.39	12.80	0.46	----	----	----	----	----	----	0.46
5.00	0.00	76.35	12.77	0.46	----	----	----	----	----	----	0.46
5.17	0.00	76.32	12.74	0.45	----	----	----	----	----	----	0.45
5.33	0.00	76.29	12.71	0.45	----	----	----	----	----	----	0.45
5.50	0.00	76.26	12.68	0.44	----	----	----	----	----	----	0.44
5.67	0.00	76.23	12.65	0.43	----	----	----	----	----	----	0.43
5.83	0.00	76.20	12.62	0.43	----	----	----	----	----	----	0.43
6.00	0.00	76.17	12.59	0.42	----	----	----	----	----	----	0.42
6.17	0.00	76.14	12.56	0.41	----	----	----	----	----	----	0.41

Continues on next page...

Hydrograph Discharge Table

Time (hrs)	Inflow cfs	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	Clv D cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Outflow cfs
6.33	0.00	76.11	12.54	0.41	----	----	----	----	----	----	0.41
6.50	0.00	76.08	12.51	0.40	----	----	----	----	----	----	0.40
6.67	0.00	76.05	12.48	0.39	----	----	----	----	----	----	0.39
6.83	0.00	76.02	12.45	0.39	----	----	----	----	----	----	0.39
7.00	0.00	75.99	12.42	0.38	----	----	----	----	----	----	0.38
7.17	0.00	75.96	12.39	0.37	----	----	----	----	----	----	0.37
7.33	0.00	75.93	12.37	0.37	----	----	----	----	----	----	0.37
7.50	0.00	75.90	12.34	0.36	----	----	----	----	----	----	0.36
7.67	0.00	75.87	12.31	0.35	----	----	----	----	----	----	0.35
7.83	0.00	75.85	12.28	0.35	----	----	----	----	----	----	0.35
8.00	0.00	75.82	12.25	0.34	----	----	----	----	----	----	0.34
8.17	0.00	75.79	12.23	0.33	----	----	----	----	----	----	0.33
8.33	0.00	75.76	12.20	0.32	----	----	----	----	----	----	0.32
8.50	0.00	75.74	12.17	0.32	----	----	----	----	----	----	0.32
8.67	0.00	75.71	12.15	0.31	----	----	----	----	----	----	0.31
8.83	0.00	75.69	12.12	0.30	----	----	----	----	----	----	0.30
9.00	0.00	75.66	12.10	0.30	----	----	----	----	----	----	0.30
9.17	0.00	75.64	12.07	0.29	----	----	----	----	----	----	0.29
9.33	0.00	75.62	12.05	0.28	----	----	----	----	----	----	0.28
9.50	0.00	75.59	12.03	0.27	----	----	----	----	----	----	0.27
9.67	0.00	75.57	12.01	0.26	----	----	----	----	----	----	0.26
9.83	0.00	75.55	11.99	0.25	----	----	----	----	----	----	0.25
10.00	0.00	75.53	11.97	0.24	----	----	----	----	----	----	0.24
10.17	0.00	75.51	11.95	0.24	----	----	----	----	----	----	0.24
10.33	0.00	75.49	11.93	0.22	----	----	----	----	----	----	0.22
10.50	0.00	75.48	11.91	0.21	----	----	----	----	----	----	0.21
10.67	0.00	75.46	11.89	0.20	----	----	----	----	----	----	0.20
10.83	0.00	75.44	11.88	0.19	----	----	----	----	----	----	0.19
11.00	0.00	75.43	11.86	0.17	----	----	----	----	----	----	0.17
11.17	0.00	75.41	11.85	0.16	----	----	----	----	----	----	0.16
11.33	0.00	75.40	11.83	0.15	----	----	----	----	----	----	0.15

...End

Type.... Mod. Rational Hyg
 Name.... DRAINAGE AREA Tag: Dev..1
 File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\
 Storm... e, b, d Tag: Dev..1

Page 5.01
 Event: 1 yr

MODIFIED RATIONAL METHOD HYDROGRAPH ✓

$Q = CiA * \text{Units Conversion}$; Where Conversion = 43560 / (12 * 3600)

Tag	Freq	File	IDF Curve
Dev..1	1	JCC.IDQ	e = .9050 b = 63.0330 d = 12.2000

Td = .5333 hrs

Tag	Freq (years)	C	C adj factor	C final	I in/hr	Area acres	Peak Q cfs
Dev..1	1	.550	1.000	.550	2.0439	6.900	7.82

HYG file = S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\IBV-MR.HYG
 HYG ID = DRAINAGE AREA
 HYG Tag = Dev..1

Peak Discharge = 7.82 cfs
 Time to Peak = .1700 hrs
 HYG Volume = .345 ac-ft

* *

* * = 15,028 CF ✓

HYDROGRAPH ORDINATES (cfs)

Output Time increment = .0100 hrs

Time on left represents time for first value in each row.

Time hrs					
.0000	.00	.46	.92	1.38	1.84
.0500	2.30	2.76	3.22	3.68	4.14
.1000	4.60	5.06	5.52	5.98	6.44
.1500	6.90	7.36	7.82	7.82	7.82
.2000	7.82	7.82	7.82	7.82	7.82
.2500	7.82	7.82	7.82	7.82	7.82
.3000	7.82	7.82	7.82	7.82	7.82
.3500	7.82	7.82	7.82	7.82	7.82
.4000	7.82	7.82	7.82	7.82	7.82
.4500	7.82	7.82	7.82	7.82	7.82
.5000	7.82	7.82	7.82	7.82	7.51
.5500	7.05	6.59	6.13	5.67	5.21
.6000	4.75	4.29	3.83	3.37	2.91

MASTER DESIGN STORM SUMMARY

Default Network Design Storm File, ID JCC.IDQ

jcc

$$i = b / ((T + d)**e)$$

Where: i = rainfall intensity (in/hr)

T = rainfall duration (min)

e, b, d = rainfall equation coefficients

Return Event	Rainfall Type	e coeff	b coeff	d coeff
Dev..1	I-D-F from e, b, d coeff.	.9050	63.0330	12.2000
Dev..2	I-D-F from e, b, d coeff.	.9070	79.8580	14.0000
Dev.10	I-D-F from e, b, d coeff.	.9430	143.7170	19.2000
Dev.25	I-D-F from e, b, d coeff.	.9420	172.1050	21.2000
Dev100	I-D-F from e, b, d coeff.	.9860	273.9490	26.3000

MASTER NETWORK SUMMARY
Modified Rational Method Network

(*Node=Outfall; +Node=Diversion;)

(Trun= HYG Truncation: Blank=None; L=Left; R=Rt; LR=Left&Rt)

Storage Node ID	Return		HYG Vol		Qpeak		Max WSEL	Max Pond
	Type	Event	ac-ft	Trun	hrs	cfs	ft	ac-ft
DRAINAGE AREA	AREA	1	.345		.1700	7.82		
DRAINAGE AREA	AREA	2	.432		.1700	8.96		
DRAINAGE AREA	AREA	10	.646		.1700	11.72		
DRAINAGE AREA	AREA	25	.773		.1700	13.06		
DRAINAGE AREA	AREA	100	.983		.1700	15.19		
*OUTFALL	JCT	1	.340		.6700	.53		
*OUTFALL	JCT	2	.425		.6900	3.14		
*OUTFALL	JCT	10	.639		.7000	9.60		
*OUTFALL	JCT	25	.766		.7400	11.23		
*OUTFALL	JCT	100	.976		.8000	13.21		
POND	IN POND	1	.345		.1700	7.82		
POND	IN POND	2	.432		.1700	8.96		

AES CALCULATIONS

WORKSHEET FOR BMP POINT SYSTEM

TOTAL SITE AREA = 7.75 AC.

A. STRUCTURAL BMP POINT ALLOCATION

<u>BMP</u>	<u>BMP Points</u>	<u>Fraction of Site Served</u>	<u>Weighted BMP Points</u>
Wet Pond (E.D.)	10 ✓	$x (6.30+0.59) \div 7.75 =$	<u>8.89</u>

TOTAL WEIGHTED STRUCTURAL BMP POINTS:

8.89

B. NATURAL OPEN SPACE CREDIT

<u>Adjacent To Wetland</u>	<u>Natural Open Space Credit</u>	<u>Fraction of Site</u>	<u>Points for Natural Open Space</u>
No	10	$x 0.94 \div 7.75$	$= 1.21$

C. TOTAL WEIGHTED POINTS

<u>Structural BMP Points</u>		<u>Natural Open Space Points</u>		<u>Total</u>
8.89	+	1.21	=	10.10 ✓

NOTES:

- 1) Natural open space has been placed in a conservation easement.

JOBS\8914\01-IBV\Design\Pond\bmp-pnts.doc

Impervious Area and Required Volume Calculations
for
Ironbound Village
AES# 8914-1

Impervious items	Totals		Acres
Houses	23 Ea	1350 SF	0.71
T.H.	7 Ea	912 SF	0.15
Office	4 Ea	2400 SF	0.22
Dreways	23 Ea	312 SF	0.16
Roads:			
Public	870 LF	31 Width	0.62
Private	530 LF	60 Width	0.73
Pond Access Rd	340 LF	12 Width	0.09
Wet Pond Surface @ N.P.	105 LF	65 Width	0.16
Sidewalks:			
w/in R/W	850 LF	8 Width	0.16
Offsite Road	500 LF	12 Width	0.14
Total Impervious Area (TIA)			3.14

Area to Pond = 6.8 Acres

Percent Impervious = 46%

Pond's Required Wet Volume = $(1")(\text{ft}/12")(\text{TIA Ac})(43560 \text{ sf}/\text{Ac}) = 11,390 \text{ c.f.}$

Pond's Required Dry Volume = $(1")(\text{ft}/12")(\text{TIA Ac})(43560 \text{ sf}/\text{Ac}) = 11,390 \text{ c.f.}$

Sediment Forebay's Required Volume = $(0.1")(\text{ft}/12")(\text{TIA Ac})(43560 \text{ sf}/\text{Ac}) = 1,139 \text{ c.f.}$

STREAM CHANNEL PROTECTION CALCULATIONS
for
Ironbound Village
AES Project No.: 8914-1

PROPOSED POND VOLUME

Eleva	Depth	Area (sq. ft.)	Incremental Volume (cu. ft.)	Sum Volume (cu. ft.)	Sum Volume (cu. yd.)	Volume Above NPE
70.0	0.0	1,094	0	0	0	
72.0	2.0	2,396	3,490	3,490	129	
73.7	1.7	4,303	5,694	9,184	340	
74.0	0.3	5,971	1,541	10,725	397	
75.0	1.0	6,918	6,445	17,170	636	0
76.0	1.0	7,865	7,392	24,561	910	7,391
77.0	1.0	8,926	8,395	32,957	1,221	15,787
78.0	1.0	9,986	9,456	42,412	1,571	25,242
78.5	0.5	10,684	5,168	47,580	1,762	30,410
80.0	1.5	12,776	17,595	65,175	2,414	48,005

RELEASE RATE REQUIRED TO DETAINED VOLUME FOR 24 HOURS

Required Volume based upon 1-Year, 24-Hour Storm Hydrograph =

15,028 cubic feet ✓

Volume provided based upon above table =

15,787 cubic feet

Elevation of water surface associated with provided volume =

77.0

Elevation of Low Flow Orifice =

75.0

Average Head, in feet =

1.0

Average Release Rate Calculation

$$\frac{15,787 \text{ cubic feet}}{(24 \text{ hours} \times 60 \text{ minutes/hour} \times 60 \text{ seconds/minute})} =$$

0.2 cfs

*AND RATIONAL
EST. CRITICAL
STORM OVR.*

LOW FLOW ORIFICE DIAMETER REQUIRED TO MAINTAIN AVERAGE RELEASE RATE

$$\text{Diameter of Low Flow Orifice} = 2 * (Q / ((64.32 * (h / 2)) ^ (1/2) * 0.6 * 3.14))) ^ (1/2)$$

where, Q equals average release rate (cfs), h equals average head (feet)

Diameter of Low Flow Orifice =

0.30

feet, or

4 inches

*CALEB Hurst /
CJ BOONAR
AND MARIC*

MASTER NETWORK SUMMARY
Modified Rational Method Network

(*Node=Outfall; +Node=Diversiion;)
(Trun= HYG Truncation: Blank=None; L=Left; R=Rt; LR=Left&Rt)

Storage Node ID	Return Type Event	HYG Vol ac-ft	Trun	Qpeak hrs	Qpeak cfs	Max WSEL ft	Max Pond ac-ft
POND	IN POND	10		.1700	11.72		
POND	IN POND	25		.1700	13.06		
POND	IN POND	100		.1700	15.19		
POND	OUT POND	1		.6700	.53	76.82	.716
POND	OUT POND	2		.6900	3.14	77.13	.780
POND	OUT POND	10		.7000	9.60	77.45	.847
POND	OUT POND	25		.7400	11.23	77.57	.874
POND	OUT POND	100		.8000	13.21	77.80	.925

Q_{out}

ELEV.

OHW

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

OUTLET STRUCTURE INPUT DATA

Structure ID = CV
Structure Type = Culvert-Circular

No. Barrels = 1
Barrel Diameter = 1.2500 ft
Upstream Invert = 69.00 ft
Dnstream Invert = 68.00 ft
Horiz. Length = 100.00 ft
Barrel Length = 100.01 ft
Barrel Slope = .01000 ft/ft

OUTLET CONTROL DATA...

Mannings n = .0130
Ke = .5000 (forward entrance loss)
Kb = .023225 (per ft of full flow)
Kr = .5000 (reverse entrance loss)
HW Convergence = .001 +/- ft

INLET CONTROL DATA...

Equation form = 1
Inlet Control K = .0078
Inlet Control M = 2.0000
Inlet Control c = .02920
Inlet Control Y = .7400
T1 ratio (HW/D) = 1.131
T2 ratio (HW/D) = 1.202
Slope Factor = -.500

Use unsubmerged inlet control Form 1 equ. below T1 elev.
Use submerged inlet control Form 1 equ. above T2 elev.

In transition zone between unsubmerged and submerged inlet control,
interpolate between flows at T1 & T2...

At T1 Elev = 70.41 ft ---> Flow = 4.80 cfs
At T2 Elev = 70.50 ft ---> Flow = 5.49 cfs

Structure ID = TW
Structure Type = TW SETUP, DS Channel

FREE OUTFALL CONDITIONS SPECIFIED

CONVERGENCE TOLERANCES...

Maximum Iterations= 30
Min. TW tolerance = .01 ft
Max. TW tolerance = .01 ft
Min. HW tolerance = .01 ft
Max. HW tolerance = .01 ft
Min. Q tolerance = .10 cfs
Max. Q tolerance = .10 cfs

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

OUTLET STRUCTURE INPUT DATA

Structure ID = SW
Structure Type = Weir-Rectangular

of Openings = 1
Crest Elev. = 78.50 ft
Weir Length = 8.00 ft
Weir Coeff. = 3.000000

Weir TW effects (Use adjustment equation)

Structure ID = SP
Structure Type = Stand Pipe

of Openings = 1
Invert Elev. = 77.00 ft
Diameter = 3.0000 ft
Orifice Area = 7.0686 sq.ft
Orifice Coeff. = .600
Weir Length = 9.42 ft
Weir Coeff. = 3.000
K, Submerged = .000
K, Reverse = 1.000
Kb, Barrel = .000000 (per ft of full flow)
Barrel Length = .00 ft
Mannings n = .0000

Structure ID = OR
Structure Type = Orifice-Circular

of Openings = 1
Invert Elev. = 75.00 ft
Diameter = .3300 ft
Orifice Coeff. = .600

Type.... Outlet Input Data
Name.... OUTLET

Page 1.01

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

REQUESTED POND WS ELEVATIONS:

Min. Elev.= 70.00 ft
Increment = .50 ft
Max. Elev.= 80.00 ft

OUTLET CONNECTIVITY

---> Forward Flow Only (UpStream to DnStream)
<--- Reverse Flow Only (DnStream to UpStream)
<---> Forward and Reverse Both Allowed

Structure	No.		Outfall	E1, ft	E2, ft
Weir-Rectangular	SW	--->	TW	78.500	80.000
Stand Pipe	SP	--->	CV	77.000	80.000
Orifice-Circular	OR	--->	CV	75.000	80.000
Culvert-Circular	CV	--->	TW	69.000	80.000
TW SETUP, DS Channel					

Type.... Composite Rating Curve
Name.... OUTLET

Page 1.04

File.... S:\JOBS\8914\01-IBV\DESIGN\POND-E&S\HAESTAD\POND.PPW

***** COMPOSITE OUTFLOW SUMMARY *****

WS Elev, Total Q		Converge		Notes
Elev. ft	Q cfs	TW Elev ft	Error +/-ft	Contributing Structures
70.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
70.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
71.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
71.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
72.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
72.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
73.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
73.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
74.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
74.50	.00	Free Outfall		(no Q: SW,SP,OR,CV)
75.00	.00	Free Outfall		(no Q: SW,SP,OR,CV)
75.50	.24	Free Outfall		OR,CV (no Q: SW,SP)
76.00	.38	Free Outfall		OR,CV (no Q: SW,SP)
76.50	.48	Free Outfall		OR,CV (no Q: SW,SP)
77.00	.56	Free Outfall		OR,CV (no Q: SW,SP)
77.50	10.63	Free Outfall		SP,OR,CV (no Q: SW)
78.00	14.90	Free Outfall		SP,CV (no Q: SW,OR)
78.50	15.32	Free Outfall		SP,CV (no Q: SW,OR)
79.00	24.21	Free Outfall		SW,SP,CV (no Q: OR)
79.50	40.12	Free Outfall		SW,SP,CV (no Q: OR)
80.00	60.60	Free Outfall		SW,SP,CV (no Q: OR)

8. Correspondence With Owners

Scott Thomas

From: Scott Thomas
Sent: Wednesday, September 26, 2001 5:34 PM
To: Darryl Cook
Subject: Howard Price Call

I returned call in response to the call you received (and forwarded to me) from Howard Price about the Ironbound Village BMP.

Computations for the BMP were very incomplete in the first review of the project as it related to WQ/SCPv. Comment # 29 in our first review dated April 25th 2001 was as follows.

"BMP Design. Design computations for the BMP as presented in the design report are incomplete. The last two pages of the report are not readable. No information appears is provided to support volumes associated with the water quality wet and extended detention pools or to verify the low-flow orifice size provides adequate drawdown time for water quality or stream channel protection criteria. Additional information is required to support peak discharge hydrologic assumptions for pre- and post-development including: drainage areas, composite runoff coefficients and times of concentration. Refer to Section III of the standard erosion and sediment control and stormwater management design plan checklist for information that is required to be presented."

In a followup 2nd review of the project, there appeared to be a routing problem which focused me in more on the computations. The 10- and 100- WSEL's in the BMP never even got to riser crest, so in looking closer at the comps I saw they used straight rational method, rather than SCS or Modified Rational-Critical Storm to compute the SCPv. The comments in our second review dated August 6th were as follows:

"Stream Channel Protection. Provide additional information to support the value of 14,939 cubic feet as used as the basis for the stream channel protection volume computation. Usually the volume for the 1-year, 24 hour storm event is computed using SCS or the Modified Rational Method-Critical Storm duration approach. If the basic Rational Method (triangular runoff hydrograph) approach was used to determine the SCP volume, the design value may be underestimated."

"BMP Design. Although no distinct discrepancies could be found in the pond's hydraulic report, please check connectivity in the hydraulic computer model for the basin. It is questionable, considering the small size of the basin and the relatively small peak outflow design discharges, that the water surface elevation for the 10- and 100-year storm events would not reach or go above the riser crest set at El. 77.0."


As I recall, I think I even discussed these issues with you briefly as a "what do you think" type question.

Therefore, their lack of comps in the first review does not exclude them from further scrutiny in the second review. I don't raise new issues if I miss them on the 1st review unless it is serious and I can justify my actions. This is not the case, as I mentioned the incompleteness of their BMP design in the first review. In addition, I also discussed this in full with one of their engineers, I think Robert Wornom, after issue of the comments on August 6th.

No further action is needed from us.

Scott

*Met w/ Howard Price, Robert Wornom (AES)
? Howard Hankins and Frank? Turlington
on 10/18/01.*



5248 Olde Towne Road • Suite 1 • Williamsburg, Virginia 23188
(757) 253-0040 • Fax (757) 220-8994 • E-mail aes@aesva.com

October 3, 2001

Mr. Scott J. Thomas, P.E.
James City County Environmental Division
101-E Mounts Bay Road
P.O. Box 8784
Williamsburg, VA 23187-8784

**RE: Ironbound Village
Pond Benches
AES Project No. 8914-1**

Dear Mr. Thomas:

This letter is in regard to the benches for the BMP/SWM pond. The JCC BMP manual states the following: "Where feasible based on topography, the perimeter of all deep pool areas (four feet or greater in depth) should be surrounded by two benches: A safety bench that extends 15 feet outward from the normal water edge to the toe of the pond side slope. The maximum slope of the safety bench shall be 6%. An aquatic bench that extends up to 15 feet inward from the normal shoreline and has a maximum depth of twelve inches below the normal pool water surface elevation."

The following conditions are being honored to preserve the intent of the manual. A 6-foot wide aquatic bench with a 5% slope has been provided per previous agreements with Darryl Cook? A 6-foot wide intermediate safety bench with a 5% slope has been provided, and a 15-foot safety bench with a 2% slope has been provided between the top of the slope and the curb.

Should you have any questions or require additional information, please do not hesitate to contact me.

Sincerely,

AES Consulting Engineers

Robert G. Wornom, P.E.
Project Manager

DARRYL,
I RAISED ISSUE
ABOUT 6' WIDE
BENCHES. Both are
provided and I WAS
not aware you
discussed with them.
However, I am OK
WITH THE REQUEST
SURT


Send APPROVAL
letter

S-36-01
SP-29-01
Ironbound Village

LANDMARK DESIGN GROUP

January 16, 2002

Mr. Scott Thomas, P.E.
James City County Environmental Division
P.O. Box 8784
Williamsburg, VA 23187-8784

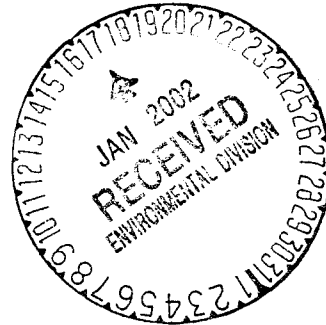

Re: Ironbound Village Subdivision and Site Plan
Case Nos. S-36-01 and SP-29-01
LMDG Job No. 2001112-000.07

Dear Scott:

We are pleased to submit, for approval, two (2) copies of the revised pond routing calculations for the above referenced project. As previously discussed, Cutting Edge Development, L.L.C. has employed our firm to assist them in obtaining final approval for these projects. The information we are submitting to you is a supplement to the plans and calculations that were previously submitted by Cutting Edge's original consultant, AES Consulting Engineers.

As we discussed last month, the developer is concerned with maintenance of the outfall structure due to the riser being thirty-six (36) inches in diameter. We have revised the calculations, per our discussions, to show the effects of using a forty-eight (48) inch riser. The calculations show no detrimental rise in the pond due to the increase in riser diameter.

If any questions or comments should arise, please do not hesitate to contact us.

Best regards,
The LandMark Design Group Inc.

Charles J. Bodnar, P.E.
Project Manager

Enclosures

CJB/cb

File: 2001112-000.07
Cutting Edge Development, L.L.C.

Approval

Based on a review of supporting information received January 17th 2002, a request to change riser structure from 36-inch diameter concrete to 48-inch diameter concrete reviewed and found acceptable. This revision is considered a minor plan change, as based on our review of information, there is no considerable change in BMP hydraulics or layout and configuration. Riser shall be reinforced concrete pipe with O-ring gaskets meeting the requirements of ASTM C361 or ASTM C76 with gaskets meeting ASTM C443; or precast manhole meeting ASTM C478 with profile gaskets meeting ASTM C443. Anti-vortex/trash rack device size shall also change appropriately consistent with the riser size change and details as shown on the previously approved plan. Record drawings (as-builts) shall reflect final riser type and size used in the field.

Scott J. Thomas, P.E.
Civil Engineer
Environmental Division

1-23-02
Date

Engineers • Planners • Surveyors • Landscape Architects • Environmental Consultants
4029 Ironbound Road, Suite 100, Williamsburg, VA 23188 (757) 253-2975 FAX: (757) 229-0049 lmdg@landmarkdgbw.com

Scott Thomas

From: Scott Thomas
Sent: Tuesday, August 31, 2004 5:08 PM
To: Michael Drewry
Subject: RE: Ironbound Village Answer

As discussed, it would be too difficult for me to give percentage of runoff, as runoff is variable between storm events (ie. 1-year, 2-year, 10-year, 100-year, etc.). I believe the best way to do this is by strict percentage of drainage area the BMP serves. In review of the entire case files for Ironbound Village Phase I (subdivision) and Phase II (site plan-commercial), the BMP serves a total postdevelopment drainage area of 6.89 acres (6.9 acres). This is the postdevelopment drainage area to the basin with all the grading and storm drainage system in place. The drainage area will not change, even if the configurations and cover conditions vary slightly.

On a percentage, you said the to-be-County owned parcels totals 1.39 acres, consisting of Parcels 1A (building to parking), 1B (building), 3 (building), 4 (building) and 2B (parking/road around building 3). This results in $1.39/6.9 = 20.14$ percent. Therefore, about 20% of the total drainage area to the BMP will be County-owned.

This should be all that you need. If you have any questions let me know.

Scott J. Thomas, P.E.
James City County
Environmental Division

-----Original Message-----

From: Michael Drewry
Sent: Tuesday, August 31, 2004 9:41 AM
To: Scott Thomas
Subject: RE: Ironbound Village

Scott:

Let me know if I need to provide you with any detail. The reason for needing the percentage is that the owner of the commercial properties which will be JCC (Tax Parcels # 391100000(1A)(1B)(2B)(3) and (4) will share in upkeep of the stormwater retention basin in accordance with the percent of run-off from the commercial properties.

Thanks, Michael

-----Original Message-----

From: Scott Thomas
Sent: Monday, August 30, 2004 5:25 PM
To: Michael Drewry
Subject: RE: Ironbound Village

Yes, I should be able to give you a percentage. Let me look at the computations and get back to you.

Scott J. Thomas, P.E.
James City County
Environmental Division

Visit:
http://www.james-city.va.us/resources/devmgmt/div_devmgmt_environ.html
and
www.protectedwithpride.org

-----Original Message-----

From: Michael Drewry
Sent: Monday, August 30, 2004 5:00 PM

To: Scott Thomas
Subject: Ironbound Village


Scott:

I am putting together closing documents for the JCC purchase of the 5 commercial lots in the Ironbound Village subdivision. I need to know the percentage of run-off from the commercial versus remainder of project. I will need this percentage before end of the week. Can you assist with this calculation?

Thanks, Michael

Michael H. Drewry
Assistant County Attorney
101-C Mounts Bay Road
Williamsburg, Virginia 23187
Tel. # 757.253.6832
Fax # 757.253.6833

9. Inspection Records (Construction Phase)



James City County Environmental Division
Stormwater Management / BMP Inspection Report
Subsurface - Detention and Infiltration Facilities

County BMP ID Code (if known): _____

Name of Facility: Ironbound Village Phase I BMP No.: CC022 Date: 8/17/2007

Location: Northeast Corner Ironbound and Magazine

Name of Owner: Cutting Edge Development, LLC

Name of Inspector: Gregory B Johnson

Type of Facility: Wet Pond

Weather Conditions: Sunny/Hot Type: ☒ Final Inspection ☐ County BMP Inspection Program ☐ Owners Inspection

If an inspection item is not applicable, mark NA, otherwise mark the appropriate column.

- O.K. - The item checked is in adequate condition and the maintenance program is currently satisfactory. No action required.
 Routine - The item checked requires attention, but does not present an immediate threat to the function/integrity of the BMP.
 Urgent - The item checked requires immediate attention to keep the BMP operational and prevent damage to the facility.

Provide an explanation and details in the comment column, if routine or urgent are marked.

Facility Item	O.K.	Routine	Urgent	Comments
Accessibility:				
Roads	✓			
Parking Areas	✓			
Gates	NA			
Locks	NA			
Safety Fencing	NA			
Access Points:				
Trap Doors	NA			
Manholes/ Vaults	✓			
Grates	NA			
Observ Wells	NA			
Pretreatment Devices: ☐ Inlet ☐ Sump ☒ Forebay ☐ Other				
Sediment	✓			
Trash & Debris	✓			
Structure	✓			
Other	✓			

Facility Item	O.K.	Routine	Urgent	Comments
Primary Storage/ Infiltration Area Structure (Pipe, Stone, etc):				
Trash & Debris		✓		Trash located along bank of lower bay
Sediment	✓			
Ponding / Drawdown	✓			
Cracks	✓			
Joints	✓			
Seams	✓			
Coating	✓			
Aesthetics		✓		Grass needs cut upper slope
Other	NA			
Inlet Structure # 1 (Describe Location): Northeast Upper Corner				
Condition of Structure	✓			
Erosion	✓			
Trash and Debris		✓		Trash around base of structure
Sediment	✓			
Aesthetics	✓			
Other				
Inlet Structure # 2 (Describe Location):				
Condition of Structure	✓			
Erosion	✓			
Trash and Debris	✓			
Sediment	✓			
Aesthetics	✓			
Other				
Inlet Structure # 3 (Describe Location):				
Condition of Structure	✓			
Erosion	✓			
Trash and Debris	✓			
Sediment	✓			
Aesthetics	✓			
Other				
Outlet - Principal Overflow or Bypass Structure (Describe Location):				
Condition of Structure	✓			
Erosion	✓			
Trash and Debris	✓			
Sediment	✓			
Other				


11. Miscellaneous

CC022

Contents for Stormwater Management Facilities As-built Files

Each file is to contain:

- ① As-built plan
2. Completed construction certification
3. Construction Plan
- ④ Design Calculations
- ⑤ Watershed Map
6. Maintenance Agreement
7. Correspondence with owners
- ⑧ Inspection Records
9. Enforcement Actions



James City County, Virginia
Environmental Division

Erosion and Sediment Control and
Stormwater Management Design Plan Checklists

Table of Contents

<u>Contents</u>	<u>Page</u>
Erosion and Sediment Control Plan	
I. General	1
II. Site Plan	1
III. Narrative	3
IV. Calculations	4
Stormwater Management Design Plan	
I. General	5
II. Stormwater Conveyance Systems	7
III. Stormwater Management / BMP Facilities	8
IV. Outlet Protections	13
V. Additional Comments and Information	14

GENERAL INFORMATION

Project Name: IRONBOUND VILLAGE

Owner / Applicant: CUTTING EDGE, Inc.

Designer: AFS

Location: _____

Tax Map / Parcel: (39-1) (1-47 & 47A)

County Plan No. (if known): SP-29-01 & S-36-01

County BMP Type: WET POND EXTENDED DETENTION (-)

Other information submitted in addition to this checklist (Check all that apply):

- ☒ Design or Construction Drawings (Plans, Profiles, Details, etc.).
- ☒ Erosion & Sediment Control Plan (Plans, Details, etc.).
- ☒ Erosion & Sediment Control Plan Design Report.
- ☒ Stormwater Management Design Plan (Plans, Profiles, Details, etc.).
- ☒ Stormwater Management Design Report.
- ☐ Other, List: _____

Pre-Final Version
March 9, 2000

**JAMES CITY COUNTY, VIRGINIA
ENVIRONMENTAL DIVISION**

EROSION AND SEDIMENT CONTROL PLAN CHECKLIST

I. GENERAL:

Yes No N/A

- ☒ ☐ ☐ *FAMILIARITY* with current versions of Chapter 8, Erosion and Sedimentation Control and Chapter 23, Chesapeake Bay Preservation ordinances of the Code of James City County, Virginia and the Virginia Erosion and Sediment Control Handbook (VESCH).
- ☒ ☐ ☐ *LAND DISTURBING PERMIT AND SILTATION AGREEMENT* with surety are required for the project.
- ☐ ☐ ☒ *VARIANCE* if necessary, requested in writing, for the plan approving authority to waive or modify any of the minimum standards and specifications of the VESCH deemed inappropriate based on site conditions specific to this review case only. Variances which are approved shall be properly documented in the plan and become part of the approved erosion and sediment control plan for the site.

II. SITE PLAN:

Yes No N/A

- ☒ ☐ ☐ *VICINITY MAP* locating the site in relation to the surrounding area. Include any major landmarks which might assist in physically locating the site.
- ☒ ☐ ☐ *INDICATE NORTH* direction in relation to the site.
- ☒ ☐ ☐ *LIMITS OF CLEARING AND GRADING* for the site including that required for implementation of erosion and sediment controls and stockpile areas.
- ☒ ☐ ☐ *DISTURBED AREA ESTIMATES* in acres or square feet for the project.
- ☒ ☐ ☐ *EXISTING TOPOGRAPHY* or contours for the site at no more than 5 foot contour interval.
- ☒ ☐ ☐ *FINAL TOPOGRAPHY*, contours or proposed site grading in accordance with the design plan which indicates changes to existing topography and drainage patterns at no more than 2 foot contour interval.
- ☒ ☐ ☐ *EXISTING AND PROPOSED SPOT ELEVATIONS* to supplement existing and proposed contours, topography or site grading information. Spot elevations may replace final contours in some instances, especially if terrain is in a low lying area or relatively flat.
- ☒ ☐ ☐ *EXISTING VEGETATION* including existing tree lines, grassed or unique vegetation areas.

Yes No N/A

☒ ☐ ☐

EXISTING SITE FEATURES including roads, buildings, homes, utilities, streams, fences, structures and other important surface features of the site.

☒ ☐ ☐

SOILS MAP with soil symbols, boundaries and legend in accordance with the current Soil Survey of James City and York Counties and the City of Williamsburg, Virginia.

☒ ☐ ☐

ENVIRONMENTAL INVENTORY in accordance with Section 23-10(2) of the Chesapeake Bay Preservation Ordinance of James City County. Inventory generally includes: tidal shores and wetlands, non-tidal wetlands, resource protection area, hydric soils and slopes steeper than 25 percent. For wetlands, provide a copy of issued permits or satisfactory evidence that appropriate permits are being pursued for the entire project.

☒ ☐ ☐

100-YEAR FLOODPLAIN LIMITS or any special flood hazard areas or flood zones based on appropriate Federal Management Agency Flood Insurance Rate Maps (FIRMs) or Flood Hazard Boundary Maps (FHBMs) of James City County, Virginia.

☒ ☐ ☐

EXISTING AND PROPOSED DRAINAGE AREAS for offsite and onsite areas. Include drainage divides and directional labels for all subareas at points of interest and size (in acres), weighted runoff coefficient or curve number and times of concentration for each subarea.

☒ ☐ ☐

CRITICAL EROSION AREAS which require special consideration or unique erosion and sediment control measures. Refer to the VESCH, Chapter 6 for criteria.

☒ ☐ ☐

DEVELOPMENT PLAN for the site showing all improvements such as buildings, structures, parking areas, access roadways, above and below ground utilities, stormwater management and drainage facilities, trails or sidewalks, proposed vegetation and landscaping, amenities, etc.

☒ ☐ ☐

LOCATION OF PRACTICES proposed for erosion and sediment control, tree protection and temporary stormwater management due to land disturbance activities at the site. Use standard abbreviations, labels and symbols consistent with the minimum standards and specification in Chapter 3 of the VESCH.

☒ ☐ ☐

TEMPORARY STOCKPILE AREAS or staging and equipment storage areas as required for onsite or offsite construction activities or indicate that none are anticipated for this project.

☒ ☐ ☐

OFFSITE LAND DISTURBING AREAS including borrow sites, waste areas, utility extensions, etc. and required erosion and sediment controls. If none are anticipated for the project, then indicate on the plans by general or erosion and sediment control notes.

☒ ☐ ☐

DETAILS in accordance with the minimum standards and specifications in Chapter 3 of the VESCH for each erosion and sediment control measure proposed for the project. Schedules or tables may be used for multiple site measures such as sediment traps, basins, stormwater conveyance channels, slope drains, etc. Any modifications to the standard details should be clearly defined, explained and illustrated.

Yes No N/A

☒ ☐ ☐

MAINTENANCE PLAN outlining the inspection frequency and maintenance requirements for all erosion and sediment control measures proposed for the project.

☐ ☐ ☒

TRENCH DEWATERING methods and erosion and sediment controls, if anticipated for the project.

☒ ☐ ☐

CONSTRUCTION SEQUENCE outlining the anticipated sequence for installation of erosion and sediment controls and site, grading and utility work to be performed for the project by the site contractor.

☒ ☐ ☐

PHASING PLAN if required for larger project sites that are to be developed in stages or phases.

☒ ☐ ☐

STANDARD COUNTY NOTES are required to be placed on the erosion and sediment control plan. Refer to the standard James City County Erosion and Sediment Control Notes dated May 5, 1999.

☒ ☐ ☐

PROFESSIONAL SEAL AND SIGNATURE required on final and complete approved plans, drawings, technical reports and specifications.

III. NARRATIVE:

Yes No N/A

☒ ☐ ☐

PROJECT DESCRIPTION briefly describing the nature and purpose of the land disturbing activity and the acreage to be disturbed.

☒ ☐ ☐

EXISTING SITE CONDITIONS description of existing topography, land use, cover and drainage patterns at the site.

☒ ☐ ☐

ADJACENT AREA descriptions for neighboring onsite or offsite areas such as streams, lakes, property, roads, etc. and potential impacts due to concentrated flow or runoff from the land disturbing activity.

☒ ☐ ☐

OFFSITE DISTURBED AREA descriptions of proposed borrow sites, waste or surplus areas, utility extensions and erosion and sediment controls to be implemented.

☒ ☐ ☐

SOILS DESCRIPTION briefly summarizing site, disturbed area and drainage basin soils including name, unit, hydrologic soil group (HSG) classification, surface runoff potential, erodibility, permeability, depth, texture, structure, erosion hazards, shrink-swell potential, limitations for use and anticipated depths to bedrock and the seasonal water table, as applicable.

☒ ☐ ☐

CRITICAL AREAS on the site which may have potentially serious erosion and sediment control problems and special considerations required (ie. steep slopes, hydric, channels, springs, sinkholes, etc.)

Yes No N/A

☒ ☐ ☐

PROPOSED EROSION & SEDIMENT CONTROL MEASURES inclusive to the specific erosion and sediment control plan proposed for the land disturbing activity. Measures should be consistent with those proposed in the site plan. Address general use, installation, limitations, sequencing and maintenance requirements for each control measure.

☒ ☐ ☐

STABILIZATION MEASURES required for the site, either temporary or permanent, and during and following construction including temporary and permanent seeding and mulching, paving, stone, soil stabilization blankets and matting, sodding, landscaping or special stabilization techniques to be utilized at the site.

☒ ☐ ☐

STORMWATER MANAGEMENT CONSIDERATIONS for the site, either of temporary or permanent nature, and strategies, sequences and measures required for control. May reference the stormwater management plan for the site, if prepared, for permanent stormwater management facilities and control of drainage once the site is stabilized.

IV. CALCULATIONS:

Yes No N/A

☒ ☐ ☐

CALCULATIONS AND COMPUTATIONS for erosion and sediment control hydrology, hydraulics and design for temporary and permanent erosion and sediment control measures as proposed including: sediment traps, basins, diversions, stormwater conveyance channels, culverts, slope drains, outlet protection, etc. Computations are not required on the construction plan and may be attached in a supplemental erosion and sediment control plan design report, if presented in a clear organized format.

☒ ☐ ☐

TEMPORARY SEDIMENT BASIN DESIGN DATA SHEET submitted for each basin along with schematic cross-section showing applicable design and construction data, dimensions and elevations. Peak design runoff to be based the 2- or 25-year storm event based on maximum disturbed site conditions in accordance with Minimum Standard 3.14 of the VESCH.

**JAMES CITY COUNTY, VIRGINIA
ENVIRONMENTAL DIVISION**

STORMWATER MANAGEMENT DESIGN PLAN CHECKLIST

I. GENERAL REQUIREMENTS:

Yes No N/A

- | | |
|---|--|
| ☒ ☐ ☐ | <i>FAMILIARITY</i> with current versions of the James City County Guidelines for Design and Construction of Stormwater Management BMPs manual; Chapter 8, Erosion and Sediment Control and Chapter 23, Chesapeake Bay Preservation ordinances of the Code of James City County, Virginia; the Virginia Erosion and Sediment Control Handbook (VESCH); and the Virginia Stormwater Management Handbook (VSMH). |
| ☒ ☐ ☐ | <i>WAIVER OR EXCEPTION</i> if necessary, requested in writing, for the plan approving authority to waive or except the requirements of Chapter 23, Chesapeake Bay Preservation ordinance in accordance with procedure established in Sections 23-14 through 23-17 of the ordinance. Applies to this review case only. |
| ☐ ☐ ☒ | <i>VARIANCE REQUEST</i> if necessary, requested in writing for the plan approving authority to waive or modify any of the minimum standards and specifications of the VESCH deemed inappropriate based on site conditions specific to this review case only. Variances which are approved shall be properly documented in the plan and become part of the approved erosion and sediment control plan for the site. |
| ☒ ☐ ☐ | <i>PROFESSIONAL SEAL AND SIGNATURE</i> required on final and complete approved stormwater management plans, drawings, technical reports and specifications. |
| ☒ ☐ ☐ | <i>WORKSHEET FOR BMP POINT SYSTEM</i> to ensure the stormwater management plan for the project attains at least 10 BMP points. |
| ☒ ☐ ☐ | <i>INSPECTION/MAINTENANCE AGREEMENT</i> executed with the County for the project. |
| ☒ ☐ ☐ | <i>CONSERVATION EASEMENTS</i> for all natural open space points claimed in the BMP worksheet. |
| ☒ ☐ ☐ | <i>FEMA FIRM PANEL</i> reference with designated special flood hazard areas or zone designations associated with the site, as applicable. |
| ☒ ☐ ☐ | <i>DRAINAGE AREA MAP</i> at a maximum scale of 1"=200' scale showing drawing area boundaries for pre- and postdevelopment conditions and associated time of concentration flow paths. Labels to include drainage area size, runoff coefficient or curve number and time of concentration for each subarea shown on the map. |
| ☒ ☐ ☐ | <i>SOILS MAP</i> with soil symbols, boundaries and legend in accordance with the current Soil Survey of James City and York Counties and the City of Williamsburg, Virginia with approximate locations of the project site, BMPs and applicable drainage basins. |

Yes ~~No~~ N/A

☒ ☐ ☐

STORMWATER MANAGEMENT NARRATIVE in a brief and simple format which describes the project; location; site and drainage basin soil characteristics; receiving water or drainage facility; existing site and drainage basin conditions (topography, land use, cover, slopes, etc.); proposed site development; proposed stormwater management and drainage plan including County BMP type selected; summary of hydrology and hydraulics; maintenance program; and any special assumptions utilized for development of the stormwater management and drainage design plan or computations.

☒ ☐ ☐

TEMPORARY STORMWATER MANAGEMENT and control of stormwater runoff encountered during construction activities. To be coordinated with the erosion and sediment control plan for the site. Adequate protection measures or sequencing provided.

☒ ☐ ☐

MODIFICATION PLANS for permanent BMPs including hydrologic and hydraulic computations, sequencing and details as required for any detention or retention pond(s) which will be utilized as a temporary sediment trap or basin during land disturbance or site construction activities. Not permitted for Bioretention, Infiltration and Filtering System facilities.

☒ ☐ ☐

STORMWATER MANAGEMENT DESIGN REPORT in a bound 8-1/2 x 11 inch size format. Report shall generally include a title sheet, date, project identification, owner and preparer information, table of contents, narrative, summaries and computations as required for backwater, closed conduits, headwater, hydraulics, hydraulic grade line, hydrology, inlets, open channels, pond routings, storm sewer, and water quality, extended detention or stream channel protection, as applicable, for the project. Computation data may include hand or computer generated computations and maps. All information should be presented in a clear, easy to follow format and closely match construction plan information.

☒ ☐ ☐

PLAN VIEW at 1 inch = 50 ft. scale or less (1" = 40', 1" = 30', etc.)

☒ ☐ ☐

North arrow and legend.

☒ ☐ ☐

Sealed by appropriate professional.

☒ ☐ ☐

Property Lines.

☒ ☐ ☐

Adjacent property information.

☒ ☐ ☐

Existing site features and impervious cover areas.

☒ ☐ ☐

Impervious cover estimates for the site.

☒ ☐ ☐

Existing drainage facilities (natural or manmade).

☒ ☐ ☐

Existing environmentally sensitive areas (RPA, wetlands, floodplain, steep slopes, critical soils, buffers, etc.).

☒ ☐ ☐

Existing and proposed contours (1' or 2' contour interval) and spot elevations as required for definition of high and low topography.

☒ ☐ ☐

Existing and proposed easements.

☒ ☐ ☐

Proposed site improvements and impervious cover areas.

☒ ☐ ☐

Proposed stormwater conveyance, drainage and management facilities with appropriate construction data and information.

☒ ☐ ☐

Proposed landscaping and seeding plans (interior, pond, buffers, etc.).

☒ ☐ ☐

Proposed slope stabilization areas (riprap, blankets, matings, etc.).

Yes No N/A

☒ ☐ ☐

Delineation of permanent and extended detention pools and 1-, 2-, 10- and 100-year design water surface elevations.

☐ ☐ ☒

Delineation of ponding, headwater, surcharge or backwater areas which may affect existing or proposed buildings or structures or upstream adjacent properties.

☒ ☐ ☐

Test borings locations.

☒ ☐ ☐

Risers, barrels, underdrains, overflows and outlet protections.

☒ ☐ ☐

Emergency spillway level section and outlet channel.

☒ ☐ ☐

Existing and proposed site utility locations and protection measures.

☒ ☐ ☐

Erosion and sediment control measures (for site and BMP construction).

☒ ☐ ☐

Maintenance or access corridors to permanent stormwater management, BMP or drainage facilities.

II. STORMWATER CONVEYANCE SYSTEMS:

Yes No N/A

☒ ☐ ☐ *PLAN VIEWS*

☒ ☐ ☐

Storm drain lengths, sizes, types, classes and slopes for all segments.

☒ ☐ ☐

Access structure (inlets, manholes, junctions, etc.) rim elevations, inverts, type and required grate or top unit and lengths labeled.

☒ ☐ ☐

All structure numbers labeled.

☒ ☐ ☐

Structure and pipe schedule not required but encouraged.

☒ ☐ ☐

Adequate horizontal clearance from other site utilities or structures.

☒ ☐ ☐

PROFILES generally are not required but are encouraged to expedite review. If profiles are not provided within the plan set, ensure all pipe segments have adequate minimum cover, do not exceed maximum depths of cover at final grade for the type and class specified and do not conflict with other site utilities or excavation areas.

☒ ☐ ☐

DETAILS

☒ ☐ ☐

Typical storm drain bedding details or reference note.

☒ ☐ ☐

Standard details or reference note for all proposed access structure types (inlets, manholes, junctions, etc.).

☒ ☐ ☐

Inlet shaping detail or applicable reference note.

☒ ☐ ☐

Step detail or applicable reference note (if depth 4 ft. or more).

☒ ☐ ☐

Typical open channel details with designation, location, shape, type, bottom width, top width, lining, slope, length, side slope, and installation depth required for construction. Channel design data as necessary may also be included.

☒ ☐ ☐

Outlet protections at all pipe outfalls.

Yes No N/A

☒ ☐ ☐

STORMWATER CONVEYANCE SYSTEM COMPUTATIONS

- ☒ ☐ ☐ Storm Sewer Design computations based on 10-year design event.
- ☒ ☐ ☐ Hydraulic Grade Line computations based on 10-year design event.
- ☒ ☐ ☐ Inlet computations based on 10-year design storm event for spread, ponding depth and grate size required.
- ☒ ☐ ☐ Culvert Headwater computations based on 10-year design storm and 100-year check storm.
- ☒ ☐ ☐ Open Channel computations based on 2-year design event for velocity and 10-year design event for capacity.
- ☒ ☐ ☐ Outlet protection or special energy dissipation structure computations.
- ☒ ☐ ☐ Pipe thickness design computations, as required, for selected pipe type (live load, minimum cover, maximum height of cover, etc.).
- ☒ ☐ ☐ Adequate channel computations for receiving channels (based on detailed site mapping or field surveyed channel section).

DETAINED 1-YR STORM

III. STORMWATER MANAGEMENT / BMP FACILITIES:

Yes No N/A

☒ ☐ ☐

HYDROLOGY - An SCS based methodology is required for the design of stormwater management/BMP facilities with watersheds exceeding 20 acres. Under 20 acres, other generally accepted methodologies such as the modified rational, critical storm are allowable. Refer to Chapter 5 of the VESCH or Chapter 5 of the VSMH.

- ☒ ☐ ☐ RCN determinations: predeveloped and ultimate development land use scenarios.
- ☒ ☐ ☐ Time of concentration: predeveloped and ultimate development indicating overland, shallow concentrated, and channel flow components (200 ft. maximum length for overland flow).
- ☒ ☐ ☐ Hydrograph generation (tabular or graphical): predevelopment and ultimate development peak flows for the 1-, 2-, 10-, and 100-year design storms.

☒ ☐ ☐

STORAGE VOLUME ESTIMATES required between pre-and postdevelopment conditions for the 2- and 10- year design storm events.

☒ ☐ ☐

FACILITY CONFIGURATION and MINIMUM SEPARATIONS

- ☒ ☐ ☐ Proper length to width ratio (Typically 2H:1V).
- ☒ ☐ ☐ Deep pool areas provided with two benches. Fifteen (15) ft. safety bench outward from normal pool at maximum 6 percent slope and aquatic bench inward from normal shoreline below normal pool.
- ☒ ☐ ☐ Pond buffer 25 feet outward from maximum design WSEL.
- ☒ ☐ ☐ No trees within 15 feet of embankment toe or 25 feet from principal spillway structure.

Yes No N/A

- ☐ ☐ ☒ Infiltration and filtering system facilities located at least 100 feet horizontally from any water supply well, 100 feet from any downslope buildings and 25 feet from any upslope buildings.

Yes No N/A

☒ ☐ ☐ **HYDRAULIC COMPUTATIONS**

- ☒ ☐ ☐ Elevation or Stage - Storage curve and tabular data.
- ☒ ☐ ☐ Weir / Orifice control - extended detention control.
- ☒ ☐ ☐ Weir / Orifice Control - riser 1-year control for stream protection.
- ☐ ☐ ☒ Weir / Orifice Control - riser 2 year control for quantity.
- ☐ ☐ ☒ Weir / Orifice Control - riser 10 year control for quantity.
- ☒ ☐ ☐ Inlet / Outlet (barrel) control - (all storms).
- ☒ ☐ ☐ Check for barrel control prior to riser orifice flow to prevent slug flow-water hammer conditions.
- ☐ ☐ ☒ Emergency spillway capacity and depth of flow. "TOKEN"
- ☒ ☐ ☐ Elevation - Discharge (Outlet Rating) table and curve. Provide all supporting calculations and/or design assumptions.
- ☐ ☐ ☒ Adequate channel computations for receiving channel. May be waived if facility is designed based on 1-year, 24 hour stream protection criteria.

☒ ☐ ☐ **POND or RESERVOIR ROUTING**

- ☒ ☐ ☐ Storage indication routing of ultimate development hydrographs for the 1-, 2-, 10-, and 100-year design storms. Preference is for structure to discharge up to the 10-year storm through the principal spillway and pass the 100-year storm with a minimum 1 foot of freeboard through a combination of principal and emergency spillways. If no emergency spillway is provided (prior approval required), riser must be large enough to pass the design high water flow and trash without overtopping the facility, have 3 square feet or more of cross-sectional area, contain a hood type inlet and have a minimum freeboard of 2 feet. Token spillways are also recommended with minimum 8 ft. width at or above the design 100-year storm elevation.
- ☐ ☐ ☒ Downstream hydrographs at established study points, if conditions warrant (ie. facility discharge combines with uncontrolled bypass).

☒ ☐ ☐ **MISCELLANEOUS COMPUTATIONS**

- ☒ ☐ ☐ Water quality volume for permanent pool based on selected BMP treatment volume (WQv).
- ☒ ☐ ☐ Water quality volume for extended detention based on selected BMP treatment volume (WQv) with drawdown computations.
- ☒ ☐ ☐ Drawdown computations for the 1-year, 24 hour detention for stream channel protection criteria.
- ☒ ☐ ☐ Pond drain computations (within 24 hours).
- ☒ ☐ ☐ Anti-seep collar design. (concrete preferred).
- ☐ ☐ ☒ Filter diaphragm design (or alternative method of controlling seepage).

Yes No N/A

- ☒ ☐ ☐ Riser / base structure flotation analyses. FS = 1.25 minimum.
- ☐ ☐ ☒ Downstream danger reach study (if conditions warrant).
- ☐ ☐ ☒ Upstream backwater analyses onto offsite adjacent property (if conditions warrant).
- ☐ ☐ ☒ 100 year floodplain impacts (if conditions warrant).

Yes No N/A

☐ ☒ ☐ **GEOTECHNICAL REQUIREMENTS**

- ☐ ☒ ☒ Geotechnical report with recommendations specific to BMP facility type selected by a registered professional engineer.
- ☐ ☐ ☒ Initial Feasibility Testing requirements satisfied as per Appendix E of the James City County Guidelines for Design and Construction of Stormwater Management BMPs manual. (Infiltration, Bioretention and Filtering System BMP types only).
- ☐ ☐ ☒ Concept Design Testing requirements satisfied as per Appendix E of the James City County Guidelines for Design and Construction of Stormwater Management BMPs manual. (Infiltration, Bioretention and Filtering System BMP types only).
- ☐ ☒ ☐ Minimum Boring locations: borrow area, pool area, principal control structure, top of facility near one abutment or emergency spillway if provided.
- ☐ ☒ ☐ Boring logs with Unified Soil Classification (ASTM D2487), soils descriptions and depths to bedrock and the seasonal water table indicated.
- ☒ ☐ ☐ Monitoring/inspection of facility required by professional during construction for certification.

☒ ☐ ☐

PRINCIPAL SPILLWAY PROFILE AND ASSOCIATED DETAILS

☒ ☐ ☐

EXISTING GROUND AND PROPOSED GRADE

- ☒ ☐ ☐ Embankment or excavation side slopes labeled (3H:1V maximum).
- ☒ ☐ ☐ Minimum top width labeled (per VESCH or VSMH requirements).
- ☐ ☒ ☐ Removal of unsuitable material under proposed facility (per geotechnical report requirements).

☒ ☐ ☐

CORE TRENCH

- ☒ ☐ ☐ Material (per plan or geotechnical report requirements).
- ☒ ☐ ☐ Bottom width (4' minimum or greater as dictated by geotechnical report recommendations).
- ☒ ☐ ☐ Side slopes (1:1 maximum steepness)
- ☒ ☐ ☐ Depth (4' minimum or greater as dictated by geotechnical report recommendations).

Yes No N/A

☒ ☐ ☐ **PRINCIPAL CONTROL STRUCTURE. RISER OR SIMILAR STRUCTURE (DETAILS REQUIRED FOR ALL ITEMS)**

- ☒ ☐ ☐ Durable, resistant material (concrete preferred).
- ☒ ☐ ☐ Riser diameter is at least 1.25 times larger than barrel diameter.
- ☒ ☐ ☐ All pertinent dimensions and elevations shown.
- ☒ ☐ ☐ Control orifice or weir dimensions and elevations shown.
- ☒ ☐ ☐ Trash rack - removable - for each release.
- ☒ ☐ ☐ Anti-vortex device, baffle or plate.
- ☒ ☐ ☐ Riser base structure with dimensions and embedment specifications (concrete preferred).
- ☒ ☐ ☐ Interior access (steps, ladders, etc.) for maintenance for structures over 4 feet in height. Excessively high risers may need some form of exterior access on top portion.
- ☒ ☐ ☐ Low flow orifice with ~~cage-type trash rack~~.

TURN-DOWN ELEVATION

☒ ☐ ☐ **PRINCIPAL CONTROL STRUCTURE OUTLET BARREL**

- ☒ ☐ ☐ Material (ASTM C-361 reinforced concrete pipe) with watertight joints. Prior approval required for all other pipe material (CMP, CPP, PVC, etc.).
- ☒ ☐ ☐ Support and bedding requirements for barrel - concrete cradles, etc. (detail required).
- ☒ ☒ ☐ Pipe inverts, length, size, class and slope shown.
- ☒ ☐ ☐ Flared end section or endwall provided on barrel outlet.

☒ ☐ ☐ **SEEPAGE CONTROL**

- ☐ ☐ ☐ Phreatic line shown (4:1 slope measured from the intersection of the embankment and the principal spillway design high water).

☒ ☐ ☐ **ANTI-SEEP COLLARS**

- ☒ ☐ ☐ Anti-seep collar, concrete preferred (detail required).
- ☒ ☐ ☐ Size - 15 percent increase in length of saturation using outside pipe diameter.
- ☒ ☐ ☐ Spacing and location on barrel (located at least 2 feet from a pipe joint).

☐ ☐ ☒ **FILTER DIAPHRAGM**

- ☐ ☐ ☒ Design based on latest NRCS design methods and certified by a professional engineer.

Yes No N/A

☒ ☐ ☐ **ELEVATION AND DIMENSIONAL DESIGN DATA**

- ☒ ☐ ☐ Top of facility - construction height and settled height (10 percent settlement).
- ☒ ☐ ☐ Crest of emergency spillway.
- ☒ ☐ ☐ Crest of principal control (riser) structure.
- ☒ ☐ ☐ Inverts of control release orifices, weirs, tubes, etc. . .
- ☒ ☐ ☐ Pools: permanent; extended detention; 1-year; 2-year; 10-year; 100-year; and appropriate safety storms.
- ☒ ☐ ☐ Crest of principal control structure spillway at least one (1) foot below crest of emergency spillway, if provided.
- ☒ ☐ ☐ Minimum freeboard of one (1) foot above the 100-year design high water elevation for facilities with an emergency spillway.
- ☐ ☐ ☒ Minimum freeboard of two (2) feet above the 100-year design high water elevation for facilities without an emergency spillway or in accordance with the SCS National Engineering Handbook (prior approval required).
- ☒ ☐ ☐ Inlet and outlet invert shown for all barrels (with slopes in percent).
- ☒ ☐ ☐ Basin clean out elevation from maintenance plan.

☒ ☐ ☐ **CROSS SECTION THROUGH FACILITY ALONG CENTERLINE**

- ☒ ☐ ☐ Existing Ground.
- ☒ ☐ ☐ Proposed grade.
- ☒ ☐ ☐ Top of facility - constructed and settled.
- ☒ ☐ ☐ Location of emergency spillway with side slopes labeled (emergency spillway in cut).
- ☒ ☐ ☐ Bottom of core trench (4' minimum).
- ☐ ☒ ☐ Location of each soil boring.
- ☒ ☐ ☐ Barrel location.
- ☒ ☐ ☐ Existing and proposed utility location/protection.

☐ ☐ ☒ **EMERGENCY SPILLWAY PROFILE**

- ☐ ☐ ☒ Existing ground.
- ☐ ☐ ☒ Inlet, level (control) and outlet sections per SCS.
- ☐ ☐ ☒ Spillway and crest elevations.

- ☒ ☐ ☐ **PRETREATMENT DEVICES** properly designed based on required pretreatment volumes for the selected County BMP facility type. Including, but not limited to: sediment forebays, sediment basins, sumps, grass channels, gravel diaphragms, plunge pools, chamber separators or other acceptable methods.

Yes No N/A

☒ ☐ ☐ **CONSTRUCTION SPECIFICATIONS and NOTES**

- ☒ ☐ ☐ Anticipated sequence of construction for BMP (consistent with erosion and sediment control plan).
- ☒ ☐ ☐ Provisions to control base stream or storm flow conditions encountered during construction.
- ☒ ☐ ☐ Site and subgrade preparation requirements.
- ☒ ☐ ☐ Embankment, fill and backfill material soil and placement (lift) thickness requirements.
- ☒ ☐ ☐ Compaction and soil moisture content requirements..
- ☒ ☐ ☐ Storm drain, underdrain and pipe conduit requirements.
- ☒ ☐ ☐ Minimum depth of pipe cover for temporary (construction) and final cover conditions.
- ☒ ☐ ☐ Permanent shutoff valve and pond drain.
- ☒ ☐ ☐ Concrete for structural components.
- ☒ ☐ ☐ Riprap and slope protection.
- ☒ ☐ ☐ Temporary and permanent stabilization measures.
- ☐ ☐ ☒ Temporary safety measures and permanent fencing.
- ☒ ☐ ☐ BMP Landscaping (deep, shallow, fringe, perimeter, etc.)
- ☐ ☐ ☒ Dust and traffic control (if warranted).
- ☒ ☐ ☐ Construction monitoring and certification by professional.

☒ ☐ ☐ **MAINTENANCE PROVISIONS**

- ☒ ☐ ☐ Person or organization responsible for maintenance.
- ☒ ☐ ☐ Inspection and maintenance agreement executed.
- ☒ ☐ ☐ Maintenance Plan which outlines the long-term schedule for inspection and maintenance of the facility and forebays, if provided.
- ☒ ☐ ☐ Maintenance access from public right-of-way or publicly traveled road.
- ☒ ☐ ☐ Maintenance easement minimum 15 feet around 100-year pool elevation (25 feet recommended).
- ☒ ☐ ☐ Fence or minimum 6 foot wide public safety shelf.

IV. OUTLET PROTECTIONS:

Yes No N/A

- ☒ ☐ ☐ Sized for maximum design release (generally 10-year storm).
- ☒ ☐ ☐ Flared end section or endwall.
- ☒ ☐ ☐ Outlet protection dimensions.
- ☒ ☐ ☐ Slope at 0 percent (Level Grade).
- ☒ ☐ ☐ Riprap size and quantity.
- ☒ ☐ ☐ Riprap placement thickness (1.5 Times Maximum Stone Diameter)
- ☒ ☐ ☐ Geotextile lining (nonwoven).
- ☐ ☐ ☒ Special energy dissipators are required for design discharge velocities that exceed eighteen (18) feet per second; or if use of standard outlet protection would result in velocities exceeding permissible channel velocities; or if space restricts or limits their use.

V. ADDITIONAL COMMENTS OR INFORMATION SPECIFIC TO THE PLAN:

This image shows a single sheet of white paper with horizontal ruling lines. The lines are evenly spaced and run across the width of the page. There is no handwriting or other markings on the paper.

Prepared By: Robert W. Wynn
Date: 7/3/01

Date: 7/3/01

SWMPProg/BMP/Checklist/chklst.0

ENVIRONMENTAL DIVISION REVIEW COMMENTS
IRONBOUND VILLAGE PHASE I (23 Lots)
COUNTY PLAN NO. S - 36 - 01
April 25, 2001

MDW/SJT

General Comments:

1. A Land Disturbing Permit and Siltation Agreement, with surety, are required for this project.
2. A Subdivision Agreement, with surety, shall be executed with the County prior to recordation of lots.
3. Water and sewer inspection fees must be paid prior to the issuance of a Land Disturbing Permit.
4. An Inspection/Maintenance Agreement shall be executed with the County for the BMP facility for this project.
5. A streetlight rental fee for 5 lights must be paid prior to the recordation of the subdivision plat.
6. VPDES. It appears land disturbance for both portions of the project (Phases I and II) may exceed five acres. Therefore, it is the owners responsibility to register for a General Virginia Pollutant Discharge Elimination System (VPDES) Permit for Discharges of Stormwater from Construction Activities, in accordance with current requirements of the Virginia Department of Environmental Quality and 9 VAC 25-180-10 et seq. Contact the Tidewater Regional Office of the DEQ at (757) 518-2000 or the Central Office at (804) 698-4000 for further information.
7. Site Tabulation. Provide an impervious cover estimate for the subdivision phase of the project.
8. Drainage Easements. All drainage easements within the subdivision shall remain private, dedicated to an HOA or similar responsible entity.

Chesapeake Bay Preservation:

9. Impervious Cover. It is unclear if the subdivision and site plan sites (Phase I and II) in combination, maintain an impervious cover value of less than 60 percent in accordance with Section 23-9 of the Chesapeake Bay Preservation ordinance.

Erosion & Sediment Control Plan:

10. Design Checklist. Please provide a standard James City County Erosion and Sediment Control and Stormwater Management Design Plan Checklist.
11. Temporary Stockpile Areas. Show any temporary soil stockpile, staging and equipment storage areas (with required erosion and sediment controls) or indicate on the plans that none are anticipated for the project site. The sequence of construction states that the topsoil will be stripped but there is no stockpile location shown.
12. Offsite Land Disturbing Areas. Identify any offsite land disturbing areas including borrow, waste, or disposal sites (with required erosion and sediment controls) or indicate on the plans that none are anticipated for this project.
13. Site Features. Provide existing topography downstream of the BMP to clearly define the area between the BMP outlet and the existing stream and along the existing stream to the downstream pump station.
14. Limit of Clearing. Adjust limits of clearing to include offsite sanitary sewer installation.

15. Narrative. Provide a brief erosion and sediment control and stormwater management plan narrative in accordance with VESCH and County checklist requirements.
16. Sequence of Construction. Installation of the temporary sediment basin will require an extreme amount of cut and earthmoving (stockpiling) prior to use as a primary site control. As this installation is early on in the construction sequence, the installation of perimeter diversion dikes cannot take place until the sediment basin is in place and functional, otherwise there is no place for intercepted site runoff to be conveyed and controlled. Therefore, Step 4 in the construction sequence must precede installation of diversion dikes in Step 2.
17. Diversion Dikes. On the Phase I E&SC plan, the diversion dike along the east side of the project, near offsite Lots 16-18 at Belen Heights Subdivision, traverses to a low topography point. Onsite drainage cannot be physically conveyed to the temporary sediment basin as the diversion dike would need to run uphill. A temporary sediment trapping facility would need to be installed at the low topography area to provide adequate perimeter control for the southeast corner of the site.
18. Diversion Dikes. Runoff from perimeter diversion dikes need to be adequately conveyed into the temporary sediment basin using temporary slope drains, stormwater conveyance channels or stabilized outlets. Runoff should not be conveyed in a concentrated fashion across the TSB's graded sideslopes. *(Note: On Sheet 9, the diversion dikes are currently shown along the top ridge of the basin with no effective method to convey runoff into the basin.)*
19. Silt Fences. Adjust site silt fences to coincide with the defined limit of work (clearing and grading), especially around the temporary sediment basin. Remove the silt fence from across the pond's emergency spillway.
20. Stormwater Conveyance Channels. Label the dot-dashed line (ditch centerline) going to storm drain structures SS # 8, SS # 6B and SS # 12 appropriately as stormwater conveyance channels. Provide supporting design computations and a typical section or construction information as appropriate for these three onsite channels. Include slope, channel configuration, side slopes, lining, etc.
21. E&SC Measures. Provide inlet protections and rock check dams on the plan as called for in the Step 8 of the sequence of construction.
22. Outlet Protections. In accordance with Step 8 of the sequence of construction and the VESCH, provide riprap outlet protection for storm drain system outfalls into the BMP and at the outfall end of the BMP barrel. Specify riprap class and thickness, pad dimensions and amount of stone to be used. *(Note: Design velocities at storm drain outfalls SS # 1A and SS # 1 are quite excessive at 21.5 fps and 10.21 feet per second respectively. The dissipator at SS # 1A may require a special design structure).*
23. E&SC Details. Provide specific details necessary for the temporary sediment basin per VESCH Minimum Standard 3.14. Provide details for all other primary structural erosion control measures being utilized for the site; or alternatively, if the details are non-modified or standard duplication from the handbook provide adequate reference to applicable minimum standards of the VESCH.
24. Temporary Sediment Basin. Submit a Sediment Basin Design Data Sheet to ensure design is in accordance with Minimum Standard 3.14 of the VESCH. Since installation will be a first step measure, provide details as necessary to modify the BMP riser for use during construction.
25. Channel Adequacy. The current design plan utilizes two small size HDPE collection lines to collect roof drain runoff from the home sites. If these conveyance systems are eliminated from the design plan, then channel adequacy computations in accordance with MS # 19 would be required for the offsite drainage channels that would receive drainage from Lots 8-15 and Lots 16-23.

Uncontrolled backlot drainage can not cause a drainage problem within the existing offsite channels or at existing properties to the north (n/f W.H. Lewis) or to the east (n/f Belen Heights Subdivision).

Stormwater Management / Drainage:

26. Open Space Credit. The BMP worksheet shows 1.43 points were taken for natural open space credit based on 1.11 acres (or 14.32%) of the site. Based on the inset map, the thin strip of open space located in the northeast corner of the site (just east of the BMP) is not of acceptable minimum width (35 feet) and is located along a proposed JCSA gravity sewer easement. The total natural open space tabulation cannot include this portion. Adjust the map and BMP worksheet accordingly.
27. Open Space Credit. Area slated for natural open space (ie. conservation easement) at Lots 18, 19 and 20 is shown for clearing and grading. To receive open space credit under the 10 point system, open spaces cannot be disturbed during project construction. See the JCC BMP manual, page 56. Adjust the inset map and BMP worksheet accordingly.
28. Adequate Outflow. Outflows from SWM/BMP facility must be discharged to a well-defined, natural drainage channel. Facilities discharging onto flat areas with no defined channel usually require a channel to be provided which can adequately convey design flows (discharges). The topography and features shown on Sheet 7 and 8 do not show a defined channel below the pond barrel outlet.
29. BMP Design. Design computations for the BMP as presented in the design report are incomplete. The last two pages of the report are not readable. No information appears is provided to support volumes associated with the water quality wet and extended detention pools or to verify the low-flow orifice size provides adequate drawdown time for water quality or stream channel protection criteria. Additional information is required to support peak discharge hydrologic assumptions for pre- and post-development including: drainage areas, composite runoff coefficients and times of concentration. Refer to Section III of the standard erosion and sediment control and stormwater management design plan checklist for information that is required to be presented.
30. BMP Design. A County Type A-3 ten point wet extended detention facility has a required treatment volume of 2" per impervious acre usually split evenly between the wet and extended detention pools.
31. BMP Hydraulics. Pond data in the reservoir report section of the stormwater management design report does not match the construction plan. Ensure the outfall barrel and orifice sizes and invert elevations reasonably match construction plan information. Provide information to support the assumption that no tailwater conditions exist at the BMP outfall for the hydraulic routing.
32. BMP Design. Provide a 1 ft. minimum separation between the principal and emergency spillways.
33. Pond Drain. Included pond drain computations and specifications on the type of valve required.
34. Concrete Riser and Barrel. Specify watertight reinforced concrete pipe meeting the requirements of ASTM C361 or a manhole section meeting the requirements of ASTM C478 for the concrete riser. Similarly, specify watertight pipe meeting ASTM C361 for the outlet barrel and indicate class of pipe required. Show dimensions for the concrete riser base and provide flotation computations.
35. Pond Construction. The pond section on Sheet 6 is substantially incomplete. Provide notes or details showing specific construction requirements for the pond (fill) embankment. Include requirements for sub-grade preparation, embankment soils, fill placement and compaction, an impervious core and core trench and seepage controls(anti-seep collars, toe drain, etc.), as applicable.
36. Emergency Spillway. Provide a typical section or additional information for the emergency spillway including bottom width, sideslopes, type/depth of rock lining required, geotextile, etc.

37. Safety Bench. Due to the depth of the permanent pool, 3H:1V interior side slopes and the considerable excavation depth, include provisions for an intermediate safety bench within the BMP, especially along the west and south sides (ie. road and lot sides).
38. Sediment Forebay. Provide spot elevations on Sheet 8 for the basin bottom and top berm at the forebay. Based on the pond's configuration and excessively cut slopes and depth from the service road, access to the sediment forebay for cleaning purposes would be difficult if not impossible.
39. Maintenance Plan. Provide a maintenance plan for the stormwater management/BMP facility.
40. Roof Drain Collection System. Provide additional information for north and east roof drain collection systems along Lots 8-15 and Lots 16-23. Include pipe sizing computations, end inverts or minimum slopes, minimum burial depth, a typical installation detail, a description of how and when individual lots are to be connected and intermediate cleanout structures. For this application, the type of corrugated polyethylene pipe should be clearly specified such as AASHTO M252 or M294 with reference to ASTM D2321 for installation. In addition, the roof drains should be within a drainage easement and the long-term maintenance plan should address cleanout requirements associated with the small-size collection systems.
41. RCP Pipe. Show class required for all proposed onsite RCP storm drain pipe and culverts.
42. Storm Drain Design. The runoff coefficient of 0.35 as used for the drainage subareas tributary to storm structures SS # 6B and SS # 8 appears questionable. These areas contain impervious areas associated with existing and future roads, buildings, homes, driveways, etc.
43. Storm Drain Design. Design velocities for portions of the 15-inch and 24-inch pipe sizes are quite excessive (above 10 feet per second) where scour of the pipe lining may occur.
44. Storm Drain Design. Include hydraulic grade line computations for the onsite storm drain system.
45. Geotechnical. Provide information (preliminary soil evaluations, logs, test results, reports, etc.) as necessary to substantiate that existing soils beneath the BMP are adequate to sustain a permanent pool as intended for water quality purposes and to assess soil/groundwater conditions that may be encountered due to excessive pond excavations approximately 20 foot in depth from natural ground.

need
initials for
Release